



Report of Geotechnical Exploration

Proposed Pickleball Courts

Canal Road
Orange Beach, Alabama

GeoCon Project No. DL 4650-24

Prepared For:

Mr. Glenn Smith
City of Orange Beach
P.O. Box 458
Orange Beach, Alabama 36561

Date: December 17, 2024

Prepared By:
GeoCon Engineering & Materials Testing, Inc.
22830 McAuliffe Drive
Robertsdale, Alabama 36567

GeoCon

Engineering & Materials Testing, Inc.

December 17, 2024

City of Orange Beach
P.O. Box 458
Orange Beach, Alabama 36561

Attn: Mr. Glenn Smith

RE: Report of Geotechnical Exploration
Proposed Pickleball Courts
Canal Road
Orange Beach, Alabama
GeoCon Project No. DL 4650-24

Dear Mr. Smith:

GeoCon Engineering & Materials Testing, Inc. is pleased to submit this report of geotechnical exploration for the above referenced project. Included in this report is a summary of our understanding of the project, results of the field exploration, and our recommendations for site grading and foundation construction along with pavement build-up recommendations. This testing has been performed in general accordance with our earlier discussions with you.


Enclosed please find our report with evaluations and recommendations followed by an Appendix which includes a Site Location Map, Test Location Plan, graphical logs of the soundings and borings, laboratory test data, a Unified Soil Classification Chart, important notes about your Geotechnical Report and the Terms and Conditions that govern our work.

We appreciate the opportunity to have provided you with our geotechnical engineering services. If you have any questions concerning this report, or if we can be of any further assistance, please contact our office.

Sincerely,

GeoCon, Inc.


David R. McKee, P.E.
Geotechnical Engineer

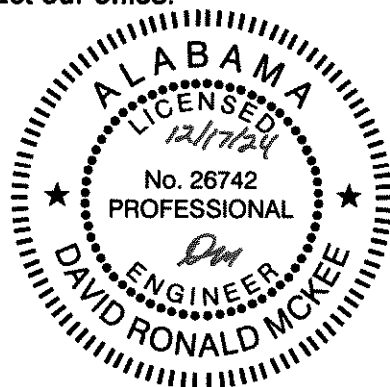



Hayden R. Mason, E.I.
Staff Engineer

TABLE OF CONTENTS

	Page No.
1.0 Project Description	3
2.0 Geotechnical Exploration	3
3.0 Soil Conditions Encountered	4
4.0 Groundwater Conditions Encountered.....	4
5.0 Laboratory Testing	5
6.0 Site Preparation Recommendations	5
6.1 General Site Preparation	5
6.2 Recommended Subgrade Preparation.....	5
6.3 Site Drainage.....	7
6.4 Placement of Structural Fill.....	7
6.5 Weather Considerations	8
6.6 Unit Costs.....	8
6.7 Testing Requirements.....	8
7.0 Shallow Foundation Recommendations	9
8.0 Ground Floor Slabs	9
9.0 Pavement Recommendations	10
9.1 Pavement Subgrade.....	10
9.2 Asphalt Pavement	10
9.3 Overlay Considerations	11
9.4 Concrete Pavement.....	12
10.0 Closure	12

1.0 Project Description

The project subject to this report is the construction of the new pickleball court facility located along Canal Road in Orange Beach, Alabama. The location of the subject site is shown on the attached Site Location Map (Figure 1). During our November 2024 field exploration, the test locations were accessible to our equipment and personnel.

2.0 Geotechnical Exploration

Soil conditions were investigated by performing two (2) Cone Penetration Test (CPT) soundings to depths of about 16 feet below the existing ground surface in the proposed restroom/pavilion area. In addition, twenty-four (24) manual hand auger borings were extended to depths of about 4 to 5 feet below the existing ground surface in the proposed pickleball courts and pavement areas. Two asphalt cores and hand auger borings (borings B-25 and B-26) were taken from the existing portion of Walker Lane to determine the in-place asphalt thickness. The general sounding and boring locations are shown on the attached Test Location Plan (Figure 2). GPS coordinates for the sounding locations are shown on the respective sounding logs.

CPT testing was performed in accordance with ASTM D-5778 using a Vertek S4 electronic CPT rig. CPT testing includes pushing an electronic cone on a series of rods into the ground at a constant rate. The electronic cone collects continuous measurements of the resistance to penetration of the cone tip and side friction sleeve. Correlations between Cone Resistance values and Standard Penetration Test (SPT) "N" values were performed using methods developed by Robertson, Campanella and Wightman. The CPT logs attached in the appendix show the cone tip stress, sleeve stress, pore pressure, correlated "N" value and the soil behavior type (SBT). At each test sounding location, samples were collected of the soils encountered in the upper 4 feet of the soil-profile.

The hand auger test borings included Dynamic Cone Penetrometer (DCP) soundings to evaluate relative soil density/consistency characteristics. With the DCP, a 1½-inch diameter cone is seated to penetrate any loose cuttings, and then driven in 1¾-inch increments with blows from a 15-pound weight falling 20 inches. The number of blows required to drive the cone the 1¾-inch increments is an index of relative soil strength and compressibility. Samples collected were visually classified by GeoCon, Inc. personnel, placed in containers and transported to our laboratory for further testing and for further review by our engineering staff. Samples will be retained at our lab for a period of 60 days after the date of this report. If no written instructions are given to GeoCon, we will discard the samples after 60 days.

3.0 Soil Conditions Encountered

The soundings initially penetrated about 6 inches of organic topsoil material. Below the organic topsoil material, the soundings generally penetrated sand, sand with silt, silty sand, and clay soils to sounding termination at depths of about 16 feet below the existing ground surface. Most of the borings initially encountered about 2 to 18 inches of organic topsoil material. The remaining borings initially encountered varying amounts of sandy fill, aggregate base, and asphalt pavement. Below the organic topsoil material, sandy fill, aggregate base, and asphalt pavement, the borings generally encountered sand, sand with silt, and silty sand soils to boring termination at depths of about 4 to 5 feet below the existing ground surface. Table 1 below presents the existing asphalt thicknesses and underlying base/soil type encountered at the boring locations.

Table 1: Existing Asphalt Thicknesses

Boring Location	Asphalt Thickness	Base Thickness	Base Material	Subgrade Soil
B-25	2 $\frac{1}{8}$ Inches	8 inches	Silty Sand with Aggregate Base	Sand with Silt
B-26	2 $\frac{1}{4}$ Inches	6 Inches	Aggregate Base	Silty Sand

Based on the cone tip friction values and the correlated Standard Penetration Test values (N-values), the sand, sand with silt, and silty sand soils were generally in a loose to very firm condition. The clay soils were generally in a very soft to firm condition. Based on the DCP values, the soils encountered were generally in a very loose to very firm condition. A more detailed description of the soil conditions encountered is shown on the Sounding and Boring Logs in the Appendix.

4.0 Groundwater Conditions Encountered

Groundwater was encountered at twenty-four (24) test locations at depths of about 6 inches to 4 feet below the existing ground surface at the time of the field exploration. The remaining test locations did not encounter groundwater for the depths explored at the time of the field exploration. Groundwater conditions are subject to seasonal variations and are expected to fluctuate in response to local variations in precipitation and drainage conditions. Considering the relatively short time frame of the field exploration, groundwater levels may not have had sufficient time to stabilize. Therefore, actual depths to groundwater may vary.

Based on the sounding and boring data, we anticipate that groundwater may be encountered during subgrade preparation. If groundwater is encountered, the use of well-points, tail ditches, temporary underdrains, etc. may be required to facilitate subgrade preparation.

5.0 Laboratory Testing

The soil samples taken from the site were visually classified in general accordance with the guidelines of ASTM D-2487 Standard Classification of Soils for Engineering Purposes (Unified Soil Classification System). The quantity and type of laboratory tests performed for this geotechnical study were determined and adjusted by GeoCon engineering personnel based on the uniformity and characteristics of the subsurface soil conditions encountered and our experience and knowledge of local soil conditions.

Laboratory soil tests were performed to aid in the classification of the soils and to help in the evaluation of engineering characteristics of the soils. Representative soil samples recovered from the soil test locations were selected for grain-size analysis (7 tests). The laboratory data is shown on the attached lab data sheets.

6.0 Site Preparation Recommendations

6.1 General Site Preparation

The subgrade soils at this site are prone to rutting and displacing/pumping during the initial phases of site grading, especially if wet weather conditions persist during site preparation. We recommend that low ground pressure track mounted equipment be used in the debris/topsoil removal and general site preparation. The use of heavy rubber tire equipment will deteriorate the subgrade soil conditions and increase the risk for excessive rutting or pumping.

Areas beneath and 3 feet beyond the restroom/pavilion area and 2 feet beyond the pickleball courts and pavement areas should be designated as "controlled areas". The initial phase of site preparation should include the complete removal of organic topsoil, buried debris, old foundation systems, utilities, pavements, etc. from within the "controlled areas".

6.2 Recommended Subgrade Preparation

Restroom/Pavilion "Controlled Area":

Below depths of about 11 feet, the soundings penetrated unstable clay soils. These soils are prone to unacceptable settlement under the loads imposed by the structural loading of the structures coupled with the fill required to reach final subgrade elevations. Buildings supported on typical shallow foundations bearing over these compressible soils could exhibit cracking and other settlement related issues.

To reduce the potential for differential settlement due to the unstable soils, we recommend that a geogrid reinforced building pad be installed consisting of two (2) layers of geogrid. The geogrid and fill layers described below should be placed below the entire restroom/pavilion area and extend laterally at least 6 feet past the perimeter foundations.

Following the initial phase of site preparation, grades in the restroom/pavilion "controlled area" should be adjusted to allow for the placement of the geogrid reinforced building pad

below the foundations. The exposed subgrade should be reviewed by a representative of the project Geotechnical Engineer of Record, and be level and free of loose debris, exposed organic material, aggregate, etc. prior to placement of the initial layer of geogrid. Any soils determined to be unsuitable should be further undercut in accordance with the recommendation of the project Geotechnical Engineer. The fill required to reach the bottom of the geogrid reinforced building pad elevation should meet the requirements of Section 6.4 of this report.

The initial layer of geogrid should be placed on the approved subgrade followed by a 9-inch-thick lift of select sand fill that is compacted to 95% ASTM D-698 standard density by "tracking" the material in. The select sand fill material should include "clean" coarse sand and exhibit less than 10% passing the No. 200 sieve (fines). The 2nd layer of geogrid should then be placed and another lift of select sand fill placed in a 9-inch-thick lift compacted to 95% ASTM D-698 standard density. The remaining lifts of fill required to establish final subgrade elevations should be placed in 8-inch lifts, compacted to 98% ASTM D-698 standard density and meet the guidelines provided in Section 6.4 of this report.

Geogrid should consist of Tensar NX750 material and should be placed as per the manufacturer's recommendations. The end roll and side roll joints should be lapped by 3 feet. A detail is attached that shows the geogrid reinforced building pad system.

Note: It is critical for the footing excavation (or any other utility trench) not to cut into the layers of geogrid. The project Civil Engineer, Structural Engineer and contractor should coordinate the elevation of the top geogrid layer so that this layer is at least 9 inches below the bottom of the lowest foundation footing. If the geogrid is cut, the reinforced building pad will not perform as designed.

The geogrid reinforced building pad system has been designed based on a maximum of 4 feet of fill. If the required fill height exceeds 4 feet, GeoCon should be contacted for further evaluation. The maximum fill height includes fill placed during site grading and stem wall backfill (if any).

Pavement "Controlled Areas":

Following the initial phase of site preparation, the exposed subgrade in the pavement "controlled areas" should be static rolled with a smooth drum roller and reviewed by a GeoCon earthwork technician. Subgrade soils that are determined to be unsuitable should be further undercut in accordance with the recommendations of the project Geotechnical Engineer. The structural fill required to reach final subgrade elevations should meet the guidelines of section 6.4 of this report.

We understand that the existing asphalt along Walker Lane is intended to be milled and overlaid. Following the milling process, caution should be taken to limit traffic on the milled asphalt surface. Traffic on the milled asphalt surface could damage the remaining asphalt and underlying base/subgrade soils. We recommend that a minimum of one inch of the existing asphalt be milled in order to remove surficial oxidized asphalt. The intent of milling a minimum of one inch of asphalt is to allow for a remaining asphalt thickness of about one inch. Additional maintenance may also be required if the existing roadway is milled and overlaid.

Pickleball Court "Controlled Areas":

Following the initial phase of site preparation, the exposed subgrade in the pickleball court "controlled areas" should be static rolled with a smooth drum roller and reviewed by a GeoCon earthwork technician. Subgrade soils that are determined to be unsuitable should be further undercut in accordance with the recommendations of the project Geotechnical Engineer. The structural fill required to reach final subgrade elevations should meet the guidelines of section 6.4 of this report.

6.3 Site Drainage

Positive drainage is important for the recommended subgrade preparation and should be maintained throughout the project's construction process. The "controlled areas" should be maintained in a well-drained condition that will promote the continual removal of surface water that may flow over the construction areas. During construction, the contractor should exercise caution during inclement weather to ensure the subgrade and structural fill courses are not degraded by construction traffic. Water should not be allowed to pond against foundations or pavements during and following construction. Ponding water adjacent to foundations and pavements can lead to settlement due to deterioration of the foundation bearing soils.

6.4 Placement of Structural Fill

Structural fill required to achieve final subgrade elevations should be placed in 8-inch loose lifts and compacted to 98% ASTM D-698 standard density. Structural fill should be placed at moisture contents within +/- 3% of the material's optimal moisture content. Once the surface of each lift of structural fill is ready for the next lift, the exposed soil should be maintained at the placed moisture content until the next lift of fill is placed.

Structural fill should originate from an approved off-site borrow source and should meet the following minimum requirements:

- 1) Exhibit SP or SP-SM classification according to the Unified Soil Classification System
- 2) Have a maximum of 10% soil fines passing the No. 200 sieve
- 3) Have a maximum Liquid Limit (LL) of 20
- 4) Have a maximum Plasticity Index (PI) of 0 (non-plastic)
- 5) Have a minimum standard Proctor (ASTM D-698) maximum dry density of 98 pcf

6.5 Weather Considerations

Weather conditions at the time of site preparation will directly impact earthmoving activities. Exposed subgrade soils and structural fill soils can be expected to degrade during wet weather conditions. Additional soil processing and drying efforts are typically required during wet weather conditions.

6.6 Unit Costs

Soils are not uniform in nature and variations in soil conditions should be expected. Also, weather prior to and during site grading has a direct effect on subgrade soil conditions and the amount of processing or undercut required to provide a stable subgrade. Therefore, we recommend that the contract documents establish a unit cost (per cubic yard) for undercutting and replacing unsuitable soil. In addition, we recommend that the contract documents include a unit cost (per liner foot) for the installation of typical underdrains (if required).

6.7 Testing Requirements

The geotechnical consultant should monitor and document the results of the topsoil stripping, debris removal, subgrade proof-rolling, correction of weak soil conditions and the conditions of the final subgrades, foundation construction, and floor slab bearing soils.

During fill placement, field density testing should be performed to confirm that the specified compaction criteria are being achieved. As a general guide, we recommend that at least three (3) compaction tests be performed for each lift of fill in the restroom/pavilion "controlled area" and a minimum of one (1) field density test be performed for each 3,000 square feet per lift of fill in the pickleball court and pavement "controlled areas". Sufficient samples of on-site soils should be collected for Proctor compaction tests to provide the moisture-density relationships needed for compaction control. Sufficient samples of structural fill materials should be submitted by the contractor for classification and Proctor density tests to show substantial compliance with the specifications and to provide the moisture-density relationships needed for compaction control. It is important that proper quality assurance testing be performed during site grading.

A minimum of one (1) field density test should be performed per each 150 linear feet (per each 2 ft. of vertical thickness) of fill placed at utility trenches extending through the "controlled areas". Current OSHA regulations should be followed with respect to excavations for this project. Heavy construction traffic and stockpiling of excavated earth should not be permitted near the top of open unsupported excavations.

7.0 Shallow Foundation Recommendations

Provided the restroom/pavilion "controlled area" is prepared in accordance with this report, the proposed structure can be supported by typical reinforced concrete spread foundations. Foundations can be designed using a net allowable soil bearing pressure up to 1,500 psf. The allowable soil bearing pressure applies to dead loads plus design live loads. Perimeter wall foundations should bear at a minimum depth of 18 inches below finished subgrade levels. The bottom of interior foundations should bear at a minimum depth of 18 inches below the top of the concrete floor slabs. The bottom of all foundation footings should be compacted to at least 95% standard Proctor density prior to reinforcing steel (rebar) and concrete placement. Please note the bottom of the foundations should be no closer than 9 inches from the top geogrid layer and the geogrid layer(s) should not be cut by utility trench excavations.

Lateral and uplift loads can be resisted by passive pressure of the soil acting against the side of the individual footings and/or the friction developed between the base of the footings and the underlying soils. For compacted backfill, the passive pressure may be taken as the equivalent to the pressure exerted by a fluid weighing 350 pounds per cubic foot (pcf). A coefficient of friction equal to 0.32 may be used for calculating the frictional resistance at the base of spread footings. These lateral resistance values are based on the assumption that the foundations can withstand horizontal movements on the order of ¼ inch. Spread foundation depths can be increased for uplift resistance as required. A soil unit weight of 98 pcf can be used for backfill atop foundations.

Soils exposed in the bottom of all satisfactory excavations should be protected against disturbance, excessive drying, freezing or rain. Surface runoff should be drained away from excavations and not allowed to pond. The saturation of soils at the footing bearing elevation level can reduce their strength and load carrying ability. Concrete for foundations should be placed as soon after completion of the excavations as possible. If a delay in concrete placement is expected or if exposed to wet weather, a 2 to 3 inch "mud mat" consisting of lean concrete should be placed in the footing excavations to protect the bearing soils.

The "frost penetration" depth in the areas of this project is generally taken to be less than 10 inches. Provided our recommendations for the development of the foundations and floor slabs are followed, we do not expect that the "frost penetration" will have any detrimental effects on the performance of the foundations or floor slabs.

8.0 Ground Floor Slabs

The subgrade soil beneath all ground supported floor slabs should consist of properly compacted structural fill as described in the Site Preparation Recommendations section of this report. At a minimum, a 10-mil plastic vapor barrier should be installed over the subgrade prior to installation of the floor slabs. The plastic vapor barrier should be properly lapped, and all joints and intrusions properly taped and sealed.

If moisture sensitive floor coverings are to be used or if interior slab moisture is critical, we recommend that a porous drainage layer (min. 4 inch) also be placed below the slab. A clean, free-draining pea gravel, crushed stone or coarse sand should prove satisfactory for the drainage layer. We recommend that the drainage layer material exhibit no more than 50% passing the No. 50 sieve and no more than 5% passing the No. 200 sieve.

Special attention should be given to properly compacting utility trenches in the building areas. Utility trenches below the slab areas should be compacted to 95% ASTM D-698 standard density.

9.0 Pavement Recommendations

9.1 Pavement Subgrade

The pavement recommendations provided below are based on a low volume of passenger vehicles (light-duty traffic) and low volume tractor trailers, garbage trucks, and fire trucks (medium-duty). The scope of this investigation did not include laboratory CBR testing for pavement design. Pavement design has been based on an estimated CBR value of 6 for the structural fill soils.

The recommendations in the Site Preparation Recommendations section of this report should be followed in the pavement areas. Prior to base placement, subgrade improvements should also include scarifying, moisture conditioning, and compacting the upper 6 inches of the pavement "controlled areas" to at least 100% ASTM D-698 standard density. Drainage improvements at subgrade levels should include slopes, 2% minimum, which are designed to discharge water (which may tend to pond over the subgrade) toward low collection points which are provided with positive relief to side drainage ditches or buried storm drainage. Areas which exhibit unsuitable materials, or which fail to compact properly should be corrected as per the geotechnical consultant's recommendations.

9.2 Asphalt Pavement

The following pavement build-up could be used for the proposed pickleball courts.

Asphalt Pavement Section

- 1½" Hot Mix Asphalt – Wearing Surface
- Tack Coat
- 1½" Hot Mix Asphalt – Binder Course
- 6" ALDOT Section 825 Crushed Aggregate Base Material
(100% standard density)
- Approved Subgrade (top 6 inches compacted to 100% standard density)

Note: Hot Mix Asphalt material and installation should meet the requirements of the pickleball court designer. Periodic maintenance should be performed on the pavement sections to help prolong the pavement's lifespan.

The following light-duty pavement build-up could be used in the pavement areas subject to passenger vehicle traffic (up to 1.4 E+04 ESAL's):

Light-Duty Asphalt Pavement Section (up to 1.4E+04 ESAL's)

- 1½" ALDOT Section 424A, Bituminous Wearing Surface (165 lb/sy)
- 6" ALDOT Section 825 Crushed Aggregate Base (100% standard density)
- Approved Subgrade (top 6 inches compacted to 100% standard density)

The following medium-duty pavement build-up could be used in the pavement areas subject to tractor trailer, garbage truck, and fire truck traffic (up to 1.2 E+05 ESAL's):

Medium-Duty Asphalt Pavement Section (up to 1.2E+05 ESAL's)

- 1½" ALDOT Section 424A, Bituminous Wearing Surface (165 lb/sy)
- ALDOT Section 405 Tack Coat
- 1½" ALDOT Section 424B, Bituminous Binder (165 lb/sy)
- 6" ALDOT Section 825 Crushed Aggregate Base (100% standard density)
- Approved Subgrade (top 6 inches compacted to 100% standard density)

Provided the moisture content of the base layer is at or within 2% of the base material's optimal moisture content at the time of paving, a prime coat over the base is not required. Periodic maintenance should be performed on the pavement sections to help prolong the pavement's lifespan. A quality crushed concrete material that meets the gradation requirements of ALDOT Section 825 Crushed Aggregate Base could be used.

9.3 Overlay Considerations

If milling and overlaying is desired in the areas of existing asphalt pavement, (as a cost saving measure), we recommend that a minimum of one inch of the existing asphalt be milled in order to remove surficial oxidized asphalt. The Site Preparation Recommendations section of this report provides additional considerations for milling and overlaying. At a minimum, we recommend that the existing asphalt be milled to allow for the below asphalt buildup:

Recommended Overlay Thickness

- 1½" ALDOT Section 424A, Bituminous Wearing Surface
(165 lb/sy - ½ inch Maximum Aggregate Size Mix, ESAL Range C/D)
- ALDOT Section 405 Tack Coat
- Existing asphalt pavement

9.4 Concrete Pavement

Light-duty Portland Cement Concrete (PCC) pavement could be used in light-duty traffic areas (passenger vehicles only).

Light-Duty Pavement Section

- 6" Concrete Pavement (4,000 psi compressive strength, 500 psi flexural strength)
- Approved Subgrade (top 6 inches compacted to 100% standard density)

Medium-duty Portland Cement Concrete (PCC) pavement should be used in truck unloading areas, dumpster pad locations or other areas subject to maneuvering or parking of garbage trucks or delivery trucks.

Medium-Duty Pavement Section

- 7" Concrete Pavement (4,000 psi compressive strength, 500 psi flexural strength)
- Approved Subgrade (top 6 inches compacted to 100% standard density)

Final pavement grades should be adequately sloped for positive drainage. The subgrade below concrete pavement areas should be prepared in accordance with the Site Preparation Recommendations section of this report. PCC pavements should be placed at a slump of 4 inches or less.

Joints should be installed in the PCC pavements to limit stresses resulting from expansion and contraction. Contraction joints should be formed by sawing as soon as the concrete has hardened enough to prevent raveling. These joints should extend to a depth of at least ¼ inch of the pavement thickness and be placed on a 12 to 15 foot spacing. The design and location of all pavement joints should be in accordance with recommendations of the Portland Cement Association (PCA) and ACI 330.

Isolation joint material should comply with ASTM D-1752. The upper one inch of the joint material should be removed and the joint sealed with a self-leveling elastomeric joint sealant immediately after the curing period and prior to opening to traffic. Construction joints should be properly cleaned and sealed with the same type of joint sealant. Dowel sizing and spacing for construction joints should conform to the recommendations of ACI 330.

10.0 Closure

This report has been prepared for the exclusive use of the City of Orange Beach and their project design professionals for specific application to the above referenced project in accordance with generally accepted current standards of geotechnical engineering practice common to the local area.

The comments and recommendations of this report provide manageable and reasonable solutions to the advancement of the project based on the collected test data and the provided design information. Significant changes in site conditions or project design may result in alternative solutions to the design required or may permit more manageable and economical construction techniques. Should such significant changes occur, we will be available to offer supplemental comments.

The comments and recommendations of this report are based upon our interpretation of the information supplied by the client, the data collected at the two (2) CPT soundings, twenty-six (26) hand auger borings and the site conditions observed at the time of testing. A significant amount of interpolation was necessary. Because it is not possible to know or predict detailed conditions hidden beneath the ground surface, our comments and recommendations are presented as opinions and judgements, as opposed to statements of fact.

Improper site preparation, extremes in climatic conditions, significant changes in grade, time, etc., can affect the groundwater, surface, and subsurface conditions. If conditions are encountered as the construction advances which vary significantly from those described by this report, we should be contacted for additional comment.

We have not intended to reflect specific volumes of subsurface conditions at the site. Volumetric estimates often require a large number of borings placed on a close grid with the collected data associated with civil engineering cross-sections. If volume estimates are required of us for the design/development of this project to advance, please contact us for further comment.


Again, we appreciate the opportunity to provide our geotechnical engineering services for this project. We recommend that the owner retain GeoCon, Inc. to provide construction observation and construction materials testing for the project.

APPENDIX

- A-1 Site Location Map
- A-2 Test Location Plan
- A-3 Graphical Logs of the Soundings and Borings
- A-4 Laboratory Test Data
- A-5 Geogrid Reinforced Building Pad Detail
- A-6 Unified Soil Classification Chart
- A-7 Important Notes About Your Geotechnical Report
- A-8 Terms & Conditions Sheet



Figure 1	<p>NOT TO SCALE</p> <p>SITE LOCATION MAP</p> <p>Proposed Pickleball Courts Canal Road Orange Beach, AL DL 4650-24</p>	<p>GEOCON, INC.</p> <p>22830 McAuliffe Drive Robertsdale, Alabama 36567</p>
Date 12/2/2024		

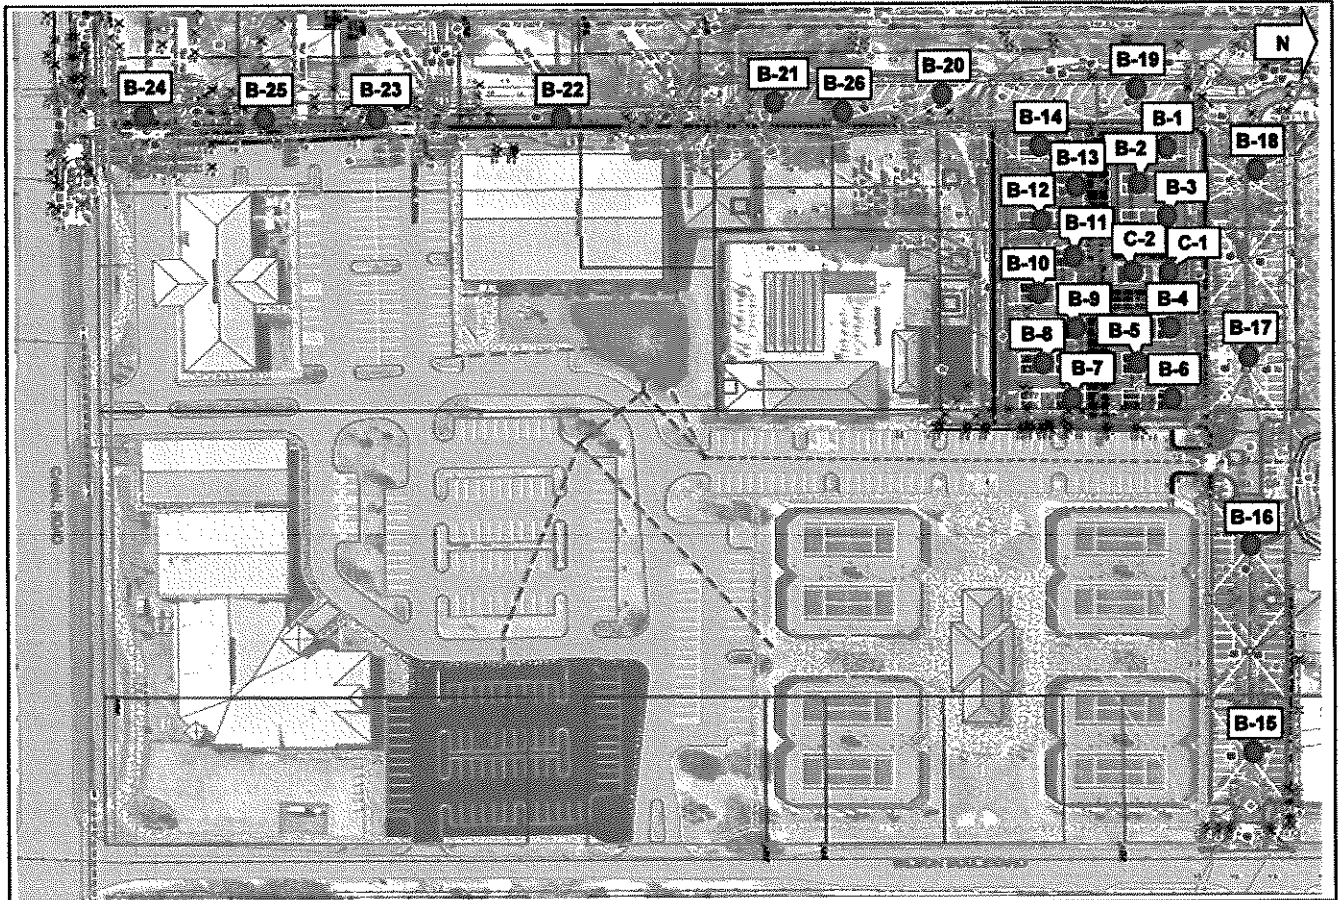


<p>Figure 2</p>	<p>NOT TO SCALE TEST LOCATION PLAN Proposed Pickleball Courts Canal Road Orange Beach, AL DL 4650-24</p>	<p>GEOCON, INC. 22830 McAuliffe Drive Robertsedale, AL 36567</p>
<p>Date 12/2/2024</p>		

C-1

CPT Testing Done By: GeoCon
 Proposed: Pickleball Courts
 CUSTOMER: City of Orange Beach
 LOCATION: Orange Beach, AL
 HOLE NUMBER: C-1

JOB NUMBER: DL 4650-24
 TEST DATE: 11/26/2024
 OPERATOR: Bryant Volovecky
 GPS (LAT,LON,ALT): 3017.8220N,08733.6310W,8.8

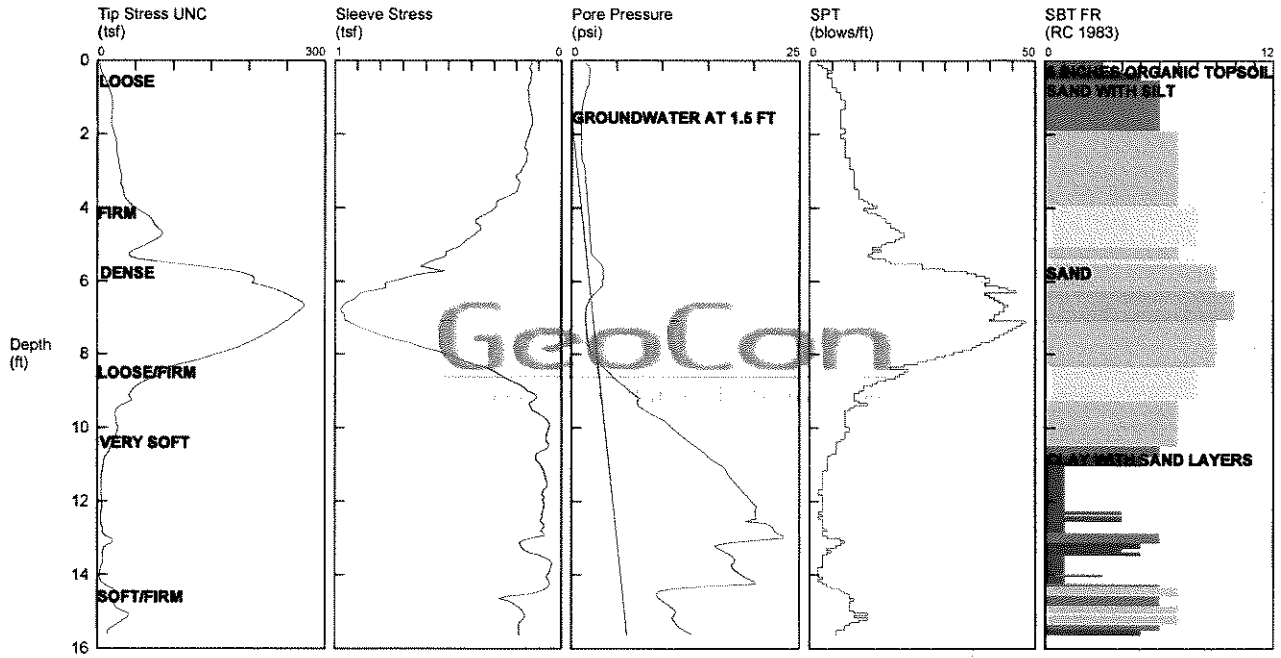


- | | | | |
|--------------------------|-----------------------------|----------------------------|--------------------------------|
| 1 sensitive fine grained | 4 silty clay to clay | 7 silty sand to sandy silt | 10 gravelly sand to sand |
| 2 organic material | 5 clayey silt to silty clay | 8 sand to silty sand | 11 very stiff fine grained (*) |
| 3 clay | 6 sandy silt to clayey silt | 9 sand | 12 sand to clayey sand (*) |
- *SBT/SPT CORRELATION: UBC-1983

C-2

CPT Testing Done By: GeoCon
 Proposed: Pickleball Courts
 CUSTOMER: City of Orange Beach
 LOCATION: Orange Beach, AL
 HOLE NUMBER: C-2

JOB NUMBER: DL 4650-24
 TEST DATE: 11/26/2024
 OPERATOR: Bryant Volovecky
 GPS (LAT,LON,ALT): 3017.8160N,08733.6300W,-0.3

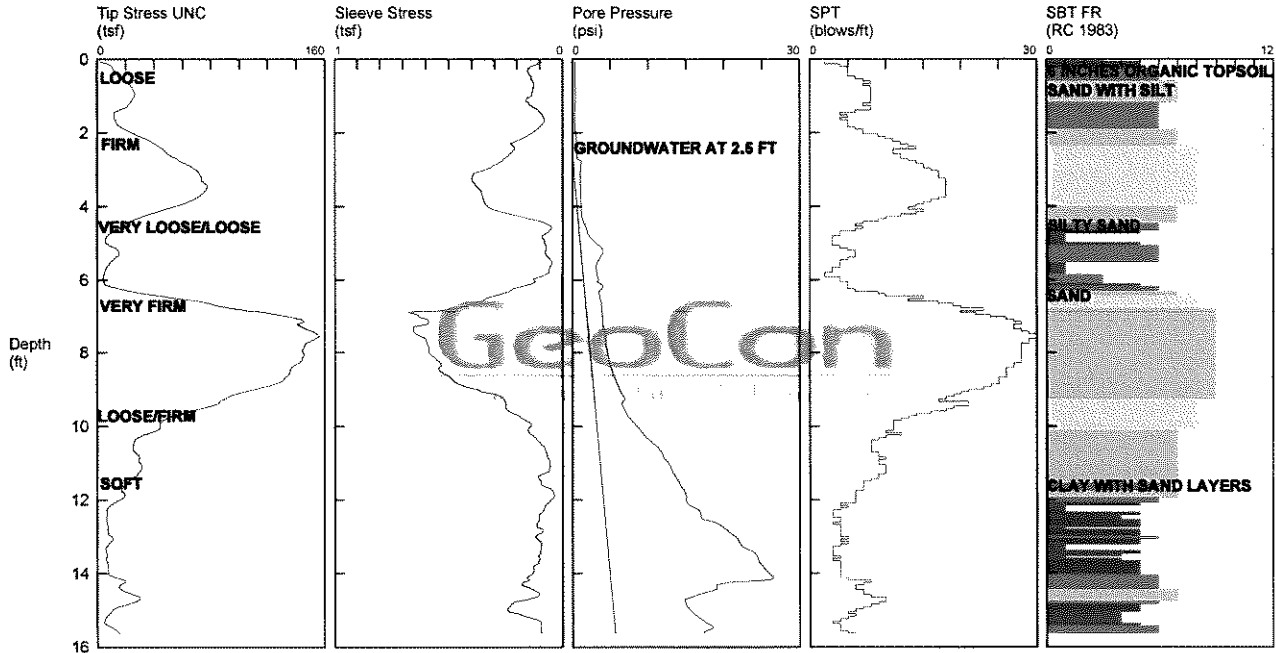

- | | | | |
|--|--|--|--|
| <ul style="list-style-type: none"> 1 sensitive fine grained 2 organic material 3 clay | <ul style="list-style-type: none"> 4 silty clay to clay 5 clayey silt to silty clay 6 sandy silt to clayey silt | <ul style="list-style-type: none"> 7 silty sand to sandy silt 8 sand to silty sand 9 sand | <ul style="list-style-type: none"> 10 gravelly sand to sand 11 very stiff fine grained (*) 12 sand to clayey sand (*) |
|--|--|--|--|

*SBT/SPT CORRELATION: UBC-1983

DRILL HOLE LOG

BORING NO.: B-1

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 2 AT COMPLETION ∇ :

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				12 Inches Organic Topsoil					10 30 5
1			SP-SM	Gray Sand with Silt, Loose				6	
2				Groundwater at 2 ft				5	
3								5	
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft					
5									
6									
7									

"N Value" Equal to DCP Soundings

DRILL HOLE LOG

BORING NO.: B-2

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL : 2 AT COMPLETION :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				12 Inches Organic Topsoil					10 30 5
1			SP-SM	Gray Sand with Silt, Loose				4	●
2				Groundwater at 2 ft				4	●
3								4	●
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft					
5									
6									
7									

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-3

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL : .5 AT COMPLETION :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				6 Inches Organic Topsoil					10 30 5
				Groundwater at 6 Inches					
1			SM	Gray Silty Sand, Very Loose				3	
2				Loose				4	
3								4	
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft					
5									
6									
7									

"N Value" Equal to DCP Soundings

DRILL HOLE LOG

BORING NO.: B-4

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL ∇ : 1 AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				6 Inches Organic Topsoil					10 30 5
1	∇		SP-SM	Gray Sand with Silt, Very Loose Groundwater at 1 ft				3	
2								3	
3				Loose				4	
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft					
5									
6									
7									

"N Value" Equal to DCP Soundings

DRILL HOLE LOG

BORING NO.: B-5

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL : 1 AT COMPLETION :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				4 Inches Organic Topsoil					
1			SP-SM	Gray Sand with Silt, Loose Groundwater at 1 ft				6	
2								5	
3				Loose				8	
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft					
5									
6									
7									

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG


BORING NO.: B-6

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL : 2 AT COMPLETION :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				4 Inches Organic Topsoil					
1			SM	Gray Silty Sand, Loose					
2				Firm Groundwater at 2 ft					
3									
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft					
5									
6									
7									

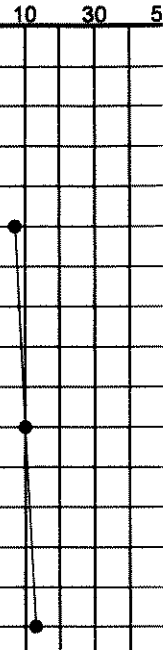

"N Value" Equal to DCP Soundings

DRILL HOLE LOG

BORING NO.: B-7

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 2

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				18 Inches Organic Topsoil					10 30 5
1									
2		∇	SM	Gray Silty Sand, Loose				7	
3			SP	Gray Sand, Loose Groundwater at 2 ft				7	
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft				8	
5									
6									
7									

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-8

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER> INITIAL ∇ : 2 AT COMPLETION ∇ :

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				12 Inches Organic Topsoil					10 30 5
1			SP-SM	Gray, Tan Sand with Silt, Loose				7	
2			SP	Tan, Gray Sand, Loose Groundwater at 2 ft				7	
3								6	
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft					
5									
6									
7									

"N Value" Equal to DCP Soundings

DRILL HOLE LOG

BORING NO.: B-9

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 2

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				12 Inches Organic Topsoil					10 30 5
1			SP-SM	Gray Sand with Silt, Loose				7	
2				Groundwater at 2 ft				6	
3								6	
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft					
5									
6									
7									

"N Value" Equal to DCP Soundings

DRILL HOLE LOG

BORING NO.: B-10

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 3 AT COMPLETION ∇ :

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				10 Inches Organic Topsoil					10 30 5
1			SM	Gray Silty Sand, Loose				6	
2								5	
3			SP	Gray Sand, Loose Groundwater at 3 ft				8	
4				Firm				14	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings

DRILL HOLE LOG

BORING NO.: B-11

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL ∇ : 3 AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				4 Inches Organic Topsoil					10 30 5
1			SP-SM	Gray Sand with Silt, Loose				4	
2								4	
3			SP	Gray Sand, Loose Groundwater at 3 ft				4	
4				Firm				12	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings

DRILL HOLE LOG

BORING NO.: B-12

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL ∇ : 3 AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				4 Inches Organic Topsoil					10 30 5
1			SP-SM	Gray Sand with Silt, Very Loose				3	
2								2	
3				Loose Groundwater at 3 ft				4	
4								7	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-13

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL ∇ : 3 AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0		[Symbol: 4 inches organic topsoil]		4 Inches Organic Topsoil					10 30 5
1		[Symbol: Tan silty sand, fill]	FILL	Tan Silty Sand, (FILL), Loose				4	
2		[Symbol: Gray sand with silt]	SP-SM	Gray Sand with Silt, Loose				4	
3		[Symbol: Groundwater]		Groundwater at 3 ft				5	
4		[Symbol: Firm soil]		Firm				12	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings

DRILL HOLE LOG

BORING NO.: B-14

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 3

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				2 Inches Organic Topsoil 6 Inches Sandy Fill					
1			SP	Tan Sand, Loose				6	
2			SP-SM	Gray Sand with Silt, Loose				4	
3		∇		Groundwater at 3 ft				4	
4				Firm				12	
5				Boring Terminated at 5 ft					

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-15

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER> INITIAL ∇ :

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST CURVE		
							DEPTH	N	
0				6 Inches Organic Topsoil 2 Inches Asphalt Paving					10 30 5
1			SM	Tan Silty Sand, Very Firm				20+	
2								20+	
3			SP-SM	Gray Sand with Silt, Firm				17	
4								14	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-16

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ :

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST			
							DEPTH	N	CURVE	
0				2 Inches Organic Topsoil						
			SM	Tan Silty Sand						
1			SM	Gray Silty Sand with Trace of Organics, Very Firm					20+	
2				Firm					17	
3			SP-SM	Gray Sand with Silt, Firm					17	
4									10	
5				Boring Terminated at 5 ft						
6										
7										

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-17

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 2

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				4 Inches Organic Topsoil					10 30 5
1			SM	Gray Silty Sand, Very Loose				3	
2		∇		Loose Groundwater at 2 ft				5	
3								5	
4				Auger Refusal due to Hole Caving Boring Terminated at 4 ft					
5									
6									
7									

"N Value" Equal to DCP Soundings






DRILL HOLE LOG

BORING NO.: B-18

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL ∇ : AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				8 Inches Aggregate Base 6 Inches Sandy Fill					10 30 5
1			SM	Gray, Tan Silty Sand, Very Firm				20+	10 30 5
2								20+	10 30 5
3			SM	Gray Silty Sand				20+	10 30 5
4				Firm				11	10 30 5
5				Boring Terminated at 5 ft					10 30 5
6									10 30 5
7									10 30 5

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-19

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL ∇ : 3 AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				10 Inches Organic Topsoil					10 30 5
1			SP-SM	Gray, Tan Sand with Silt, Firm				15	
2			SP-SM	Gray Sand with Silt, Loose				8	
3				Groundwater at 3 ft Firm				12	
4				Loose				6	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-20

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 3

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				8 Inches Organic Topsoil					
1			SP-SM	Gray Sand with Silt, Very Firm				20+	
2			SP	Gray Sand, Loose				8	
3				Groundwater at 3 ft				7	
4								8	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings





DRILL HOLE LOG

BORING NO.: B-21

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL ∇ : 4 AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				8 Inches Aggregate Base					
1			SM	Gray Silty Sand, Very Firm				20+	
2			SP-SM	Tan Sand with Silt, Very Firm				20+	
3				Loose				7	
4		 ∇	SP	Tan Sand, Firm Groundwater at 4 ft				12	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings







DRILL HOLE LOG

BORING NO.: B-22

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 4

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				8 Inches Organic Topsoil					10 30 5
1			SM	Gray Silty Sand, Loose				9	9
2				Very Loose				3	3
3				Loose				5	5
4		 ∇	SP	Tan Sand, Firm Groundwater at 4 ft				15	15
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-23

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 3

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				12 Inches Organic Topsoil					10 30 5
1			SP-SM	Gray Sand with Silt, Loose				9	
2				Very Loose				3	
3				Loose Groundwater at 3 ft				5	
4				Firm				13	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-24

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Cole Brooks
 DRILL RIG:
 DEPTH TO WATER > INITIAL ∇ : 3

PROJECT NO.: DL 4650-24
 DATE: 11/26/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0				6 Inches Organic Topsoil					10 30 5
1			SP-SM	Gray Sand with Silt, Loose				6	
2								6	
3				Groundwater at 3 ft				4	
4				Firm				10	
5				Boring Terminated at 5 ft					
6									
7									

"N Value" Equal to DCP Soundings

This information pertains only to this boring and should not be interpreted as being indicative of the site.




DRILL HOLE LOG

BORING NO.: B-25

PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Bill Tartt
 DRILL RIG:
 DEPTH TO WATER> INITIAL ∇ :

PROJECT NO.: DL 4650-24
 DATE: 12/11/2024
 ELEVATION:
 LOGGED BY: Chris Rea

AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST				
							DEPTH	N	CURVE		
									10	30	5
0				2.125 Inches Asphalt Paving							
				8 Inches Silty Sand with Aggregate Base							
1			SP-SM	Gray Sand with Silt							
2											
3											
4				Boring Terminated at 4 ft							
5											
6											
7											

This information pertains only to this boring and should not be interpreted as being indicative of the site.






DRILL HOLE LOG

BORING NO.: B-26


PROJECT: Proposed Pickleball Courts
 CLIENT: City of Orange Beach
 LOCATION: Orange Beach, AL
 DRILLER: Bill Tartt
 DRILL RIG:

PROJECT NO.: DL 4650-24
 DATE: 12/11/2024
 ELEVATION:
 LOGGED BY: Chris Rea

DEPTH TO WATER > INITIAL ∇ : 3.5 AT COMPLETION ∇ :

LEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
									10 30 5
0				2.25 Inches Asphalt Paving					
				6 Inches Aggregate Base					
1			SM	Dark Gray Silty Sand					
2									
3			SP	Gray Sand					
				Groundwater at 3.5 ft					
4				Boring Terminated at 4 ft					
5									
6									
7									

Particle Size Distribution Report

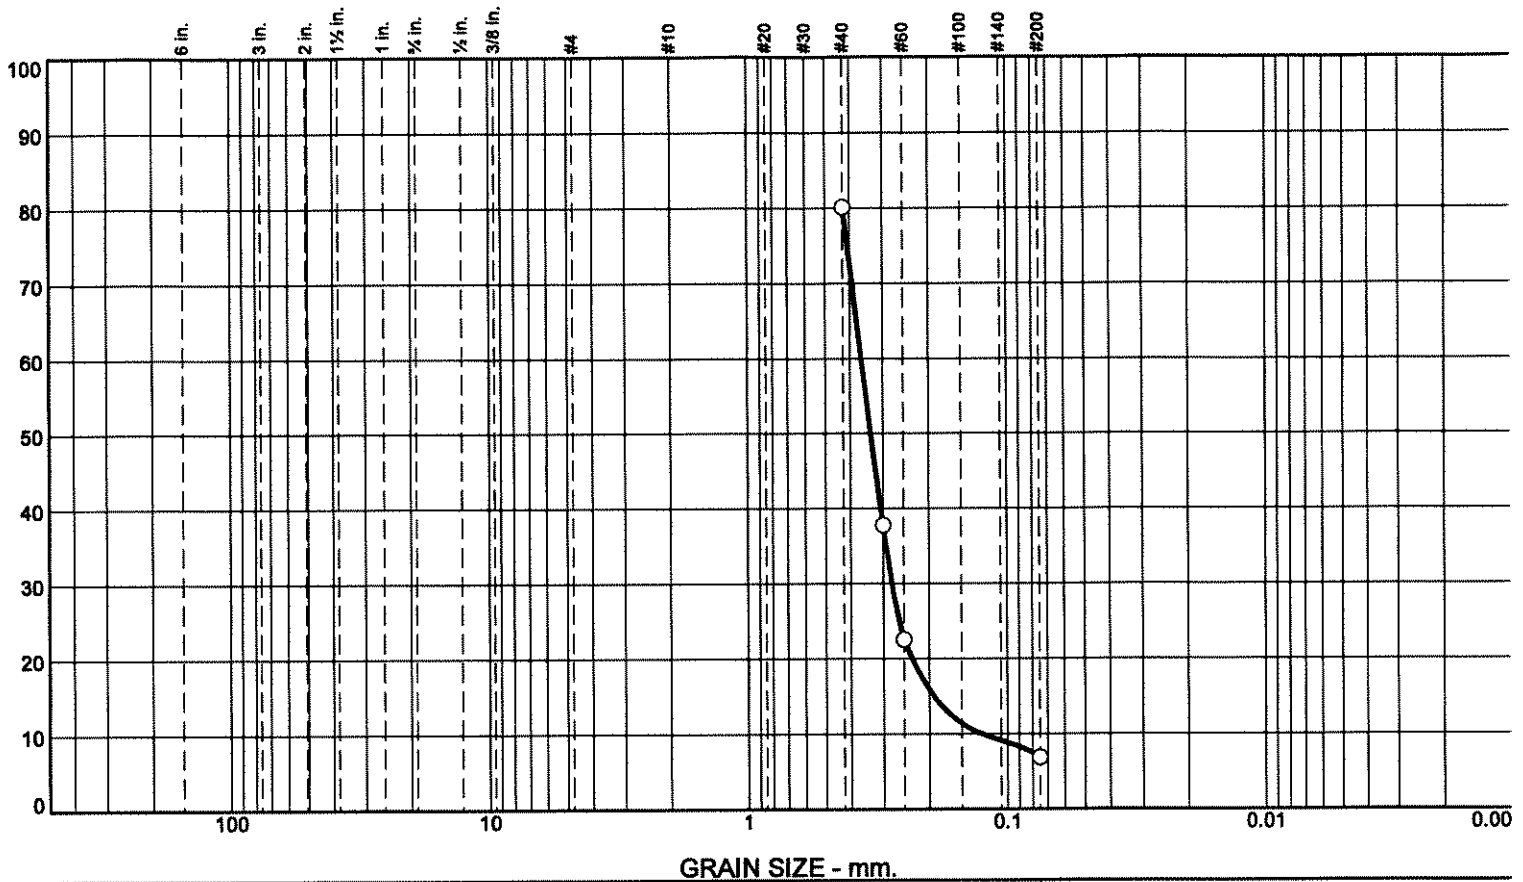

GRAIN SIZE - mm.

% +3"	% Gravel		% Sand			% Fines
	Coarse	Fine	Coarse	Medium	Fine	
					73.2	6.9

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
#40	80.1		
#50	37.8		
#60	22.6		
#200	6.9		

* (no specification provided)

Soil Description

Black Sand with Silt

Atterberg Limits

PL= LL= PI=

Coefficients

D₉₀= D₈₅= D₆₀= 0.3624
D₅₀= 0.3344 D₃₀= 0.2777 D₁₅= 0.1917
D₁₀= 0.1256 C_u= 2.89 C_c= 1.69

Classification

USCS= SP-SM AASHTO=

Remarks

Location: Orange Beach, AL
Sample Number: C-1 **Depth:** 0 to 1.5 ft

Date: 12/2/2024

GeoCon

Client: City of Orange Beach
Project: Proposed Pickleball Courts

Robertsdale, Alabama


Project No: DL 4650-24

Figure

Prepared By: Joe Jones

Checked By: David McKee

Particle Size Distribution Report

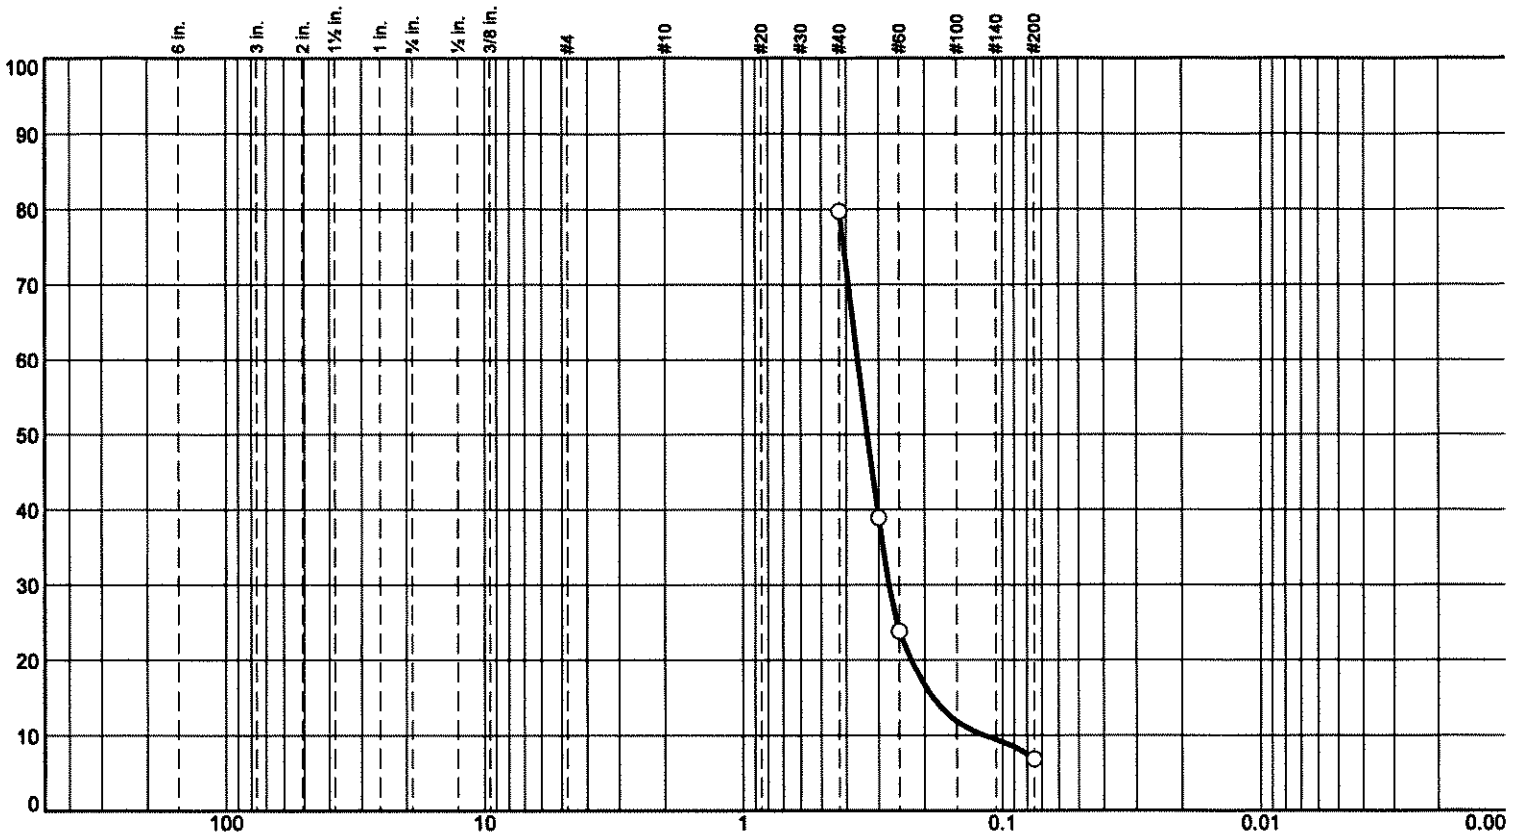

GRAIN SIZE - mm.

% +3"	% Gravel		% Sand			% Fines
	Coarse	Fine	Coarse	Medium	Fine	
					72.9	6.8

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
#40	79.7		
#50	39.0		
#60	23.8		
#200	6.8		

Soil Description

Gray Sand with Silt

Atterberg Limits

PL= LL= PI=

Coefficients

D₉₀= D₈₅= D₆₀= 0.3612
D₅₀= 0.3322 D₃₀= 0.2737 D₁₅= 0.1854
D₁₀= 0.1179 C_u= 3.06 C_c= 1.76

Classification

USCS= SP-SM AASHTO=

Remarks

(no specification provided)

Location: Orange Beach, AL
Sample Number: B-3 **Depth:** 0 to 1 ft


Date: 12/2/2024

<h2 style="margin: 0;">GeoCon</h2> <h3 style="margin: 0;">Robertsdale, Alabama</h3>	<p>Client: City of Orange Beach</p> <p>Project: Proposed Pickleball Courts</p> <p>Project No: DL 4650-24</p>
<p>Figure</p>	

Prepared By: Joe Jones

Checked By: David McKee

Particle Size Distribution Report

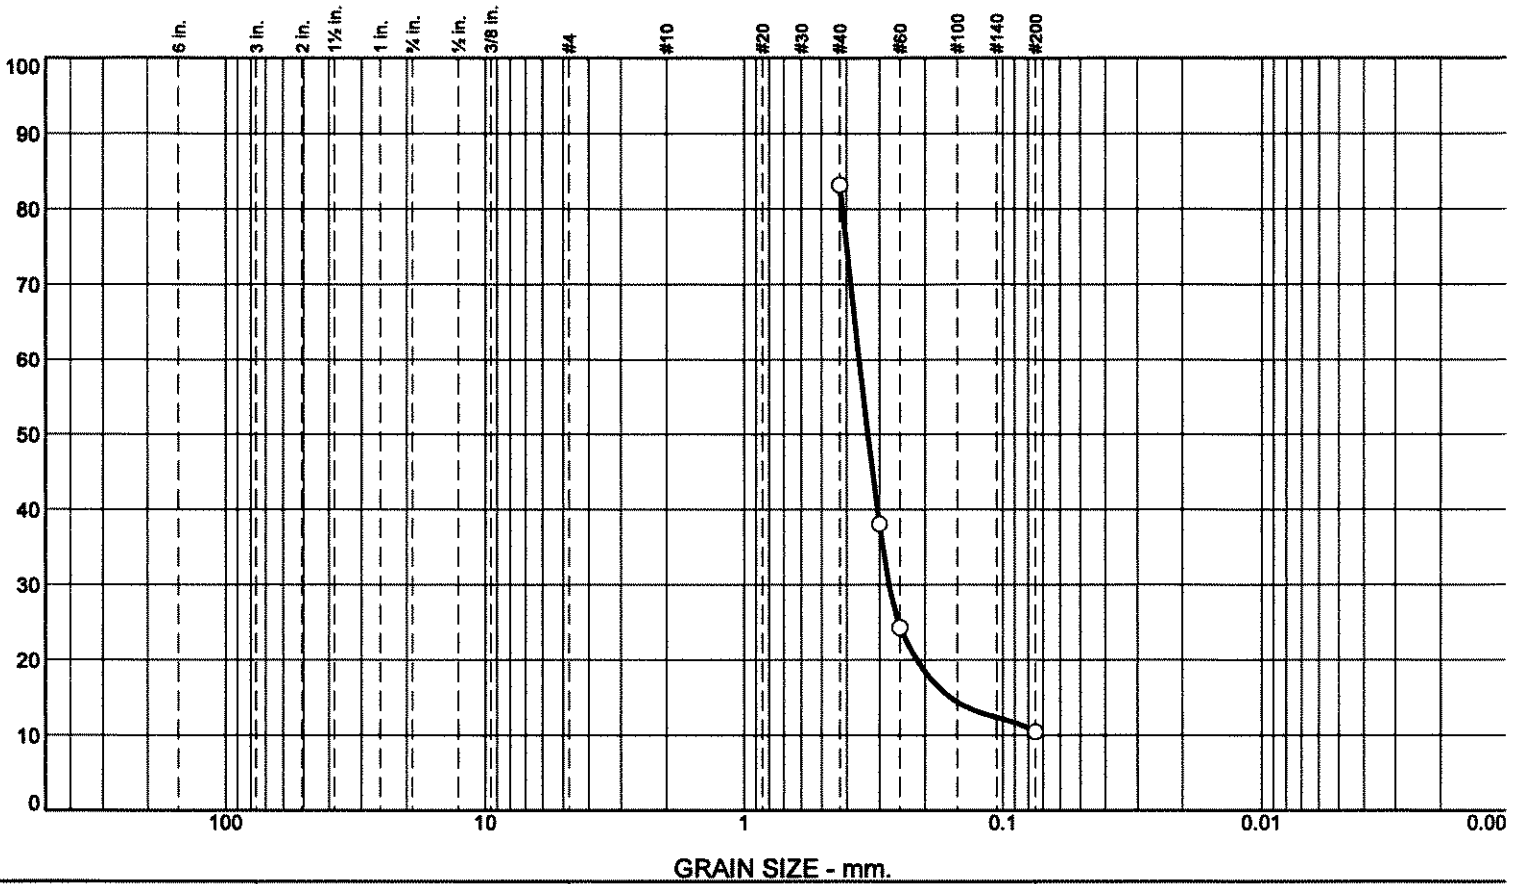

GRAIN SIZE - mm.

% +3"	% Gravel		% Sand			% Fines
	Coarse	Fine	Coarse	Medium	Fine	
					72.8	10.4

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
#40	83.2		
#50	38.1		
#60	24.3		
#200	10.4		

Soil Description
Tan Sand with Silt

Atterberg Limits
 PL= LL= PI=

Coefficients
 D₉₀= D₈₅= D₆₀= 0.3585
 D₅₀= 0.3325 D₃₀= 0.2751 D₁₅= 0.1595
 D₁₀= C_u= C_c=

Classification
 USCS= SP-SM AASHTO=

Remarks

* (no specification provided)

Location: Orange Beach, AL
Sample Number: B-8 **Depth:** 0 to 2 ft


Date: 12/2/2024

GeoCon Robertsdale, Alabama	Client: City of Orange Beach Project: Proposed Pickleball Courts Project No: DL 4650-24
Figure	

Prepared By: Joe Jones

Checked By: David McKee

Particle Size Distribution Report

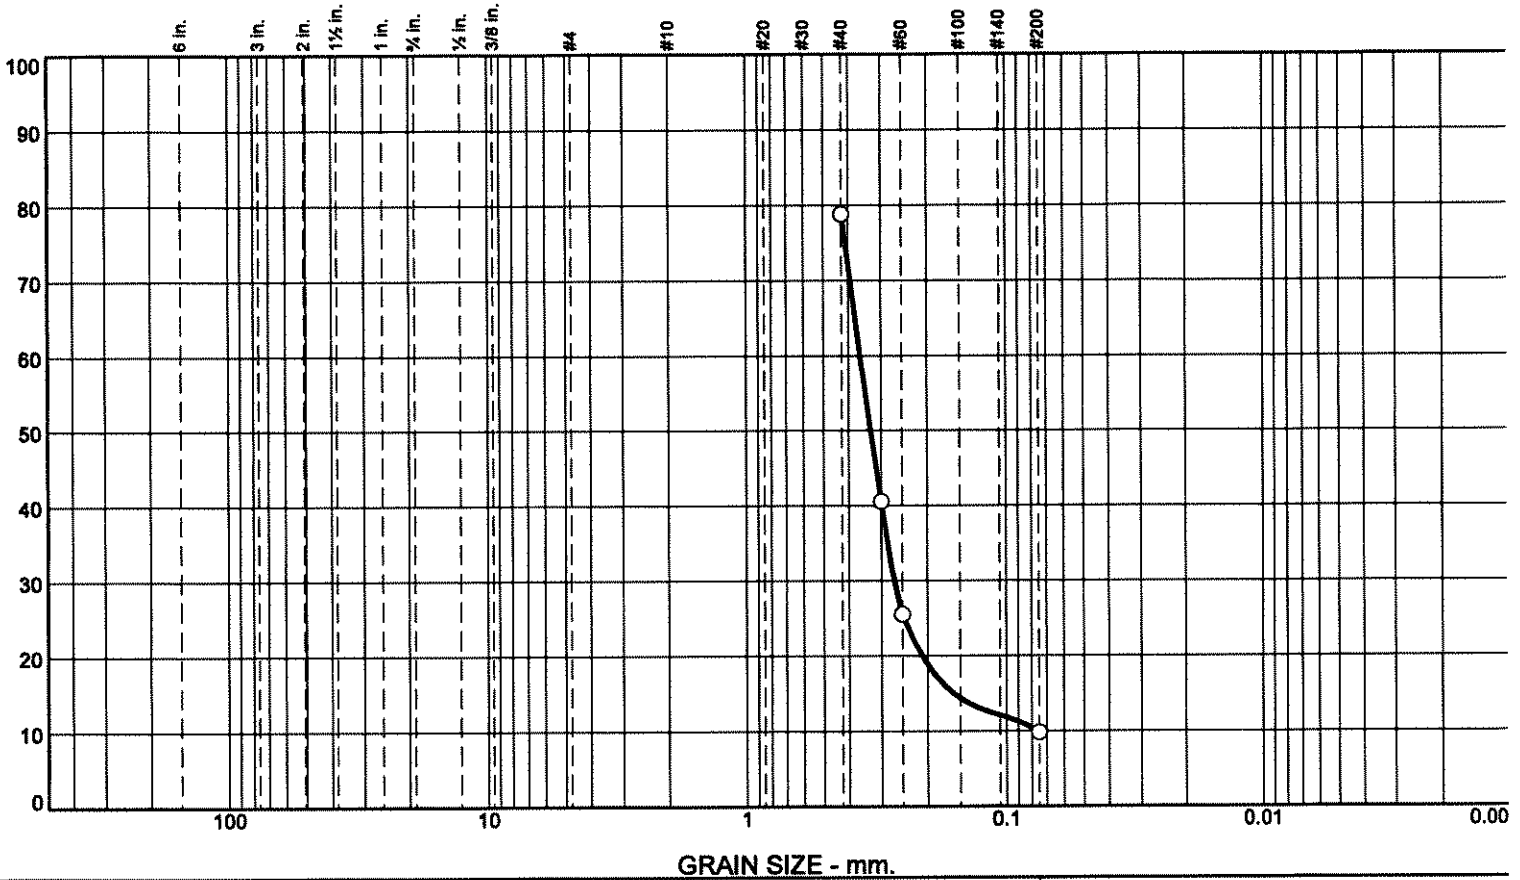

% +3"	% Gravel		% Sand			% Fines
	Coarse	Fine	Coarse	Medium	Fine	
					69.0	9.8

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
#40	78.8		
#50	40.5		
#60	25.6		
#200	9.8		

Soil Description
Gray Sand with Silt

Atterberg Limits
 PL= LL= PI=

Coefficients
 D₉₀= D₈₅= D₆₀= 0.3600
 D₅₀= 0.3291 D₃₀= 0.2685 D₁₅= 0.1590
 D₁₀= 0.0763 C_u= 4.72 C_c= 2.62

Classification
 USCS= SP-SM AASHTO=

Remarks

* (no specification provided)


Location: Orange Beach, AL
Sample Number: B-12 **Depth:** 0 to 2.5 ft

Date: 12/2/2024

GeoCon Robertsdale, Alabama	Client: City of Orange Beach Project: Proposed Pickleball Courts Project No: DL 4650-24
	Figure

Prepared By: Joe Jones Checked By: David McKee

Particle Size Distribution Report

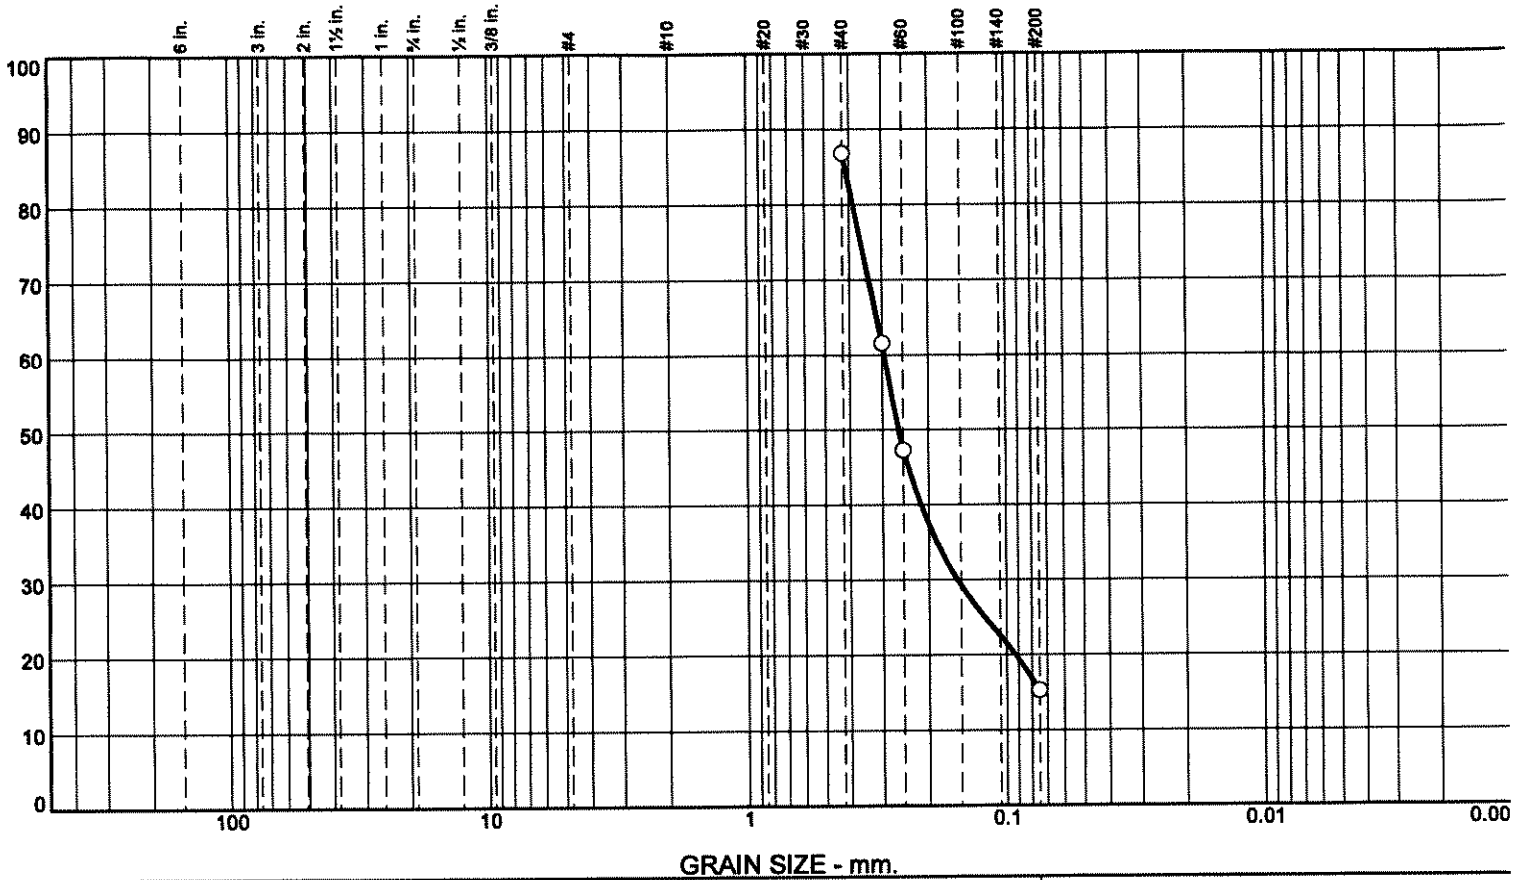

% +3"	% Gravel		% Sand			% Fines
	Coarse	Fine	Coarse	Medium	Fine	
					71.5	15.3

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
#40	86.8		
#50	61.6		
#60	47.3		
#200	15.3		

Soil Description
Tan Silty Sand

Atterberg Limits
 PL= LL= PI=

Coefficients
 D₉₀= D₈₅= 0.4144 D₆₀= 0.2939
 D₅₀= 0.2609 D₃₀= 0.1549 D₁₅=
 D₁₀= C_u= C_c=

Classification
 USCS= SP-SM AASHTO=

Remarks

(no specification provided)

Location: Orange Beach, AL
 Sample Number: B-15 Depth: 0 to 2.5 ft

Date: 12/2/2024

GeoCon

Client: City of Orange Beach
 Project: Proposed Pickleball Courts

Robertsdale, Alabama


Project No: DL 4650-24

Figure

Prepared By: Joe Jones

Checked By: David McKee

Particle Size Distribution Report

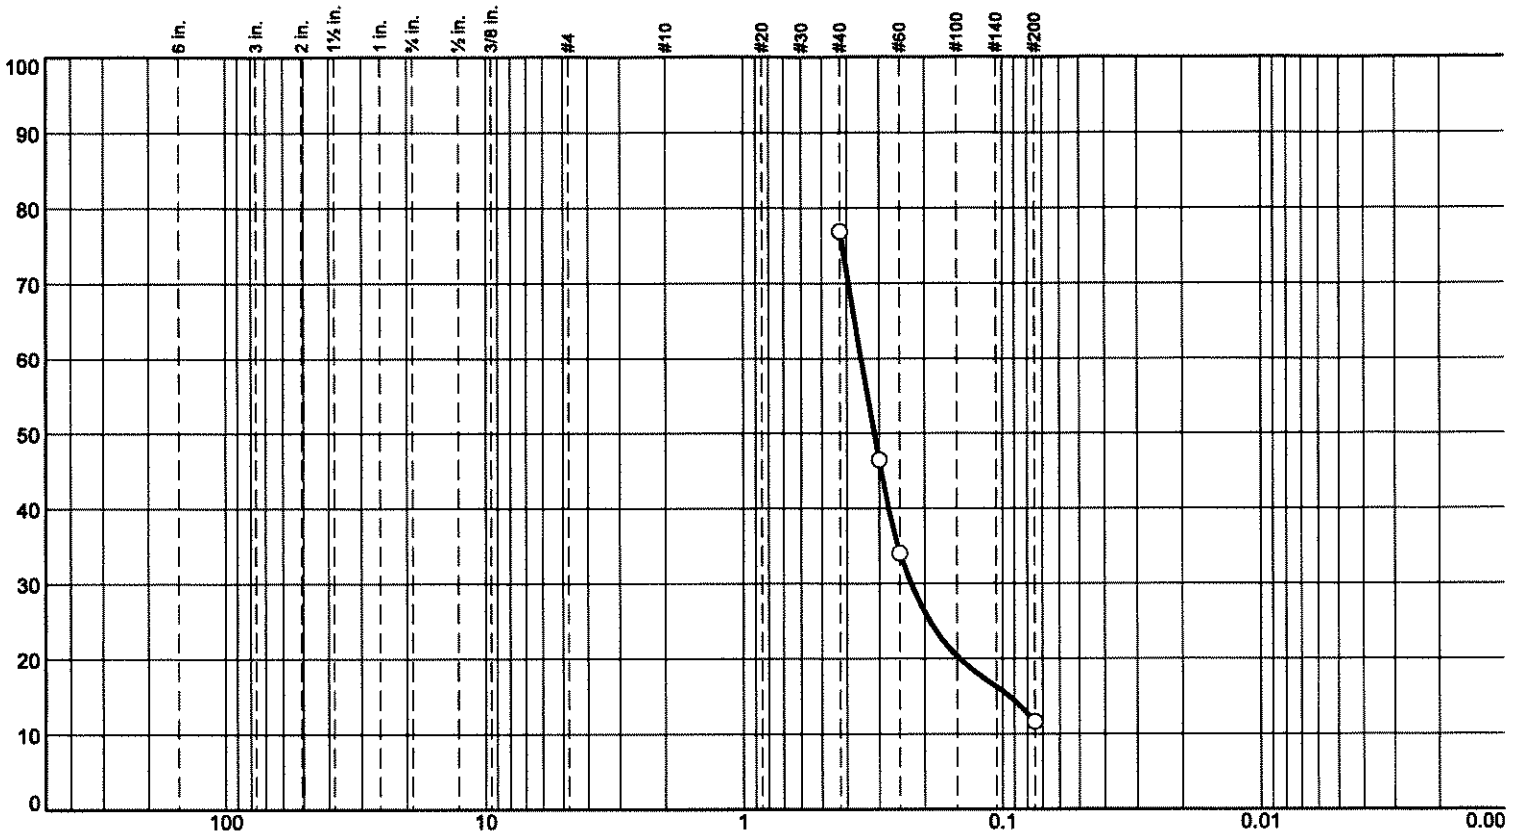

GRAIN SIZE - mm.

% +3"	% Gravel		% Sand			% Fines
	Coarse	Fine	Coarse	Medium	Fine	
					65.3	11.6

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
#40	76.9		
#50	46.5		
#60	34.0		
#200	11.6		

Soil Description

Gray/Tan Sand with Silt

Atterberg Limits

PL= LL= PI=

Coefficients

D₉₀= D₈₅= D₆₀= 0.3521
 D₅₀= 0.3136 D₃₀= 0.2257 D₁₅= 0.0942
 D₁₀= C_u= C_c=

Classification

USCS= SP-SM AASHTO=

Remarks

* (no specification provided)

Location: Orange Beach, AL
 Sample Number: B-19 Depth: 0 to 1.5 ft

Date: 12/2/2024

GeoCon

Client: City of Orange Beach
 Project: Proposed Pickleball Courts

Robertsdale, Alabama


Project No: DL 4650-24

Figure

Prepared By: Joe Jones

Checked By: David McKee

Particle Size Distribution Report

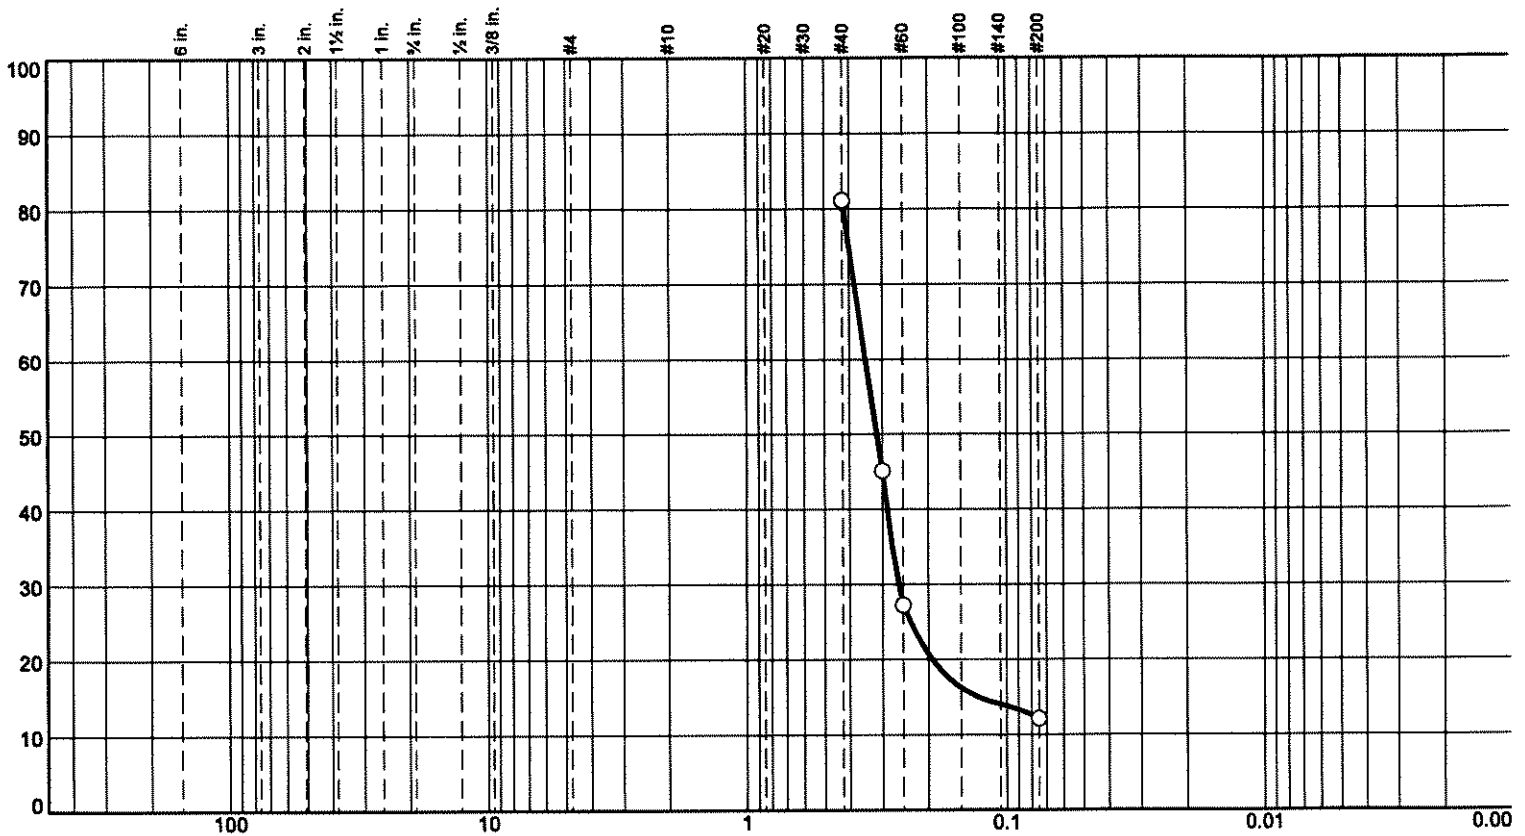

GRAIN SIZE - mm.

% +3"	% Gravel		% Sand			% Fines
	Coarse	Fine	Coarse	Medium	Fine	
					69.0	12.2

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
#40	81.2		
#50	45.1		
#60	27.2		
#200	12.2		

Soil Description
Gray Sand with Silt

Atterberg Limits
 PL= LL= PI=

Coefficients
 D₉₀= D₈₅= D₆₀= 0.3469
 D₅₀= 0.3149 D₃₀= 0.2614 D₁₅= 0.1285
 D₁₀= C_u= C_c=

Classification
 USCS= SP-SM AASHTO=

Remarks

* (no specification provided)

Location: Orange Beach, AL
 Sample Number: B-24 Depth: 0 to 2.5 ft

Date: 12/2/2024

GeoCon

Robertsdale, Alabama


Client: City of Orange Beach
Project: Proposed Pickleball Courts

Project No: DL 4650-24

Figure

Prepared By: Joe Jones

Checked By: David McKee

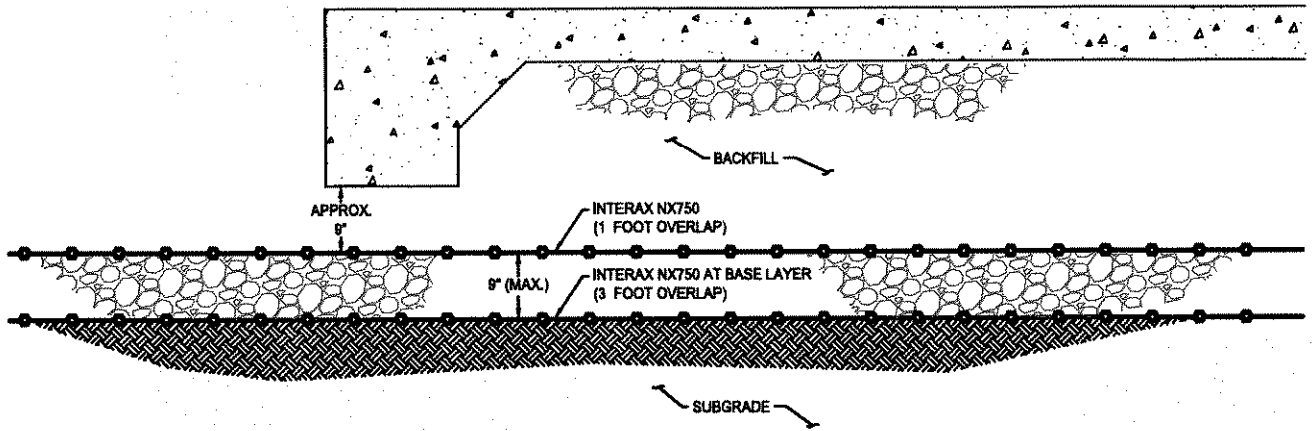

FOUNDATION IMPROVEMENT DETAIL
SUBGRADE

INTERAX FOUNDATION IMPROVEMENT DETAIL
















INTERAX FOUNDATION IMPROVEMENT DETAIL210907.DWG

Tensor.

Tensor International Corporation | 2500 Northwind Parkway, Suite 500 | Alpharetta, Georgia 30009
Toll Free: 1-888-828-5126 | Phone: 770-344-2090 | Fax: 770-344-2089 | www.tensorcorp.com

THIS DRAWING IS BASED UPON SPECIFIC PROPERTIES OF TENSAR PRODUCTS (GEOGRIDS, DRAINAGE COMPOSITES AND EROSION MEDIA), WHICH ARE PROPRIETARY TO TENSAR CORPORATION 1210 CITIZENS PARKWAY, MORROW, GA. 30260 AND ARE PROTECTED BY US AND INTERNATIONAL PATENTS, AND LICENSING AGREEMENTS. YOUR USE OF THE INFORMATION CONSTITUTES YOUR ACKNOWLEDGMENT OF THE PROPRIETARY NATURE OF THESE DRAWINGS AND THE TECHNOLOGY.

SOIL CLASSIFICATION CHART

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS
			GRAPH	LETTER	
COARSE GRAINED SOILS MORE THAN 50% OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE	GRAVEL AND GRAVELLY SOILS MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE	CLEAN GRAVELS (LITTLE OR NO FINES)		GW	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES
		(LITTLE OR NO FINES)		GP	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES
		GRAVELS WITH FINES (APPRECIABLE AMOUNT OF FINES)		GM	SILTY GRAVELS, GRAVEL - SAND - SILT MIXTURES
		(APPRECIABLE AMOUNT OF FINES)		GC	CLAYEY GRAVELS, GRAVEL - SAND - CLAY MIXTURES
	SAND AND SANDY SOILS MORE THAN 50% OF COARSE FRACTION PASSING ON NO. 4 SIEVE	CLEAN SANDS (LITTLE OR NO FINES)		SW	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES
		(LITTLE OR NO FINES)		SP	POORLY-GRADED SANDS, GRAVELLY SAND, LITTLE OR NO FINES
		SANDS WITH FINES (APPRECIABLE AMOUNT OF FINES)		SM	SILTY SANDS, SAND - SILT MIXTURES
		(APPRECIABLE AMOUNT OF FINES)		SC	CLAYEY SANDS, SAND - CLAY MIXTURES
	FINE GRAINED SOILS MORE THAN 50% OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	SILTS AND CLAYS LIQUID LIMIT LESS THAN 50		ML	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY
				CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS
			OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY	
SILTS AND CLAYS LIQUID LIMIT GREATER THAN 50			MH	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILTY SOILS	
			CH	INORGANIC CLAYS OF HIGH PLASTICITY	
			OH	ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS	
HIGHLY ORGANIC SOILS				PT	PEAT, HUMUS, SWAMP SOILS WITH HIGH ORGANIC CONTENTS

NOTE: DUAL SYMBOLS ARE USED TO INDICATE BORDERLINE SOIL CLASSIFICATIONS

Important Information about This

Geotechnical-Engineering Report

Subsurface problems are a principal cause of construction delays, cost overruns, claims, and disputes.

While you cannot eliminate all such risks, you can manage them. The following information is provided to help.

The Geoprofessional Business Association (GBA) has prepared this advisory to help you – assumedly a client representative – interpret and apply this geotechnical-engineering report as effectively as possible. In that way, you can benefit from a lowered exposure to problems associated with subsurface conditions at project sites and development of them that, for decades, have been a principal cause of construction delays, cost overruns, claims, and disputes. If you have questions or want more information about any of the issues discussed herein, contact your GBA-member geotechnical engineer. Active engagement in GBA exposes geotechnical engineers to a wide array of risk-confrontation techniques that can be of genuine benefit for everyone involved with a construction project.

Understand the Geotechnical-Engineering Services Provided for this Report

Geotechnical-engineering services typically include the planning, collection, interpretation, and analysis of exploratory data from widely spaced borings and/or test pits. Field data are combined with results from laboratory tests of soil and rock samples obtained from field exploration (if applicable), observations made during site reconnaissance, and historical information to form one or more models of the expected subsurface conditions beneath the site. Local geology and alterations of the site surface and subsurface by previous and proposed construction are also important considerations. Geotechnical engineers apply their engineering training, experience, and judgment to adapt the requirements of the prospective project to the subsurface model(s). Estimates are made of the subsurface conditions that will likely be exposed during construction as well as the expected performance of foundations and other structures being planned and/or affected by construction activities.

The culmination of these geotechnical-engineering services is typically a geotechnical-engineering report providing the data obtained, a discussion of the subsurface model(s), the engineering and geologic engineering assessments and analyses made, and the recommendations developed to satisfy the given requirements of the project. These reports may be titled investigations, explorations, studies, assessments, or evaluations. Regardless of the title used, the geotechnical-engineering report is an engineering interpretation of the subsurface conditions within the context of the project and does not represent a close examination, systematic inquiry, or thorough investigation of all site and subsurface conditions.

Geotechnical-Engineering Services are Performed for Specific Purposes, Persons, and Projects, and At Specific Times

Geotechnical engineers structure their services to meet the specific needs, goals, and risk management preferences of their clients. A geotechnical-engineering study conducted for a given civil engineer

will not likely meet the needs of a civil-works constructor or even a different civil engineer. Because each geotechnical-engineering study is unique, each geotechnical-engineering report is unique, prepared *solely* for the client.

Likewise, geotechnical-engineering services are performed for a specific project and purpose. For example, it is unlikely that a geotechnical-engineering study for a refrigerated warehouse will be the same as one prepared for a parking garage; and a few borings drilled during a preliminary study to evaluate site feasibility will not be adequate to develop geotechnical design recommendations for the project.

Do not rely on this report if your geotechnical engineer prepared it:

- for a different client;
- for a different project or purpose;
- for a different site (that may or may not include all or a portion of the original site); or
- before important events occurred at the site or adjacent to it; e.g., man-made events like construction or environmental remediation, or natural events like floods, droughts, earthquakes, or groundwater fluctuations.

Note, too, the reliability of a geotechnical-engineering report can be affected by the passage of time, because of factors like changed subsurface conditions; new or modified codes, standards, or regulations; or new techniques or tools. *If you are the least bit uncertain* about the continued reliability of this report, contact your geotechnical engineer before applying the recommendations in it. A minor amount of additional testing or analysis after the passage of time – if any is required at all – could prevent major problems.

Read this Report in Full

Costly problems have occurred because those relying on a geotechnical-engineering report did not read the report in its entirety. Do not rely on an executive summary. Do not read selective elements only. *Read and refer to the report in full.*

You Need to Inform Your Geotechnical Engineer About Change

Your geotechnical engineer considered unique, project-specific factors when developing the scope of study behind this report and developing the confirmation-dependent recommendations the report conveys. Typical changes that could erode the reliability of this report include those that affect:

- the site's size or shape;
- the elevation, configuration, location, orientation, function or weight of the proposed structure and the desired performance criteria;
- the composition of the design team; or
- project ownership.

As a general rule, *always* inform your geotechnical engineer of project or site changes – even minor ones – and request an assessment of their impact. *The geotechnical engineer who prepared this report cannot accept*

responsibility or liability for problems that arise because the geotechnical engineer was not informed about developments the engineer otherwise would have considered.

Most of the "Findings" Related in This Report Are Professional Opinions

Before construction begins, geotechnical engineers explore a site's subsurface using various sampling and testing procedures. *Geotechnical engineers can observe actual subsurface conditions only at those specific locations where sampling and testing is performed.* The data derived from that sampling and testing were reviewed by your geotechnical engineer, who then applied professional judgement to form opinions about subsurface conditions throughout the site. Actual sitewide-subsurface conditions may differ – maybe significantly – from those indicated in this report. Confront that risk by retaining your geotechnical engineer to serve on the design team through project completion to obtain informed guidance quickly, whenever needed.

This Report's Recommendations Are Confirmation-Dependent

The recommendations included in this report – including any options or alternatives – are confirmation-dependent. In other words, they are not final, because the geotechnical engineer who developed them relied heavily on judgement and opinion to do so. Your geotechnical engineer can finalize the recommendations *only after observing actual subsurface conditions* exposed during construction. If through observation your geotechnical engineer confirms that the conditions assumed to exist actually do exist, the recommendations can be relied upon, assuming no other changes have occurred. *The geotechnical engineer who prepared this report cannot assume responsibility or liability for confirmation-dependent recommendations if you fail to retain that engineer to perform construction observation.*

This Report Could Be Misinterpreted

Other design professionals' misinterpretation of geotechnical-engineering reports has resulted in costly problems. Confront that risk by having your geotechnical engineer serve as a continuing member of the design team, to:

- confer with other design-team members;
- help develop specifications;
- review pertinent elements of other design professionals' plans and specifications; and
- be available whenever geotechnical-engineering guidance is needed.

You should also confront the risk of constructors misinterpreting this report. Do so by retaining your geotechnical engineer to participate in prebid and preconstruction conferences and to perform construction-phase observations.

Give Constructors a Complete Report and Guidance

Some owners and design professionals mistakenly believe they can shift unanticipated-subsurface-conditions liability to constructors by limiting the information they provide for bid preparation. To help prevent the costly, contentious problems this practice has caused, include the complete geotechnical-engineering report, along with any attachments or appendices, with your contract documents, *but be certain to note*

conspicuously that you've included the material for information purposes only. To avoid misunderstanding, you may also want to note that "informational purposes" means constructors have no right to rely on the interpretations, opinions, conclusions, or recommendations in the report. Be certain that constructors know they may learn about specific project requirements, including options selected from the report, *only* from the design drawings and specifications. Remind constructors that they may perform their own studies if they want to, and *be sure to allow enough time* to permit them to do so. Only then might you be in a position to give constructors the information available to you, while requiring them to at least share some of the financial responsibilities stemming from unanticipated conditions. Conducting prebid and preconstruction conferences can also be valuable in this respect.

Read Responsibility Provisions Closely

Some client representatives, design professionals, and constructors do not realize that geotechnical engineering is far less exact than other engineering disciplines. This happens in part because soil and rock on project sites are typically heterogeneous and not manufactured materials with well-defined engineering properties like steel and concrete. That lack of understanding has nurtured unrealistic expectations that have resulted in disappointments, delays, cost overruns, claims, and disputes. To confront that risk, geotechnical engineers commonly include explanatory provisions in their reports. Sometimes labeled "limitations," many of these provisions indicate where geotechnical engineers' responsibilities begin and end, to help others recognize their own responsibilities and risks. *Read these provisions closely.* Ask questions. Your geotechnical engineer should respond fully and frankly.

Geoenvironmental Concerns Are Not Covered

The personnel, equipment, and techniques used to perform an environmental study – e.g., a "phase-one" or "phase-two" environmental site assessment – differ significantly from those used to perform a geotechnical-engineering study. For that reason, a geotechnical-engineering report does not usually provide environmental findings, conclusions, or recommendations; e.g., about the likelihood of encountering underground storage tanks or regulated contaminants. *Unanticipated subsurface environmental problems have led to project failures.* If you have not obtained your own environmental information about the project site, ask your geotechnical consultant for a recommendation on how to find environmental risk-management guidance.

Obtain Professional Assistance to Deal with Moisture Infiltration and Mold

While your geotechnical engineer may have addressed groundwater, water infiltration, or similar issues in this report, the engineer's services were not designed, conducted, or intended to prevent migration of moisture – including water vapor – from the soil through building slabs and walls and into the building interior, where it can cause mold growth and material-performance deficiencies. Accordingly, *proper implementation of the geotechnical engineer's recommendations will not of itself be sufficient to prevent moisture infiltration.* Confront the risk of moisture infiltration by including building-envelope or mold specialists on the design team. *Geotechnical engineers are not building-envelope or mold specialists.*



Telephone: 301/565-2733

e-mail: info@geoprofessional.org www.geoprofessional.org

Copyright 2019 by Geoprofessional Business Association (GBA). Duplication, reproduction, or copying of this document, in whole or in part, by any means whatsoever, is strictly prohibited, except with GBA's specific written permission. Excerpting, quoting, or otherwise extracting wording from this document is permitted only with the express written permission of GBA, and only for purposes of scholarly research or book review. Only members of GBA may use this document or its wording as a complement to or as an element of a report of any kind. Any other firm, individual, or other entity that so uses this document without being a GBA member could be committing negligent

TERMS AND CONDITIONS

SERVICES TO BE PROVIDED. GeoCon Engineering & Material Testing, Inc. (hereinafter GeoCon) is an independent consultant and agrees to provide Client, for its sole benefit and exclusive use, consulting services set forth in our proposal.

PAYMENT TERMS. Client agrees to pay our invoice upon receipt. If payment is not received within 30 days from the invoice date, Client agrees to pay a service charge on the past due amount at a rate of 1.5% per month, and GeoCon reserves the right to suspend all work until payment is received. No deduction shall be made from our invoice on account of liquidated damages or other sums withheld from payments to contractors or others.

TERMINATION. Either party may terminate this Agreement without cause upon 20 days advance notice in writing. In the event Client requests termination prior to completion of the proposed services, Client agrees to pay GeoCon for all costs incurred plus reasonable charges associated with termination of the work.

PROFESSIONAL LIABILITY. Notwithstanding any other provision of this Agreement, the Engineer's and GeoCon's total liability to the Owner for any loss or damages from claims arising out of or in connection with this Agreement from any cause including the Engineer's strict liability, breach of contract, or professional negligence, errors and omissions (whether claimed in tort, contract, strict liability, nuisance, by statute or otherwise) shall not exceed the lesser of the total contract price of this Agreement or the proceeds paid under Engineer's liability insurance in effect at the time such claims are made. The Owner hereby releases the Engineer from any liability exceeding such amount. In no event shall either party to this Agreement be liable to the other for special, indirect, incidental or consequential damages, whether or not such damages were foreseeable at the time of the commencement of the work under this Agreement.

SITE OPERATIONS. Client will arrange for right-of-entry to all applicable properties for the purpose of performing studies, tests and evaluations pursuant to the agreed services. Client represents that it possesses necessary permits and licenses required for its activities at the site.

OWNERSHIP AND USE OF PROJECT DOCUMENTS. All documents are instruments of service in respect to the Services, and Engineer shall retain an ownership and proprietary property interest therein (including the right of reuse at the discretion of the Engineer) whether or not the Services are completed. Client may make and retain copies of documents for information and reference in connection with the services by Client. Such documents are not intended or represented to be suitable for reuse by Client or others on extensions of the services or on any other project. Any such reuse or modification without written verification or adaptation by Engineer, as appropriate for the specific purpose intended, will be at Client's sole risk and without liability or legal exposure to Engineer or to Engineer's consultants. Client shall indemnify and hold harmless Engineer and Engineer's consultants from all claims, damages, and expenses including attorneys' fees arising out of or resulting therefrom.

ADDITIONAL SERVICES OF CONSULTANT. If authorized in writing by the Client, GeoCon shall furnish additional services that are not considered as an integral part of the Scope of Services outlined in the Proposal Acceptance Sheet. Under this Agreement, all costs for additional services will be negotiated as to activities and compensation. In addition, it is possible that unforeseen conditions may be encountered that could substantially alter the original scope of services. If this occurs, GeoCon will promptly notify and consult with Client and any additional services will be negotiated.

ASSIGNABILITY. GeoCon shall not assign any interest on this Agreement, and shall not transfer any interest in the same (whether by assignment or novation) without the prior written consent of the Client; provided, however, that claims for money by GeoCon against Client under this Agreement may be assigned to a bank, trust company, or other financial institution without such approval. Written notice of any such assignment or transfer shall be promptly furnished to the Client.

SERVICES TO BE CONFIDENTIAL. All services, including opinions, designs, drawings, plans, specifications, reports and other services and information, to be furnished by GeoCon under this Agreement are confidential and shall not be divulged, in whole or in part, to any person, other than to duly authorized representatives of the Client, without prior written approval of the Client, except by testimony under oath in a judicial proceeding or as otherwise required by law. GeoCon shall take all necessary steps to ensure that no member of its organization divulges any such information except as may be required by law.

CLAIMS. The parties agree to attempt to resolve any dispute without resort to litigation. However, in the event a claim is made that results in litigation, and the claimant does not prevail at trial, then the claimant shall pay all costs incurred in defending the claim, including reasonable attorney's fees. The claim will be considered proven if the judgment obtained and retained through any applicable appeal is at least ten percent greater than the sum offered to resolve the matter prior to the commencement of trial.

SEVERABILITY. It is understood and agreed by the parties hereto, that if any part, term or provisions of this Agreement is held by any court of competent jurisdiction to be illegal or in conflict with any applicable law, the validity of the remaining portion or portions of this Agreement shall not be affected and the rights and obligations of the parties shall be construed and enforced as if the Agreement did not contain the particular part, term or provision held to be invalid.

SURVIVAL. All obligations arising prior to the termination of this Agreement and all provisions of this Agreement allocating responsibility or liability between Client and GEOCON shall survive the completion of the services and the termination of this Agreement.

INTEGRATION. This Agreement, the attached documents and those incorporated herein constitute the entire Agreement between the parties and cannot be changed except by a written instrument signed by both parties.

GOVERNING LAW. This Agreement shall be governed in all respects by the laws of the State of Alabama and venue shall be in Baldwin County, Alabama