

CONCOURSE A, B, & BAGCLAIM RESTROOMS RESTROOM RENOVATIONS

DESTIN-FORT WALTON BEACH AIRPORT (VPS)
1701 STATE ROAD 85 NORTH, EGLIN AFB, FL 32542
BID REVIEW SET 09.19.2025



PROJECT NARRATIVE

INTERIOR ARCHITECTURE RENOVATION OF EXISTING RESTROOMS. ALTERATION LEVEL 2. THREE EXISTING RESTROOM CLUSTERS ARE BEING RENOVATED WITH NEW FLOOR, WALL, CEILING FINISHES, LIGHTING, PLUMBING FIXTURES, TOILET PARTITIONS AND RESTROOM ACCESSORIES. LAVATORY COUNT INCREASE OF (2). SOME EXISTING PLUMBING CHASES ARE TO BE WIDENED BY MOVING URINAL PLUMBING WALLS INTO RESTROOMS TO IMPROVE MAINTENANCE ACCESS TO PLUMBING WHERE POSSIBLE. ONE SMALL EXISTING OFFICE BEHIND A PLUMBING WALL IS TO BE COMBINED WITH AN EXISTING CIRCULATION ALCOVE AND UNOCCUPIED CONCEALED SPACE TO CREATE A JANITORIAL STORAGE & PLUMBING ACCESS ROOM AT THE GROUND FLOOR BAGGAGE CLAIM RESTROOMS. CONSTRUCTION IS TO BE IN (3) PHASES TO FACILITATE CONTINUOUS AIRPORT OPERATIONS DURING CONSTRUCTION. SECURITY ACCESS IS REQUIRED TO ACCESS 2 OF THE 3 RESTROOM CLUSTERS.

OWNER
OKALOOSA COUNTY AIRPORT ADMINISTRATION
1701 STATE ROAD 85 NORTH, EGLIN AFB, FL 32542
CONTACT: CHAD ROGERS, DEPUTY DIRECTOR
PHONE: 850-651-7160

ARCHITECTURE
INFRASTRUCTURE CONSULTING & ENGINEERING
5550 W IDLEWILD AVE, SUITE 115, TAMPA, FL 33634
CONTACT: BING LIU, AIA
PHONE: 813-803-8928

STRUCTURAL
ROBEL ENGINEERING, INC.
3702 W SPRUCE ST #1308, TAMPA, FL, 33607
CONTACT: ROBERT BELL, PE
PHONE: 813-638-0385

MECHANICAL & PLUMBING
ENGINEERING PROFESSIONALS, INC.
912 W DR MARTIN LUTHER KING JR BLVD, TAMPA, FL 33603
CONTACT: JASON KENDALL, ASHRAE HFDP
PHONE: 813-251-6848

ELECTRICAL
KBA ENGINEERING, INC.
201 FLAGSHIP DR, SUITE 106, LUTZ, FL 33549
CONTACT: TREVOR BAKER, PROJECT MANAGER
PHONE: 813-909-1845



VICINITY MAP




LOCATION MAP



INFRASTRUCTURE CONSULTING & ENGINEERING ARCHITECTURE
5550 W Idlewild Ave, Suite 115
Tampa, FL 33634
813-803-8928

Consultant	
Designed by:	KGL
Drawn by:	JCL
Checked by:	EL
Project Number:	24-201.01



Notes:

Scale Graphic:

REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
COVER SHEET

Date:	09-19-2025	Sheet Number:	G-001
Scale:		Drawing Number:	24-201.01

CODE REFERENCE LEGEND

FBC-A # = 2023 FLORIDA BUILDING CODE, ACCESSIBILITY, 8TH ED.
 FBC-P # = 2023 FLORIDA BUILDING CODE, PLUMBING, 8TH ED.



INFRASTRUCTURE CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
 Tampa, FL 33634
 813-803-8928

Consultant:
 Designed by: **KGL**
 Drawn by: **JL**
 Checked by: **EL**
 Project Number: **24-201.01**

Scale Graphic:

REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
 VPS - DESTIN-FORT
 WALTON BEACH
 AIRPORT**

TYPICAL ADA DETAILS


Date: 09-19-2025
 Sheet Number: **A-002**
 Scale: 3/8" = 1'-0"
 Drawing Number: 24-201.01

A


B

C


D

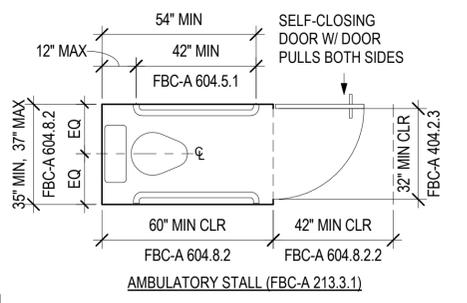

AMBULATORY STALL (FBC-A 213.3.1)

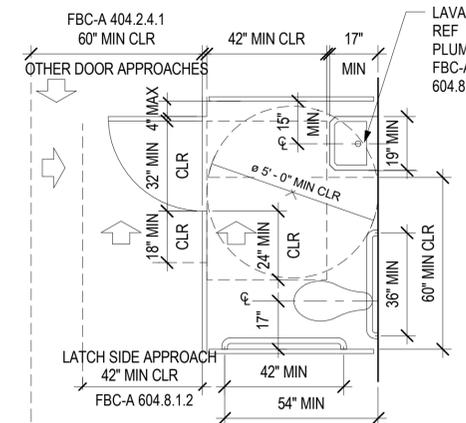

WHEELCHAIR ACCESSIBLE STALL

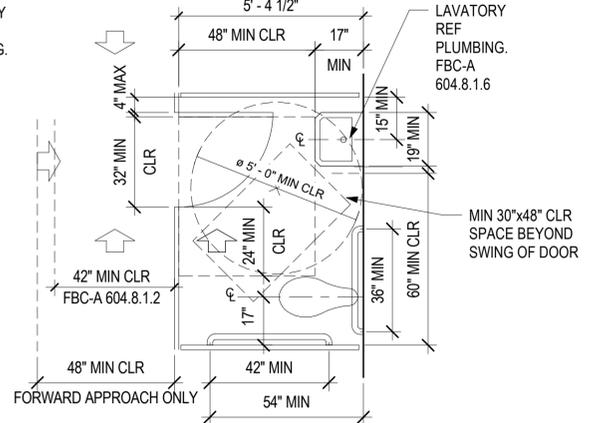


ALTERNATE WHEELCHAIR ACCESSIBLE STALL

- TOE CLEARANCE AT THE FRONT OF THE PARTITION IS NOT REQUIRED IN A COMPARTMENT GREATER THAN 62" DEEP WITH A WALL-HUNG WATER CLOSET OR 65" DEEP WITH A FLOOR-MOUNTED WATER CLOSET. TOE CLEARANCE AT THE SIDE IS NOT REQUIRED IN A COMPARTMENT GREATER THAN 66" WIDE. (FBC-A 604.8.1.4)
- WHERE 6 OR MORE STALLS ARE PROVIDED, IN ADDITION TO STANDARD STALL, PROVIDE AT LEAST 1 AMBULATORY STALL 36" WIDE WITH A DOOR THAT SWINGS OUT AND A MIN. STALL DEPTH OF 60". STALL SHALL BE IN ACCORDANCE TO APPLICABLE PLUMBING AND FBC ACCESSIBILITY CODE (FBC-P 405.3.1, FBC-A 604.8.2).

TOILET STALLS


TOILET ROOMS WITH STALLS

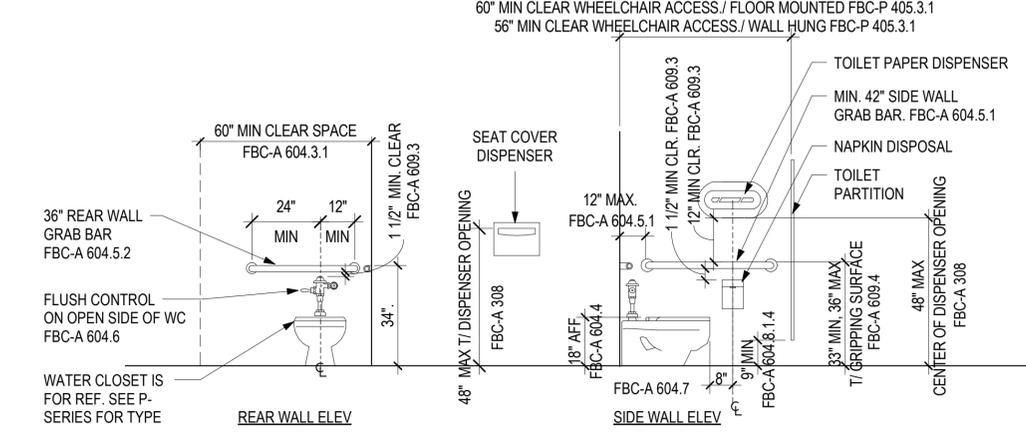


REAR WALL ELEV

SIDE WALL ELEV


NOT IN STALL

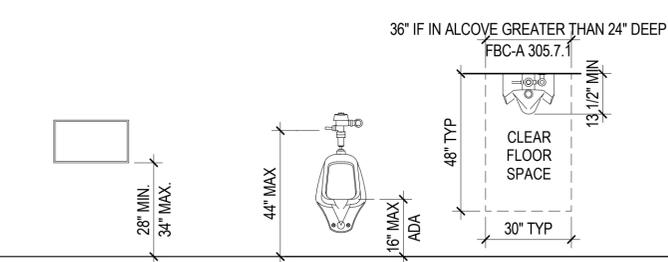


BABY CHANGING

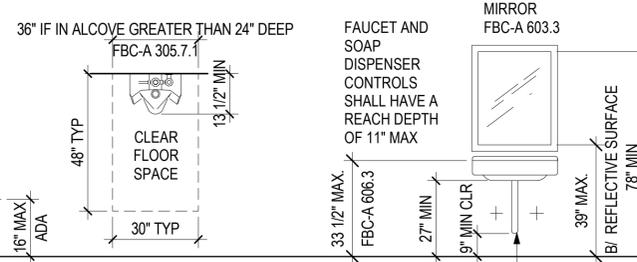


URINAL

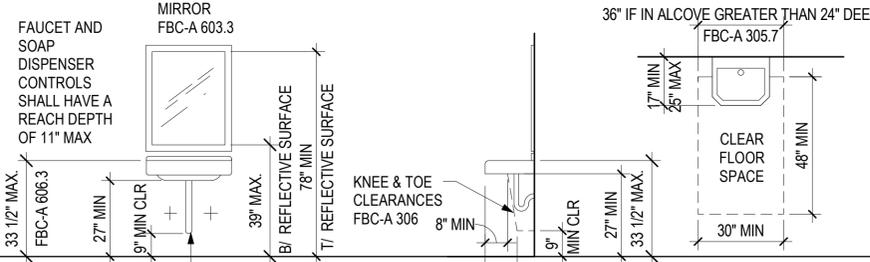


SINKS

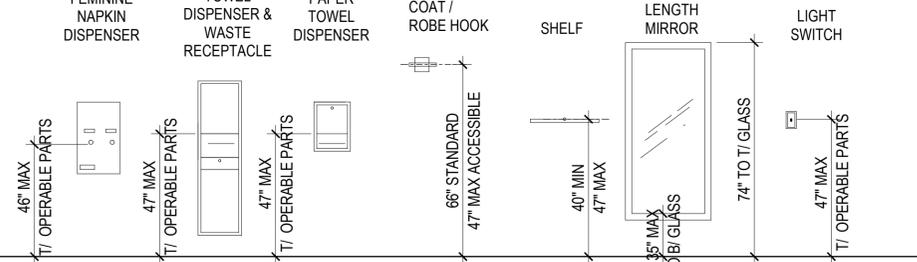


RESTROOM ACCESSORY MOUNTING HEIGHTS

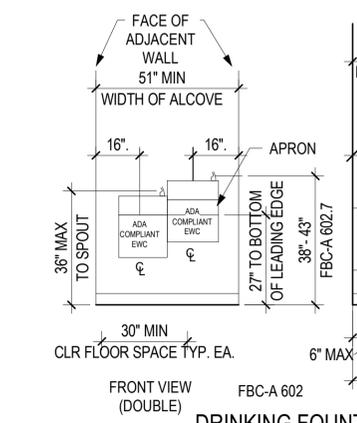

DRINKING FOUNTAINS

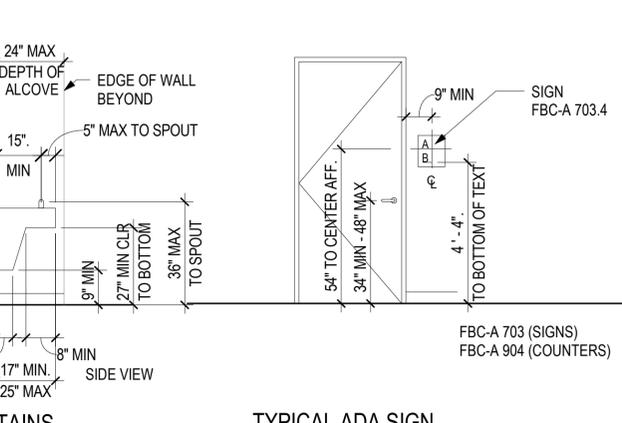


TYPICAL ADA SIGN

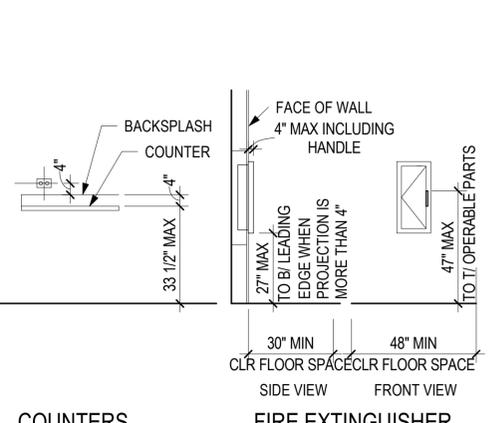


COUNTERS

FIRE EXTINGUISHER

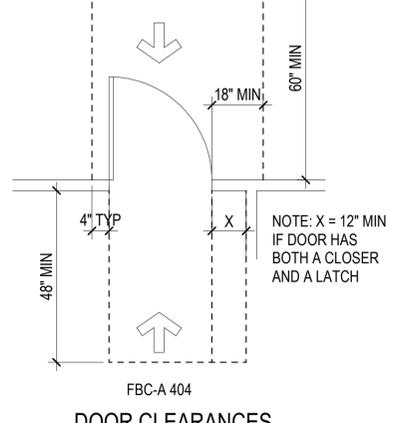

DOOR CLEARANCES

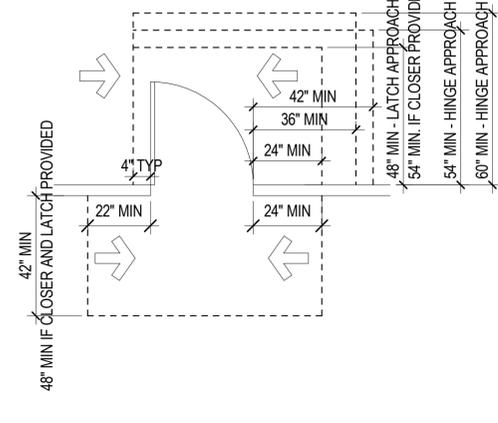

DOOR CLEARANCES


BID SET

A

B


C

D

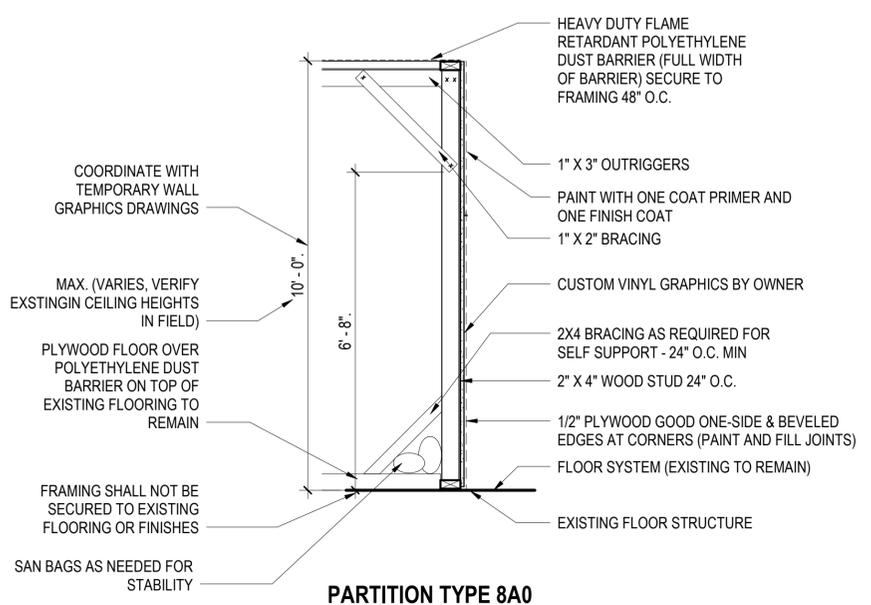

PARTITION TYPE 8A0


TYPE	FIRE RATING	CORE WIDTH	OVERALL WIDTH	UL LISTING
8A0.2	NON-RATED	2 1/2"	3 1/8"	N/A

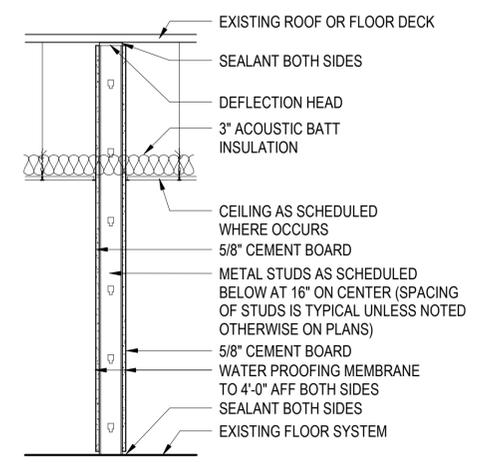

PARTITION TYPE 1A0


IN NON-RESTROOM INSTALLATIONS: SUBSTITUTE GYPSUM WALL BOARD WITHOUT WATERPROOFING MEMBRANE. SUBSTITUTE CEILING ACOUSTIC BATT INSULATION TO BE IN WALL FLOOR TO DECK ABOVE.

TYPE	FIRE RATED	CORE WIDTH	OVERALL WIDTH	STC RATED	UL LISTING	STC TEST
1A0.3	NON-RATED	3 5/8"	4 7/8"	NON-RATED	N/A	N/A
1A0.4	NON-RATED	4"	5 1/4"	NON-RATED	N/A	N/A
1A0.6	NON-RATED	6"	7 1/4"	NON-RATED	N/A	N/A

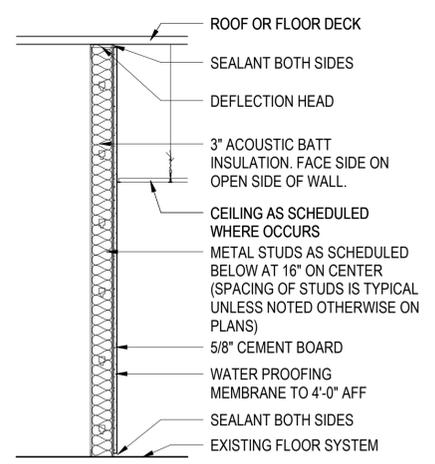


PARTITION TYPE 3A0
CHASE WALL

TYPE	FIRE RATING	CORE WIDTH	OVERALL WIDTH	STC RATING	UL LISTING	STC TEST
3A0.4	NON-RATED	4"	4 5/8"		N/A	
3A0.6	NON-RATED	6"	6 5/8"		N/A	

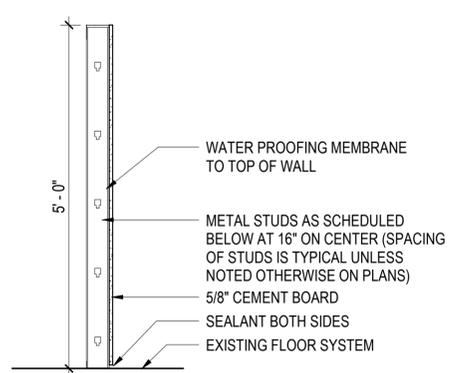

PARTITION TYPE 3D0
URINAL WALL

TYPE	FIRE RATING	CORE WIDTH	OVERALL WIDTH	STC RATING	UL LISTING	STC TEST
3D0.4	NON-RATED	4"	5 1/4"	NON-RATED	N/A	
3E0.4	NON-RATED	4"	4 1/4"	NON-RATED	N/A	

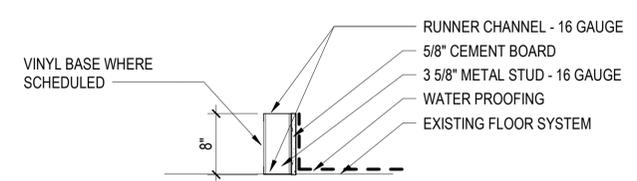


PARTITION TYPE 3E0
W.P. CURB

TYPE	FIRE RATING	CORE WIDTH	OVERALL WIDTH	STC RATING	UL LISTING	STC TEST
3E0.3	NON-RATED	3 5/8"	4 1/4"	NON-RATED	N/A	

NOTES - PARTITION

- ALL PARTITIONS IN RESTROOMS TO RECEIVE MOISTURE RESISTANT GYPSUM BOARD IN PLACE OF GYPSUM WALL BOARD.
- ALL PARTITIONS AT SHOWER ENCLOSURES TO RECEIVE 5/8" CEMENT BOARD IN PLACE OF GYPSUM WALL BOARD.
- WHERE WALLS ARE TO RECEIVE TILE OR STONE CLADDING, 5/8" CEMENT BOARD IS TO BE USED IN PLACE OF GYPSUM WALL BOARD.
- ALL PERIMETER WALLS AROUND RESTROOMS THAT ARE NOT ALREADY REQUIRED TO RECEIVE AND STC RATING WILL RECEIVE SOUND ATTENUATING BATT INSULATION AND ACOUSTICAL SEALANT AT THE TOP AND BOTTOM OF THE WALL. THE SOUND ATTENUATING BATT INSULATION WILL BE CONTINUOUS THEN ENTIRE HEIGHT OF THE WALL.
- FILL VOIDS AROUND WALL PENETRATIONS WITH FIRE STOPPING TO AVOID REDUCTION OF FIRE RATING.
- ALL FIRE RATED PARTITIONS TO RECEIVE TYPE "X" GYPSUM BOARD.

LEGEND - PARTITION TYPES



- CORE TYPE
- METAL STUD WALL
 - METAL STUD SHAFT WALL
 - METAL STUD (1 SIDED GYP BD)
 - WOOD STUD WALL
 - WOOD STUD (1 SIDED GYP BD)
 - CMU
 - CONCRETE
 - FURRING
- CORE HEIGHT
- FULL HEIGHT (TO UNDERSIDE OF STRUCTURE)
 - 6" ABOVE HIGHEST ADJACENT CEILING
 - TO CEILING
 - (D-Z) USER DEFINED (SPECIAL CONDITIONS)

- RATING
- NON-RATED
 - 1 HOUR
 - 2 HOUR
 - 3 HOUR
 - 4 HOUR
 - 1/2 HOUR
 - SMOKE RATED

- CORE WIDTH
- METAL STUD (1 5/8")
 - METAL STUD (2 1/2")
 - METAL STUD (3 5/8")
 - METAL STUD (4") WOOD STUD (3 1/2") CMU/CONCRETE (3 5/8")
 - METAL STUD (5") WOOD STUD (4 1/2") CMU/CONCRETE (5 5/8")
 - METAL STUD (6") WOOD STUD (5 1/2") CMU/CONCRETE (7 5/8")
 - METAL STUD (8") WOOD STUD (7 1/4") CMU/CONCRETE (7 5/8")
 - METAL STUD (10") WOOD STUD (9 1/4") CMU/CONCRETE (9 5/8")
 - WOOD STUD (11 1/4") CMU/CONCRETE (11 5/8")

- STC CLASSIFICATION
- STC 35
 - STC 40
 - STC 45
 - STC 50
 - STC 55



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant

Designed by: **KGL**

Drawn by: **JCL**

Checked by: **EL**

Project Number: **24-201.01**

Notes:

Scale Graphic:

REVISIONS

No.	Description	Date
1	BID SET	09-19-2025

Project Name:


RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT

Drawing Name:

PARTITION TYPES

Date: **09-19-2025** Sheet Number: **A-003**

Scale: **As indicated** Drawing Number: **24-201.01**

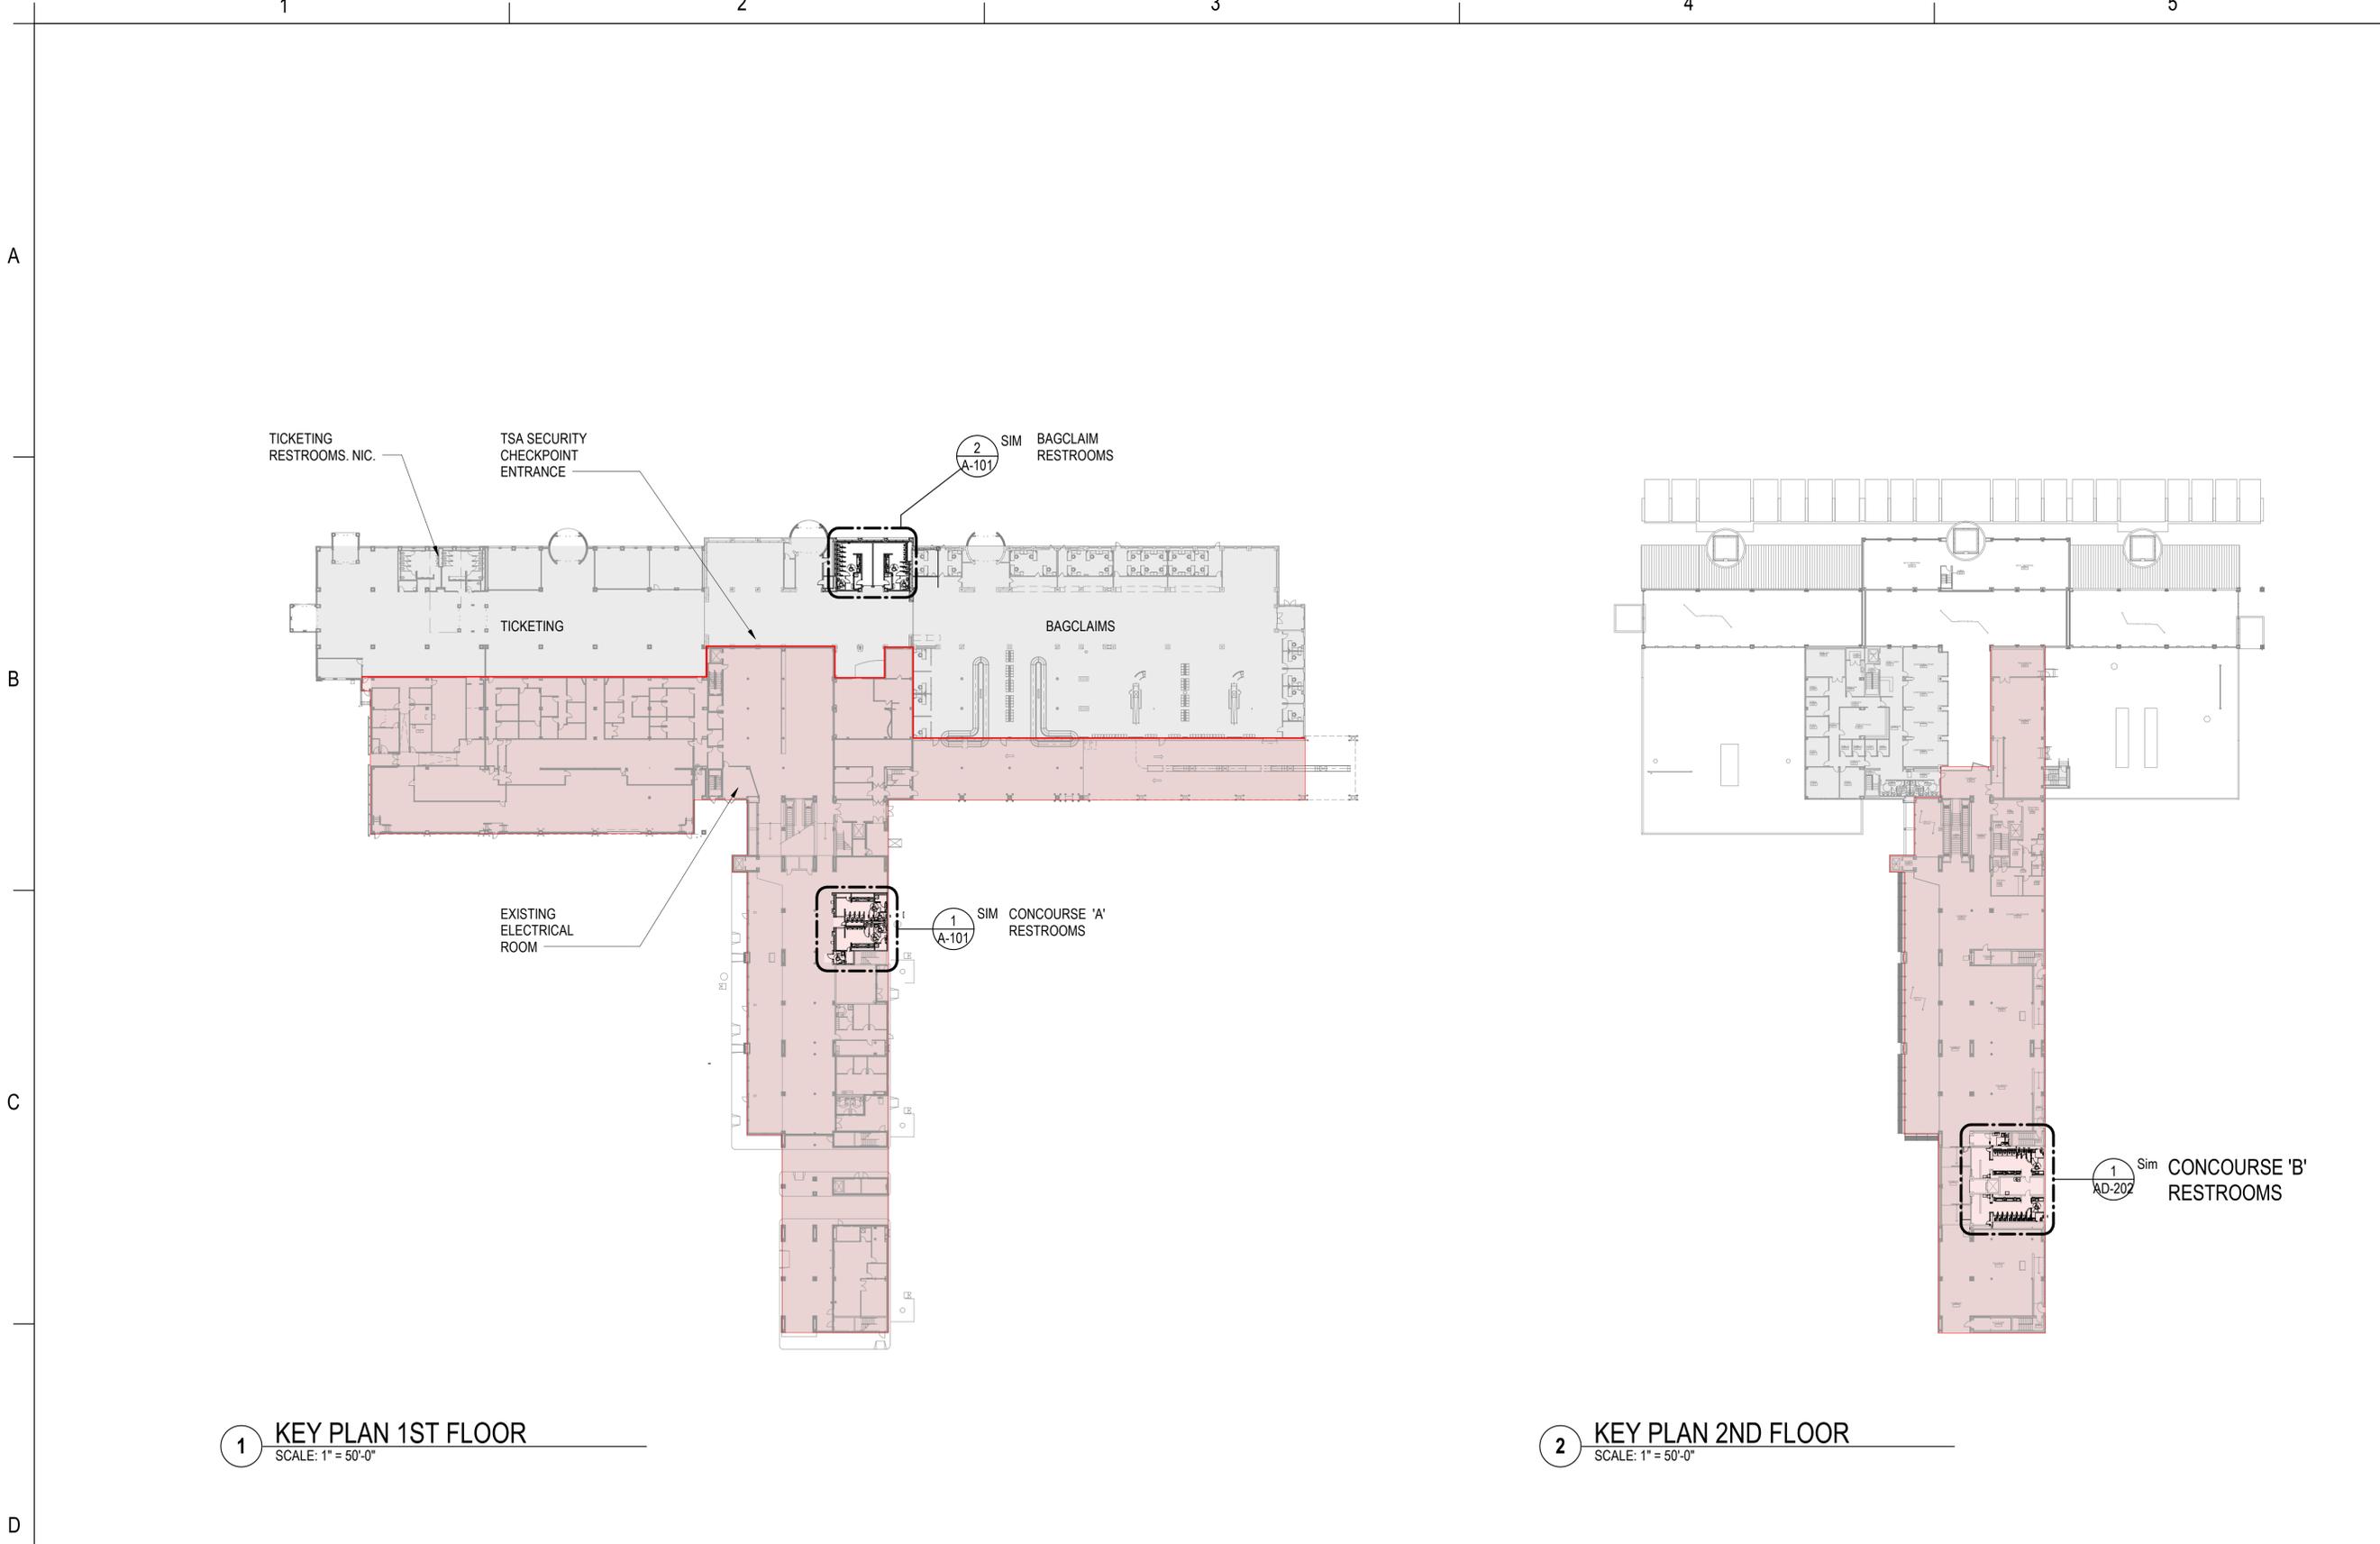

1 KEY PLAN 1ST FLOOR
SCALE: 1" = 50'-0"

2 KEY PLAN 2ND FLOOR
SCALE: 1" = 50'-0"

KEY PLAN LEGEND

	SIDA (SECURITY IDENTIFICATION DISPLAY AREA)
	NIC AREA




INFRASTRUCTURE
CONSULTING & ENGINEERING
ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:
Designed by: **KGL**
Drawn by: **JCL**
Checked by: **EL**
Project Number: **24-201.01**



Notes:

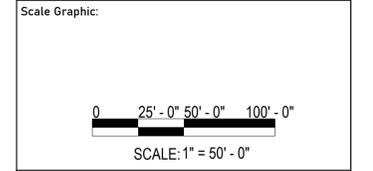


REVISIONS

No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT
WALTON BEACH
AIRPORT**

Drawing Name:
KEY PLAN

Date: 09-19-2025	Sheet Number: AS-101
Scale: As indicated	Drawing Number: 24-201.01

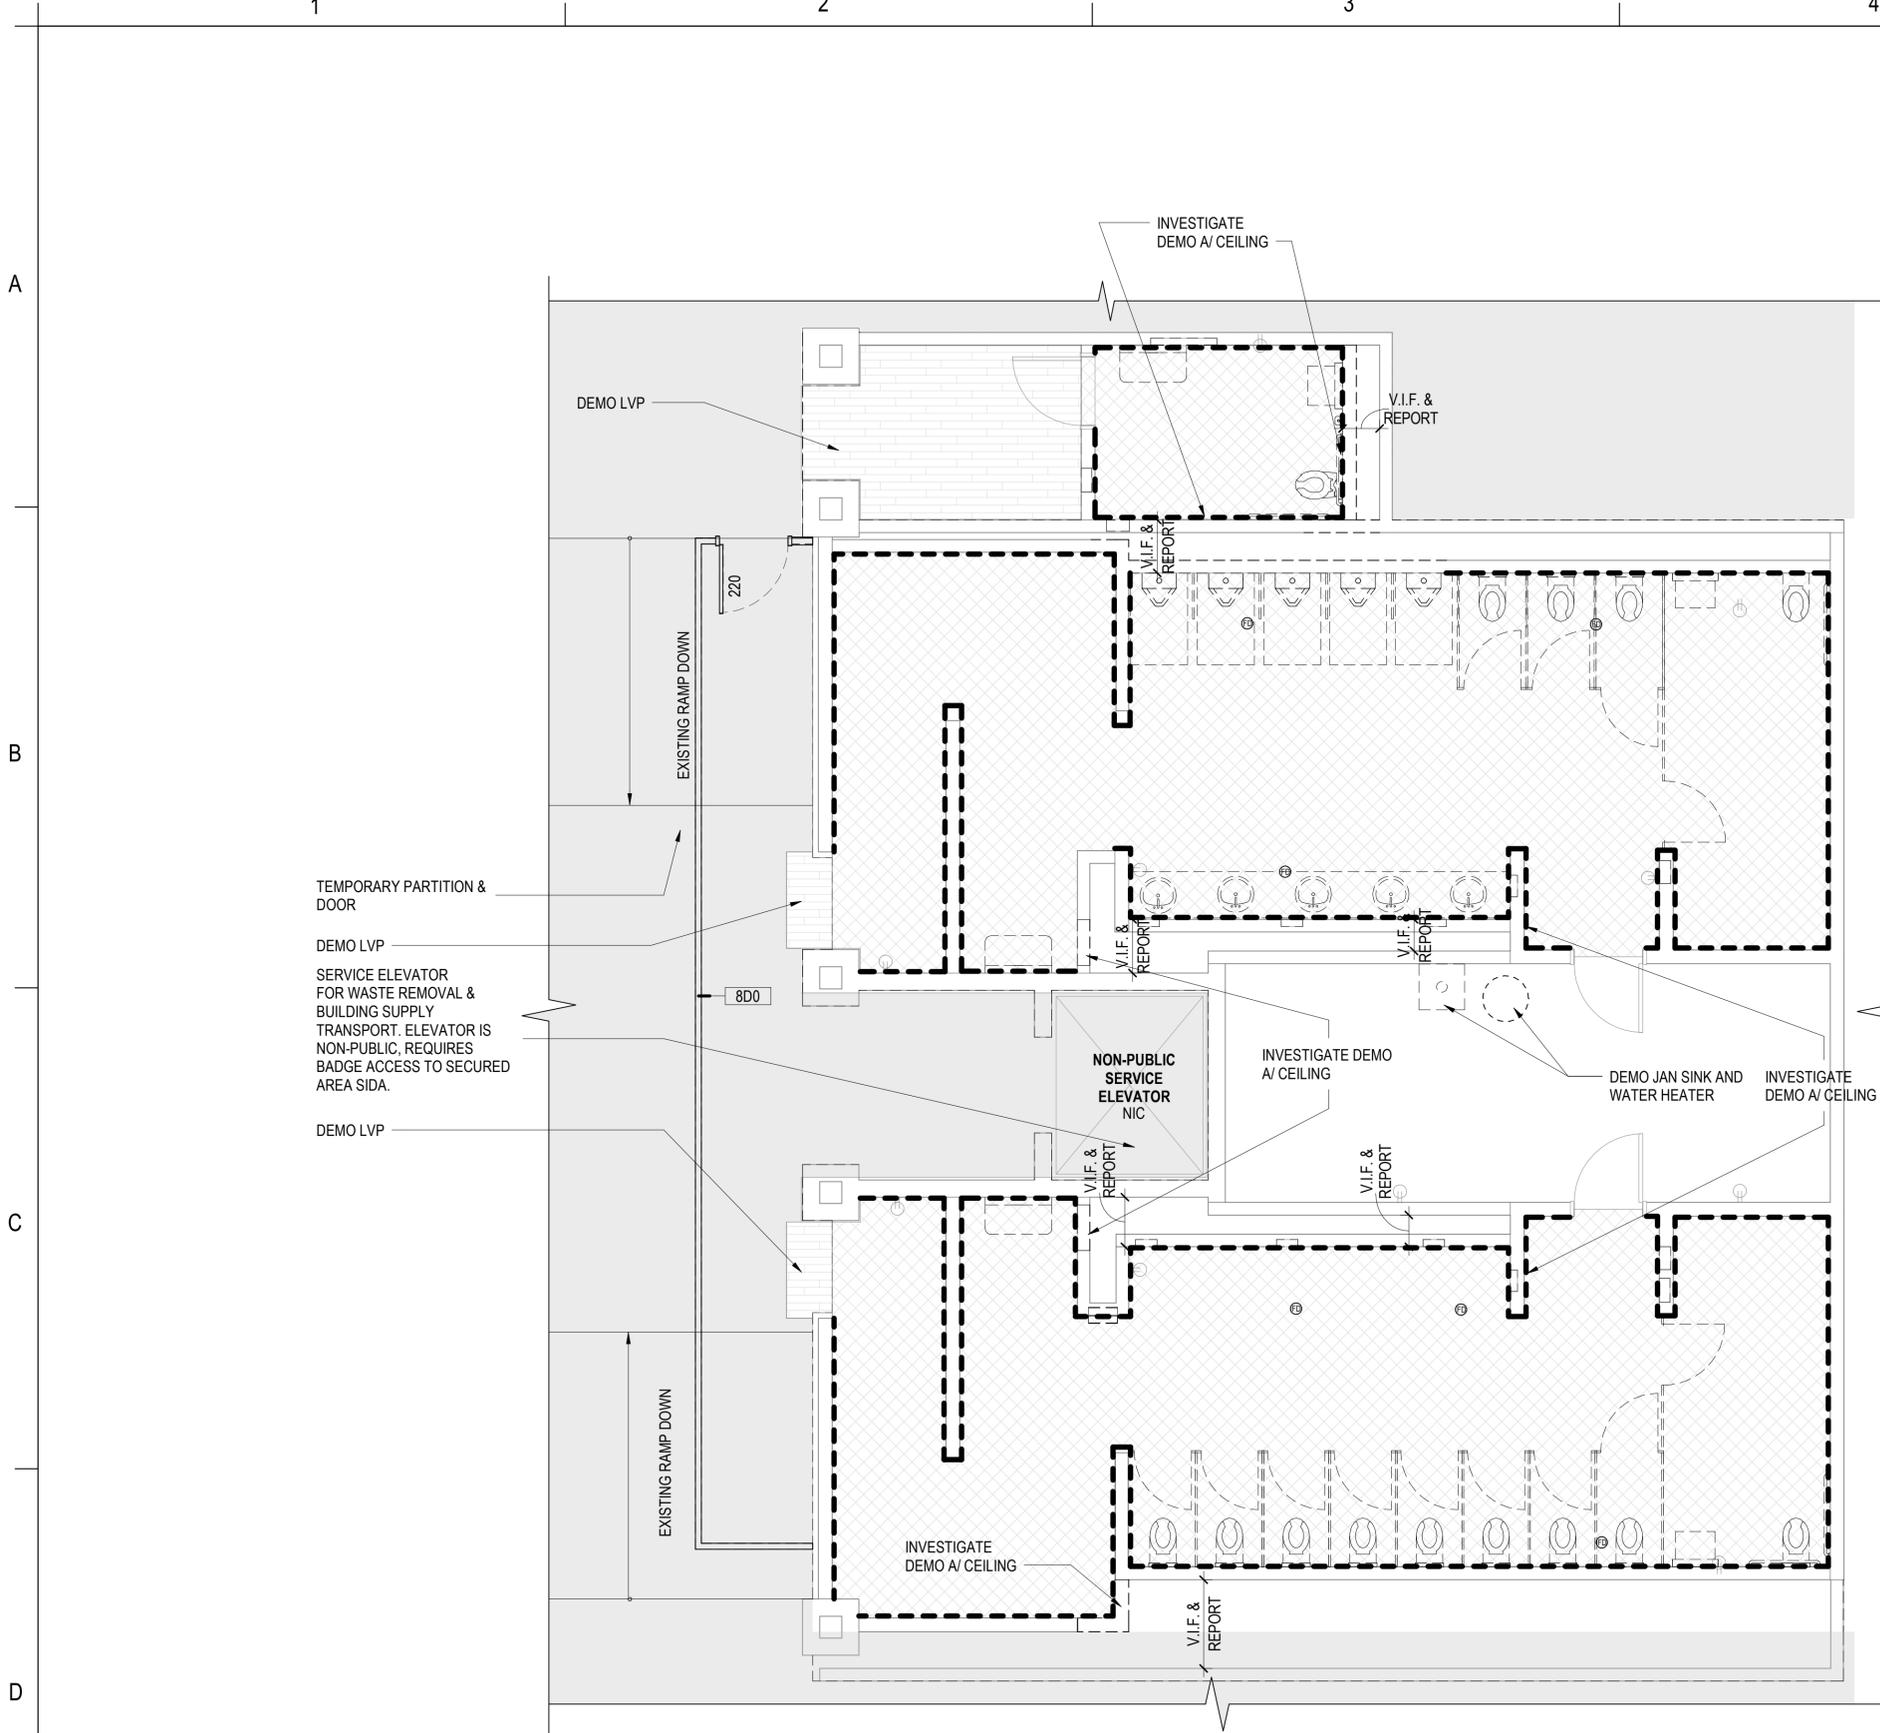

1 CONCURSE 'B' RESTROOMS DEMO PLAN (2ND FLOOR)
SCALE: 1/4" = 1'-0"

- NOTES - DEMO**
- ALL ABANDONED MECHANICAL, PLUMBING, AND ELECTRICAL PIPING IS TO BE REMOVED TO A POINT BELOW EXISTING CONCRETE FLOOR SLAB, BEHIND WALLS AND AS CLOSE TO THE CEILING DECK AS POSSIBLE AND MADE SAFE BY CAPPING.
 - ALL DEMOLITION WORK IS TO BE DONE IN COMPLIANCE WITH ALL APPLICABLE CODES, LAWS AND REGULATIONS.
 - ALL DEMOLITION WORK REQUIRED IS NOT LIMITED TO THAT INDICATED ON THESE PLANS. THE INTENT IS TO REMOVE ALL MECHANICAL, ELECTRICAL, PLUMBING, COMMUNICATIONS, AND ARCHITECTURAL ITEMS AS INDICATED AND AS NECESSARY TO FACILITATE NEW CONSTRUCTION.
 - ALL EQUIPMENT TO REMAIN THE PROPERTY OF THE OWNER. ALL EQUIPMENT THE OWNER DOES NOT WANT TO KEEP AND STORE SHALL BECOME THE PROPERTY OF THE CONTRACTOR.
 - CONDITIONS OF STRUCTURES: OWNER ASSUMES NO RESPONSIBILITY FOR ACTUAL CONDITION OF ITEMS OR STRUCTURES TO BE DEMOLISHED.
 - CONTRACTOR TO PROTECT ADJACENT AREAS FROM DUST, EXCESSIVE NOISE OR DISRUPTION OF OPERATION.
 - COORDINATE WITH MECHANICAL, ELECTRICAL, PLUMBING, AND COMMUNICATIONS DRAWINGS AND SCOPES OF WORK FOR ADDITIONAL DEMOLITION REQUIREMENTS.
 - IF HAZARDOUS MATERIALS ARE ENCOUNTERED DURING DEMOLITION OPERATIONS, THE CONTRACTOR IS TO STOP WORK IN THE AREA IMMEDIATELY, AND INFORM THE OWNER AND ARCHITECT FOR FUTURE DIRECTION.
 - NOTIFY ARCHITECT IF ANY EXISTING ITEM THAT CONFLICTS WITH THE INTENDED FINAL PRODUCT IS NOT SPECIFICALLY CALLED OUT FOR DEMOLITION. CONTRACTOR IS TO NOTIFY ARCHITECT OF ANY DISCREPANCIES IN THE DOCUMENTS AND FIELD CONDITIONS BEFORE PROCEEDING WITH DEMOLITION AND/OR CONSTRUCTION.
 - PATCH ALL INTERIOR AND EXTERIOR WALL PENETRATIONS TO MATCH EXISTING ADJACENT FINISHES. FINISH SHALL BE FLUSH WITH ADJACENT CONSTRUCTION.
 - PROTECT EXISTING STRUCTURES, FINISHES, UTILITIES AND OTHER ITEMS SCHEDULED TO REMAIN. AREAS THAT ARE DAMAGED BY SELECTIVE DEMOLITION SHALL BE PATCHED AND REPAIRED AND FINISHED OR REPLACED TO MATCH EXISTING ADJACENT SURFACES AT NO ADDITIONAL COST TO THE OWNER.
 - PROVIDE TEMPORARY BARRICADES AND OTHER FORMS OF PROTECTION AS REQUIRED TO PROTECT OWNER'S PERSONNEL AND GENERAL PUBLIC FROM INJURY DUE TO CONSTRUCTION WORK.
 - TEMPORARY BARRICADES TO BE A PREFABRICATED RE-USABLE SYSTEM WITH WHITE EXTERIOR FINISH SUITABLE FOR THE APPLICATION OF VINYL GRAPHICS BY OWNER. TEMPORARY WALL BARRICADES TO BE MIN. 8'-0" HIGH, SELF SUPPORTING.
 - REMOVE ALL EXISTING MECHANICAL DUCTS, PLUMBING, ELECTRICAL, COMMUNICATIONS, AND ANY OTHER ITEMS THAT ARE AFFECTED AND RENDERED OBSOLETE BY NEW MECHANICAL, PLUMBING AND ELECTRICAL WORK. CONTRACTOR SHALL VACUUM CLEAN THE AREA PRIOR TO INSTALLATION OF ANY NEW ITEM.
 - SHOULD HIDDEN FIELD CONDITIONS REQUIRE MODIFICATIONS TO THE LAYOUT, THE CONTRACTOR SHALL COORDINATE WITH THE ARCHITECT.
 - WHERE NECESSARY, SAW-CUT SURFACES TO PROTECT ADJACENT SURFACES NOT SCHEDULED FOR DEMOLITION.

DEMOLITION LEGEND

	NIC WORK AREAS / EXISTING TO REMAIN
	DEMO FLOOR TILE
	EXISTING LVP TO BE DEMOLISHED
	DEMO WALL TO THE STUDS
	EXISTING TO BE DEMOLISHED
	EXISTING TO REMAIN




INFRASTRUCTURE CONSULTING & ENGINEERING ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:

Designed by:	KCL
Drawn by:	JL
Checked by:	EL
Project Number:	24-201.01

Notes:

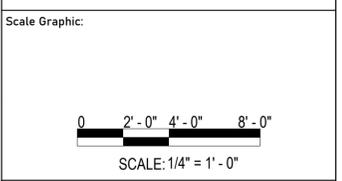


REVISIONS

No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT
WALTON BEACH
AIRPORT**

Drawing Name:
DEMO PLAN - 2ND FLOOR

Date:	09-19-2025	Sheet Number:	AD-102
Scale:	As indicated	Drawing Number:	24-201.01

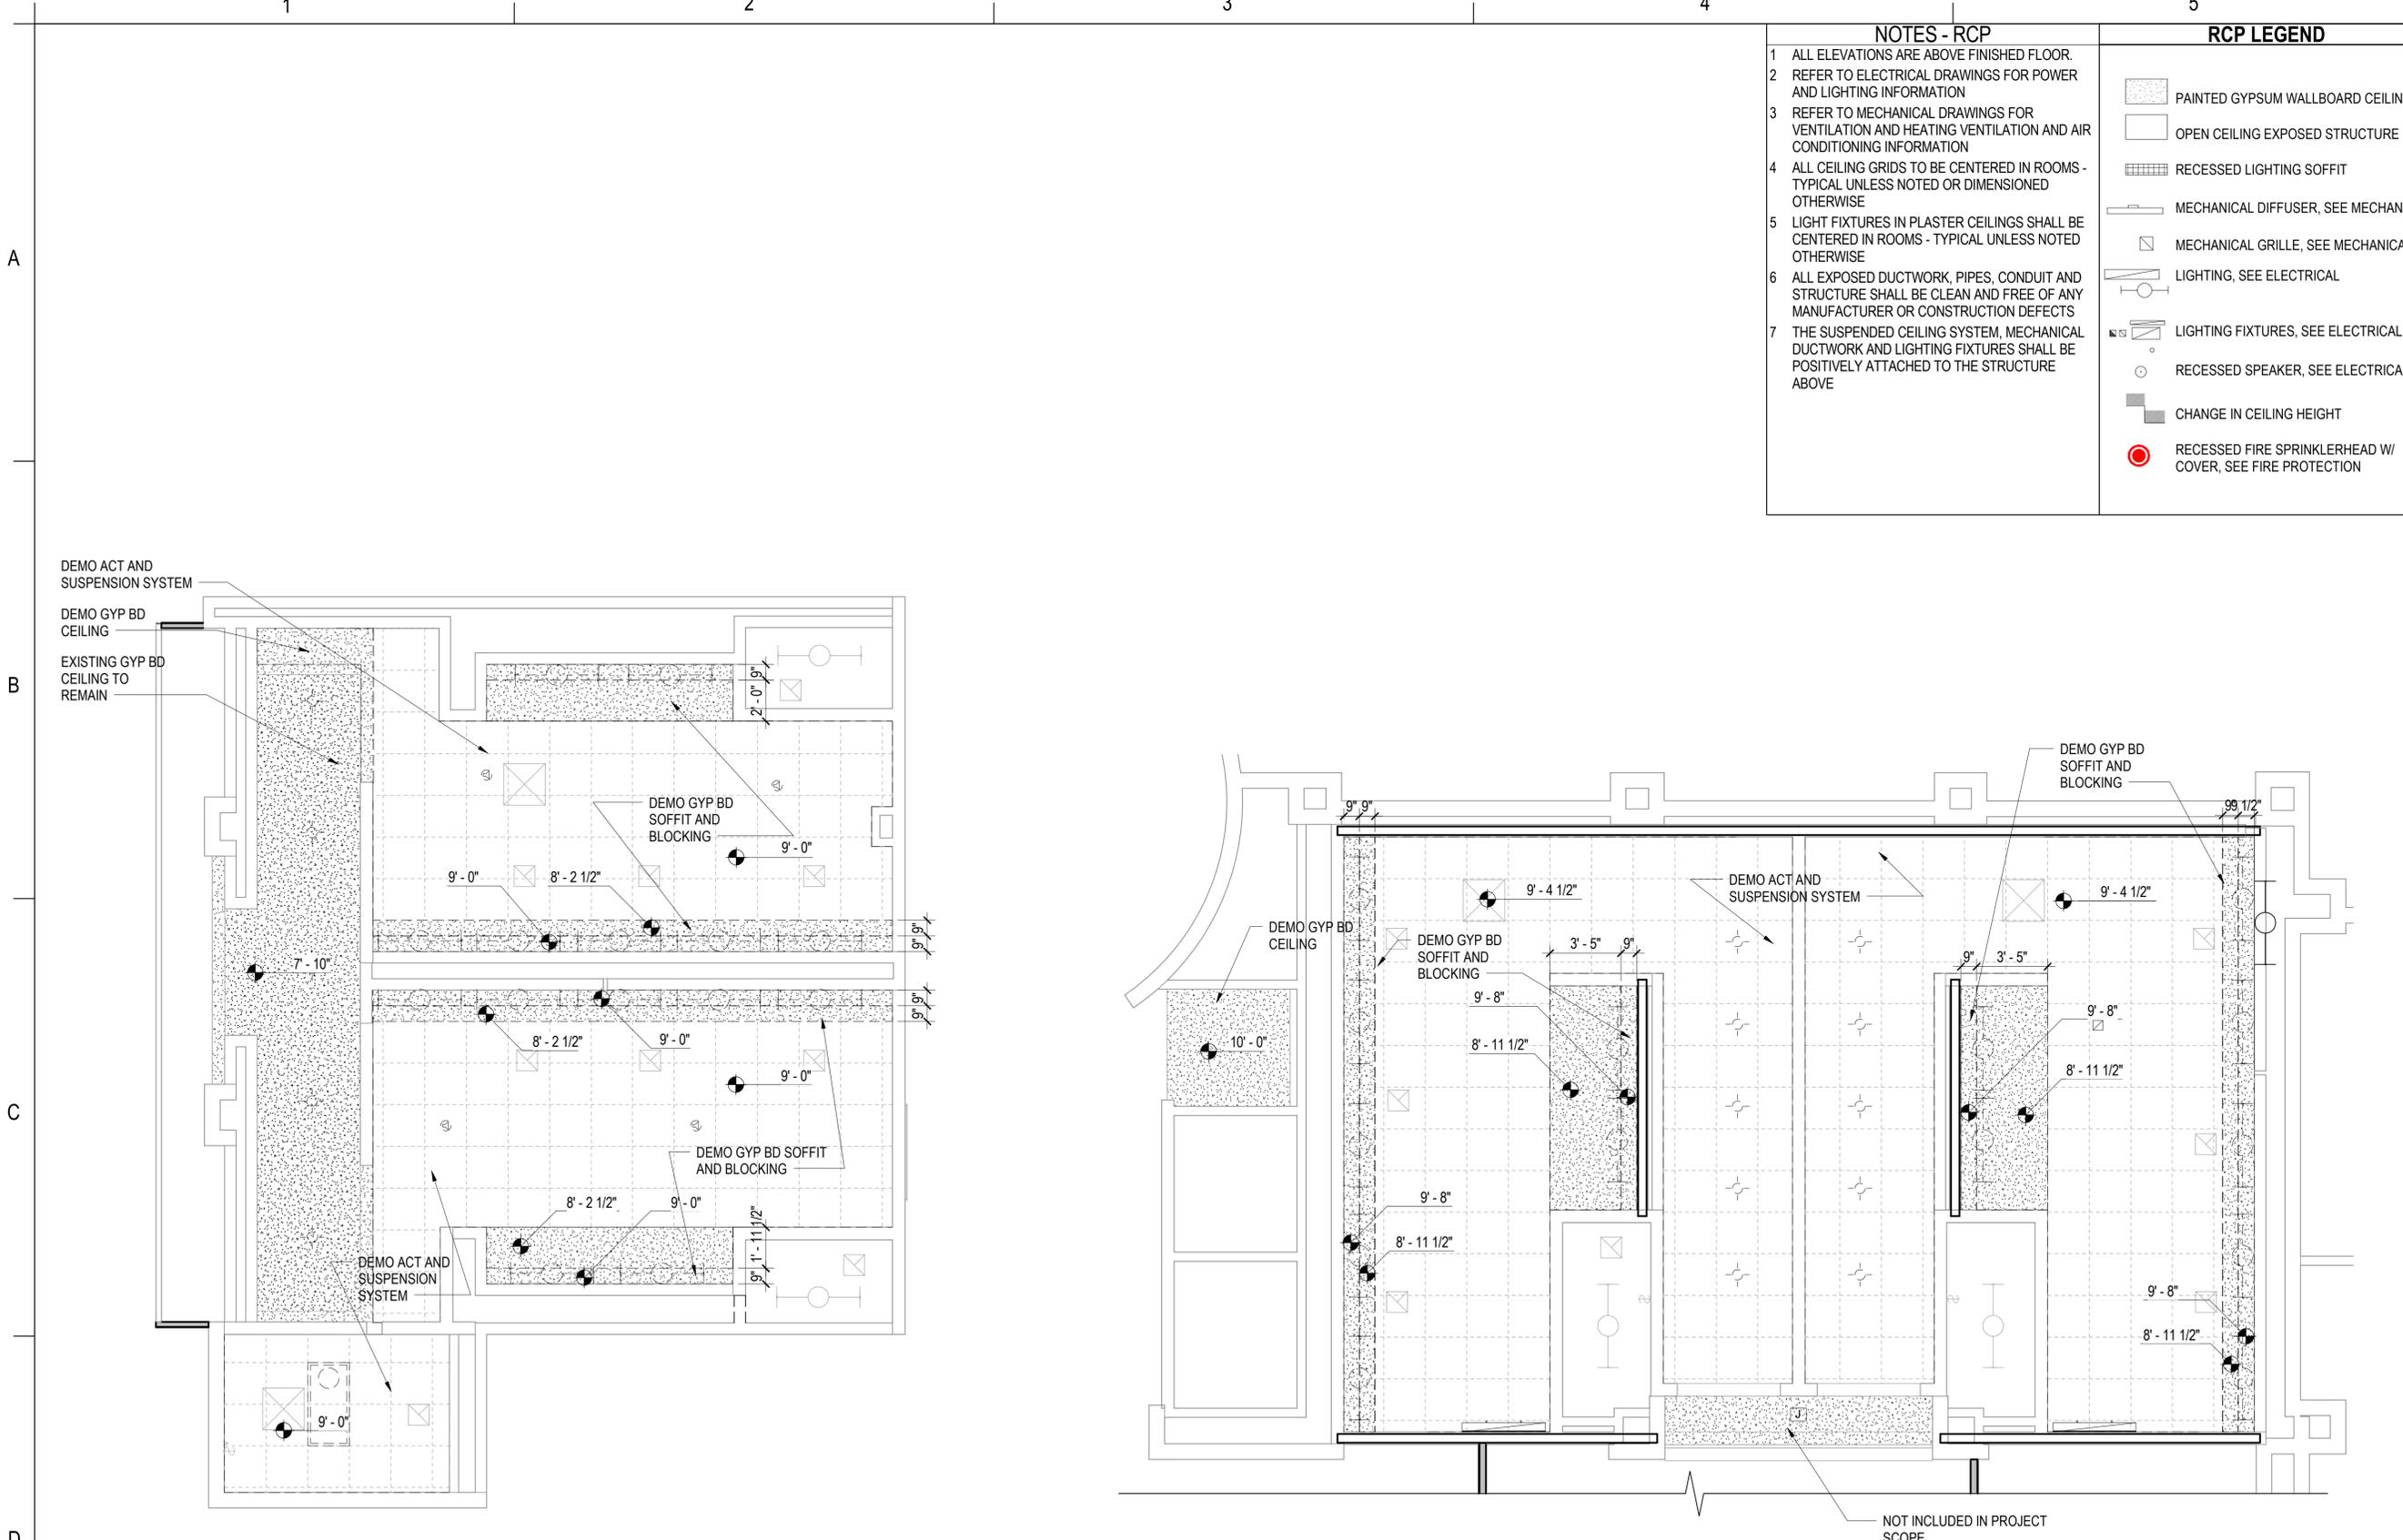

NOTES - RCP		RCP LEGEND	
1	ALL ELEVATIONS ARE ABOVE FINISHED FLOOR.	[Pattern]	PAINTED GYPSUM WALLBOARD CEILING
2	REFER TO ELECTRICAL DRAWINGS FOR POWER AND LIGHTING INFORMATION	[Pattern]	OPEN CEILING EXPOSED STRUCTURE
3	REFER TO MECHANICAL DRAWINGS FOR VENTILATION AND HEATING VENTILATION AND AIR CONDITIONING INFORMATION	[Pattern]	RECESSED LIGHTING SOFFIT
4	ALL CEILING GRIDS TO BE CENTERED IN ROOMS - TYPICAL UNLESS NOTED OR DIMENSIONED OTHERWISE	[Symbol]	MECHANICAL DIFFUSER, SEE MECHANICAL
5	LIGHT FIXTURES IN PLASTER CEILINGS SHALL BE CENTERED IN ROOMS - TYPICAL UNLESS NOTED OTHERWISE	[Symbol]	MECHANICAL GRILLE, SEE MECHANICAL
6	ALL EXPOSED DUCTWORK, PIPES, CONDUIT AND STRUCTURE SHALL BE CLEAN AND FREE OF ANY MANUFACTURER OR CONSTRUCTION DEFECTS	[Symbol]	LIGHTING, SEE ELECTRICAL
7	THE SUSPENDED CEILING SYSTEM, MECHANICAL DUCTWORK AND LIGHTING FIXTURES SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE ABOVE	[Symbol]	LIGHTING FIXTURES, SEE ELECTRICAL
		[Symbol]	RECESSED SPEAKER, SEE ELECTRICAL
		[Symbol]	CHANGE IN CEILING HEIGHT
		[Symbol]	RECESSED FIRE SPRINKLERHEAD W/ COVER, SEE FIRE PROTECTION




INFRASTRUCTURE
CONSULTING & ENGINEERING
ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant	
Designed by:	KCL
Drawn by:	JCL
Checked by:	EL
Project Number:	24-201.01



Notes:

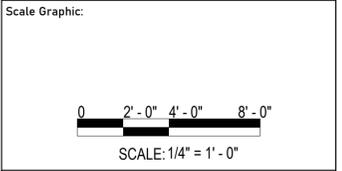

REVISIONS		
No.	Description	Date


Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name: DEMO REFLECTED CEILING PLAN - 1ST FLOOR	
Date: 09-19-2025	Sheet Number: AD-201
Scale: As indicated	Drawing Number: 24-201.01

1 CONCOURSE 'A' REFLECTED CEILING DEMO PLAN
SCALE: 1/4" = 1'-0"

2 BAGCLAIM REFLECTED CEILING DEMO PLAN
SCALE: 1/4" = 1'-0"

BD SET

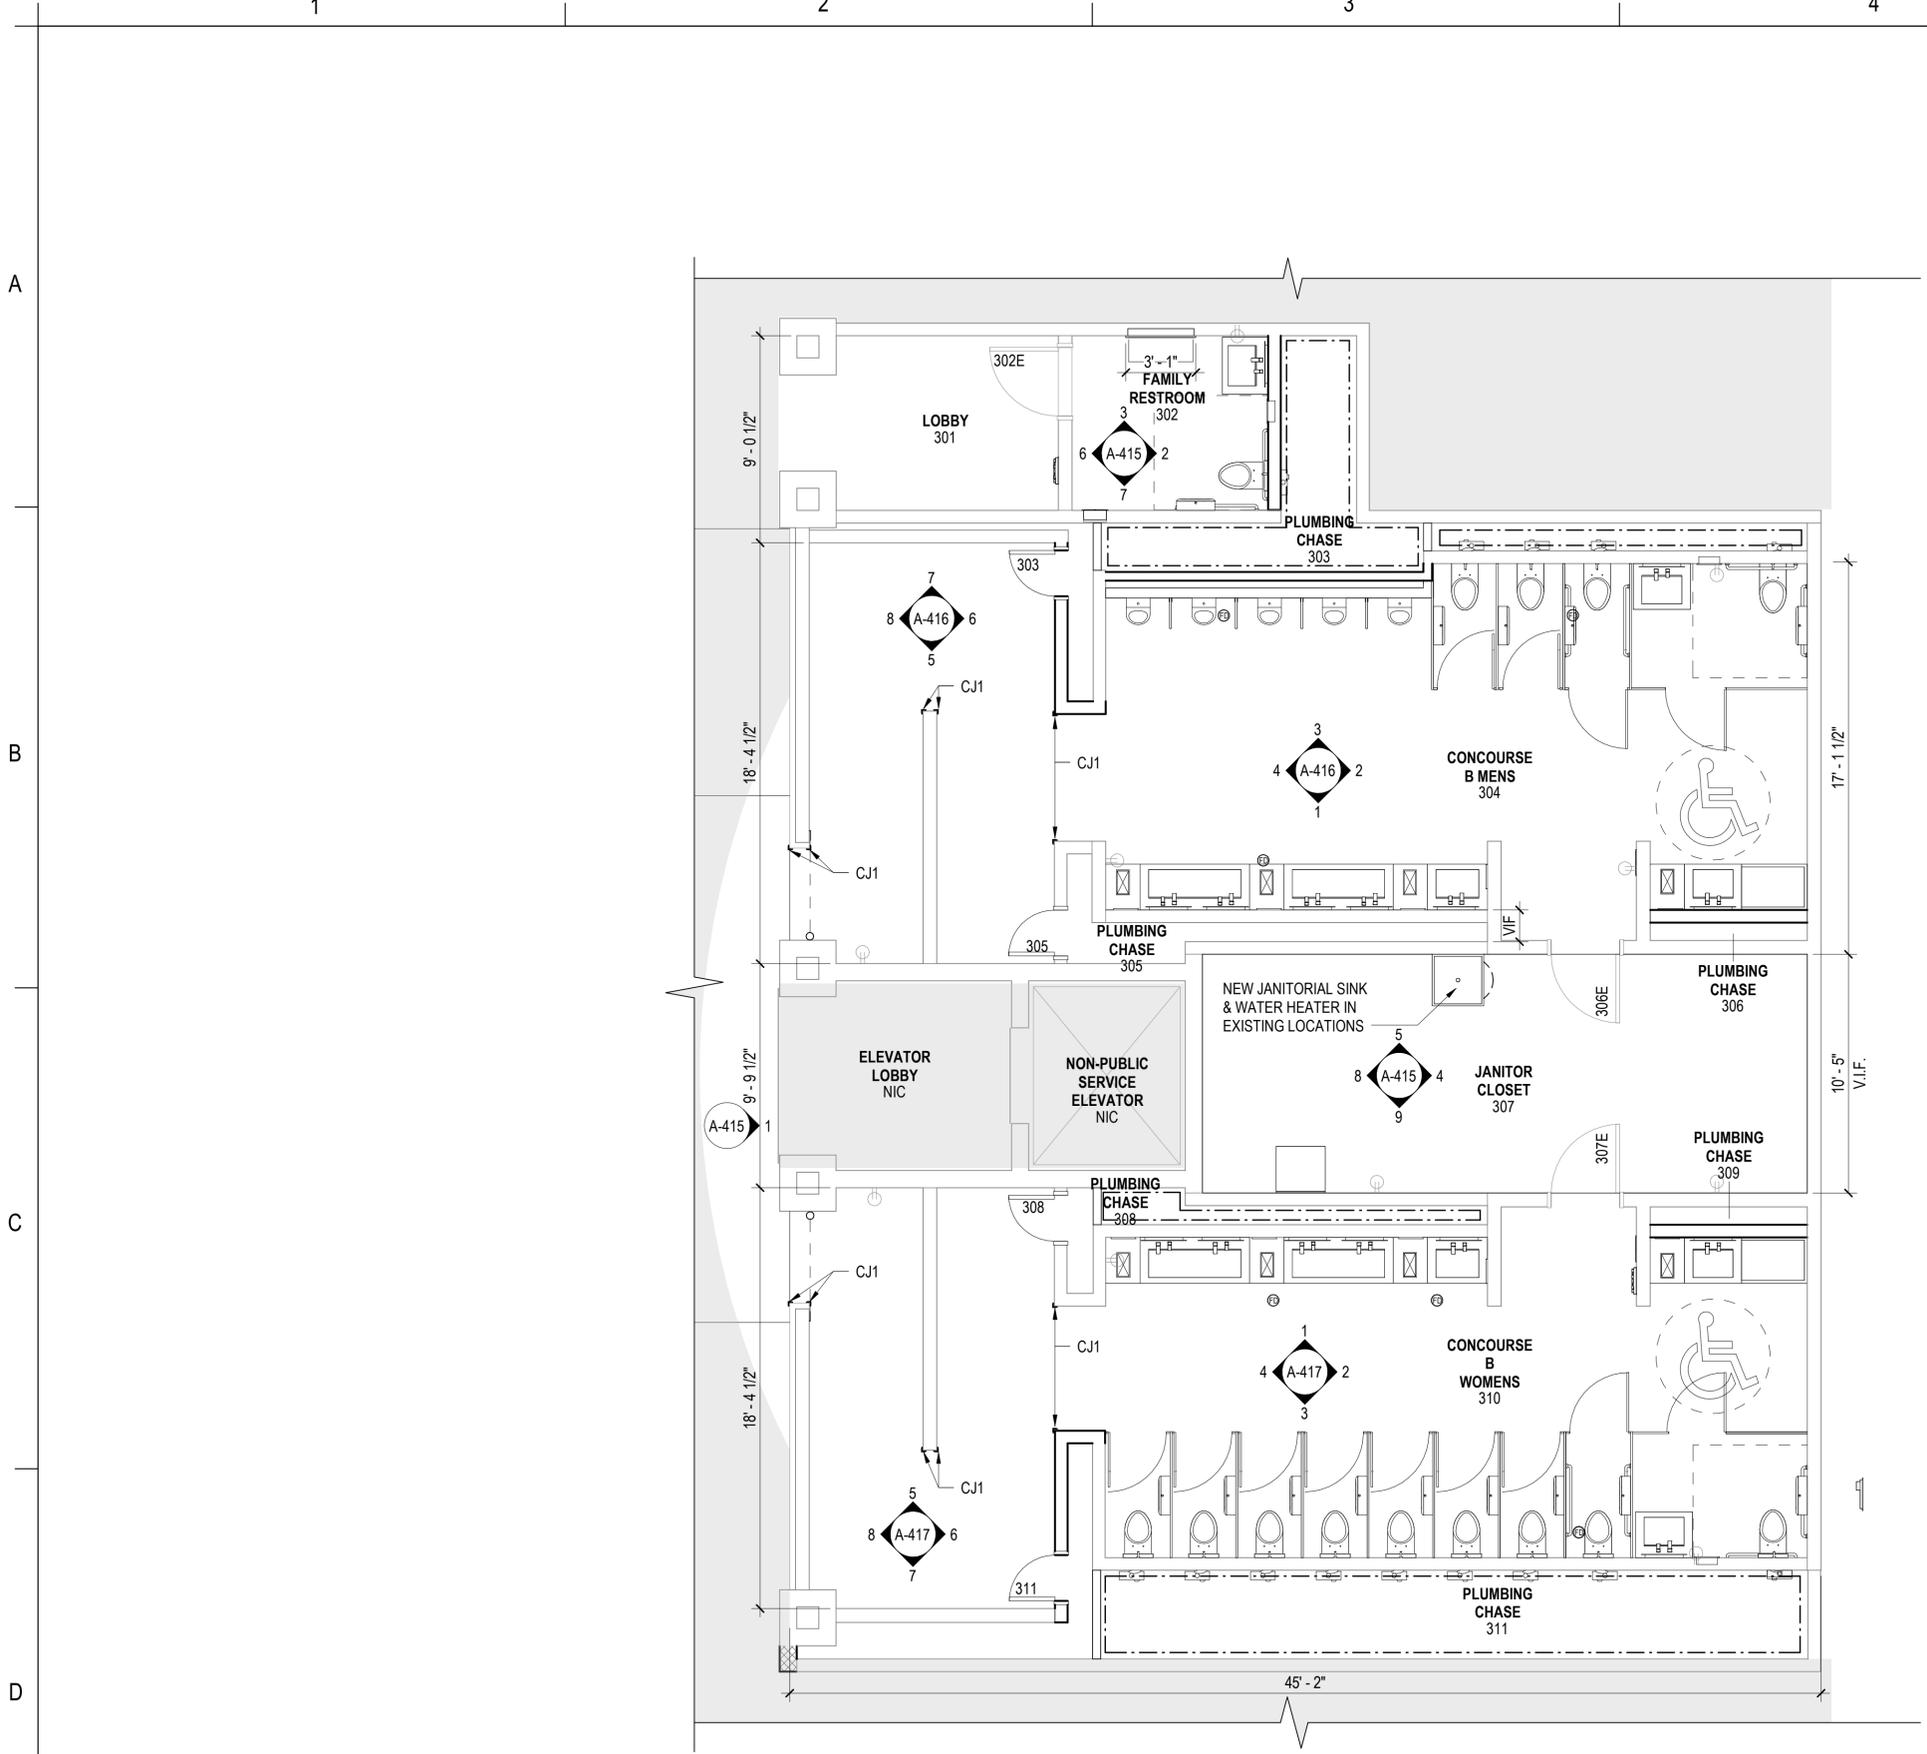

1 CONCOURSE 'B' RESTROOMS FLOOR PLAN
SCALE: 1/4" = 1'-0"

- NOTES - FLOOR PLANS**
- REFER TO A-000 SERIES FOR PARTITION TYPES
 - REFER TO ENLARGED PLANS AND INTERIOR ELEVATIONS FOR ADDITIONAL INFORMATION
 - REFER TO MECHANICAL, ELECTRICAL SHEETS FOR EQUIPMENT LOCATIONS AND REQUIREMENTS.
 - ALL DIMENSIONS SHOWN ARE TO FACE OF WALL (LEFT TO RIGHT, BOTTOM TO TOP)- TYPICAL UNLESS NOTED OTHERWISE
 - ALL DOORS TO BE INSTALLED 4" FROM HINGE SIDE OF WALL - TYPICAL UNLESS NOTED OR DIMENSIONED OTHERWISE
 - DIMENSIONS MARKED AS "CLEAR" DICTATES THE CLEAR DIMENSION FROM FINISH TO FINISH
 - WHERE FIRE RATED PARTITIONS INTERSECT WITH LESSER RATED PARTITIONS OR NON-RATED PARTITIONS, THE HIGHER RATED PARTITION IS TO CONTINUE THROUGH THE INTERSECTION TO MAINTAIN THE HIGHER RATING
 - FIRE EXTINGUISHERS SHALL BE PROVIDED AND LOCATED IN ACCORDANCE WITH NFPA 10. THE MAXIMUM TRAVEL DISTANCE TO THE NEAREST FIRE EXTINGUISHER FROM ANY POINT IN THE BUILDING SHALL NOT EXCEED 75 FEET.
 - REFER TO SHEET A-001 FOR ARCHITECTURAL GENERAL NOTES, & ANNOTATION LEGEND



INFRASTRUCTURE
CONSULTING & ENGINEERING
ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:
Designed by: **KGL**
Drawn by: **JCL**
Checked by: **EL**
Project Number: **24-201.01**



Notes:

Scale Graphic:
0 2'-0" 4'-0" 8'-0"
SCALE: 1/4" = 1'-0"

REVISIONS		
No.	Description	Date

- LEGEND**
- EXISTING WALL TO REMAIN
 - NEW STONE SHELF
 - NEW FRAMED WALL
 - TOILET PARTITION / URINAL SCREEN
 - MURAL
 - CEMENT BOARD CURB & WP. MEMBRANE FLASHING
 - FULL HEIGHT MIRROR
 - WALL TYPE TAG
 - FLOOR DRAIN
 - FIRE EXTINGUISHER
 - STEEL COLUMN (SEE STRUCTURAL)
 - TRASH BIN BELOW COUNTER
 - WP. MEMBRANE FLASHING AT GWB STUD AND TRACK
 - NIC (NOT IN CONTRACT)

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
PROPOSED FLOOR PLAN - CONCOURSE 'B'

Date: **09-19-2025** Sheet Number: **A-102**
Scale: **1/4" = 1'-0"** Drawing Number: **24-201.01**

NOTES - RCP

- 1 ALL ELEVATIONS ARE ABOVE FINISHED FLOOR.
- 2 REFER TO ELECTRICAL DRAWINGS FOR POWER AND LIGHTING INFORMATION
- 3 REFER TO MECHANICAL DRAWINGS FOR VENTILATION AND HEATING VENTILATION AND AIR CONDITIONING INFORMATION
- 4 ALL CEILING GRIDS TO BE CENTERED IN ROOMS - TYPICAL UNLESS NOTED OR DIMENSIONED OTHERWISE
- 5 LIGHT FIXTURES IN PLASTER CEILINGS SHALL BE CENTERED IN ROOMS - TYPICAL UNLESS NOTED OTHERWISE
- 6 ALL EXPOSED DUCTWORK, PIPES, CONDUIT AND STRUCTURE SHALL BE CLEAN AND FREE OF ANY MANUFACTURER OR CONSTRUCTION DEFECTS
- 7 THE SUSPENDED CEILING SYSTEM, MECHANICAL DUCTWORK AND LIGHTING FIXTURES SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE ABOVE


RCP LEGEND

- PAINTED GYPSUM WALLBOARD CEILING
- OPEN CEILING EXPOSED STRUCTURE
- RECESSED LIGHTING SOFFIT
- MECHANICAL DIFFUSER, SEE MECHANICAL
- MECHANICAL GRILLE, SEE MECHANICAL
- LIGHTING, SEE ELECTRICAL
- LIGHTING FIXTURES, SEE ELECTRICAL
- RECESSED SPEAKER, SEE ELECTRICAL
- CHANGE IN CEILING HEIGHT
- RECESSED FIRE SPRINKLERHEAD W/ COVER, SEE FIRE PROTECTION



INFRASTRUCTURE
CONSULTING & ENGINEERING
ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant	
Designed by:	KCL
Drawn by:	JCL
Checked by:	EL
Project Number:	24-201.01
Notes:	

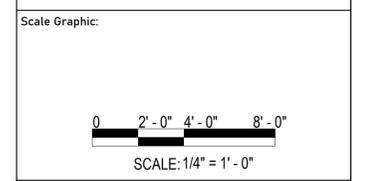

REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT
WALTON BEACH
AIRPORT**

Drawing Name:
**REFLECTED CEILING PLAN -
1ST FLOOR**


Date: 09-19-2025
Scale: As indicated

Sheet Number:
AR-111


Drawing Number:
24-201.01

© ICE-ENG 2025


A
B
C
D

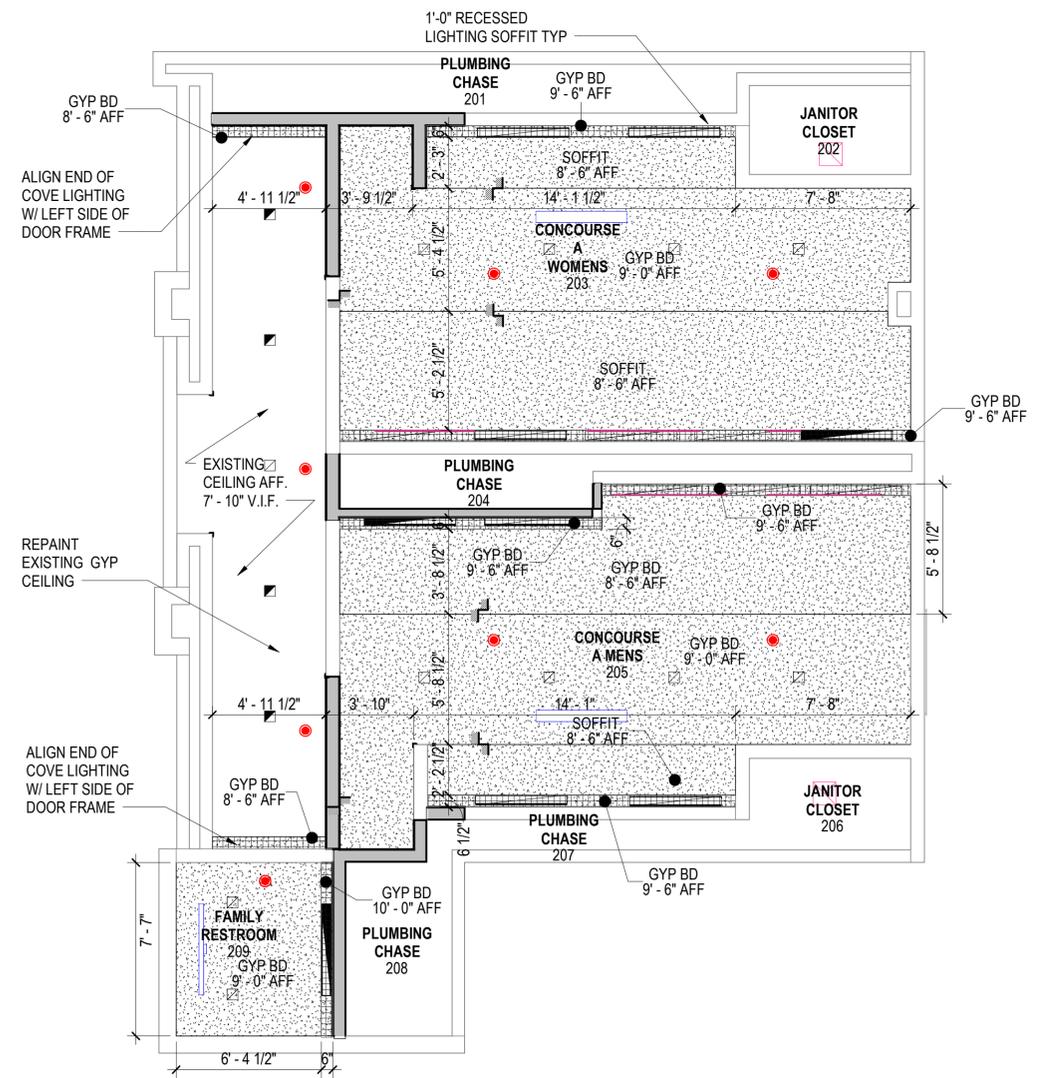

2 CONCOURSE 'A' REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

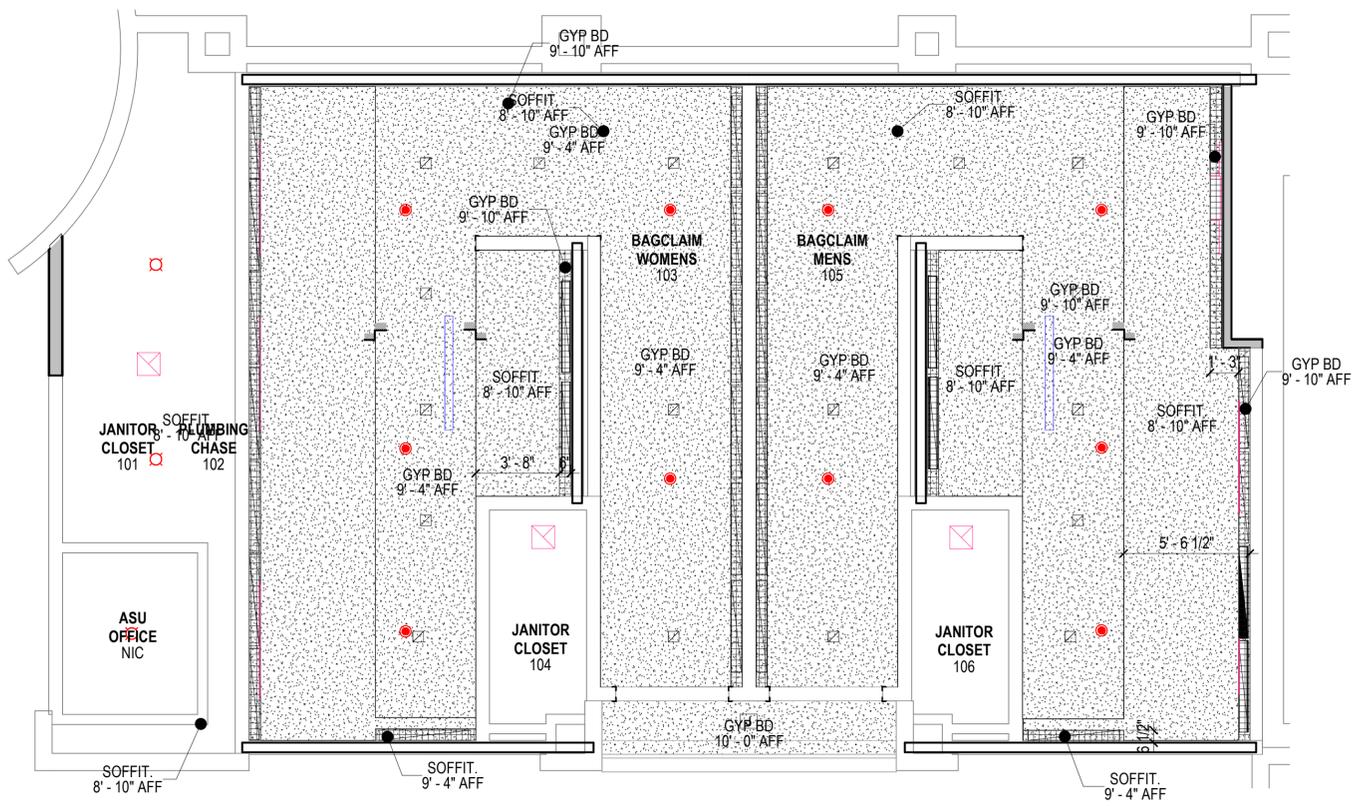

1 BAGCLAIM REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

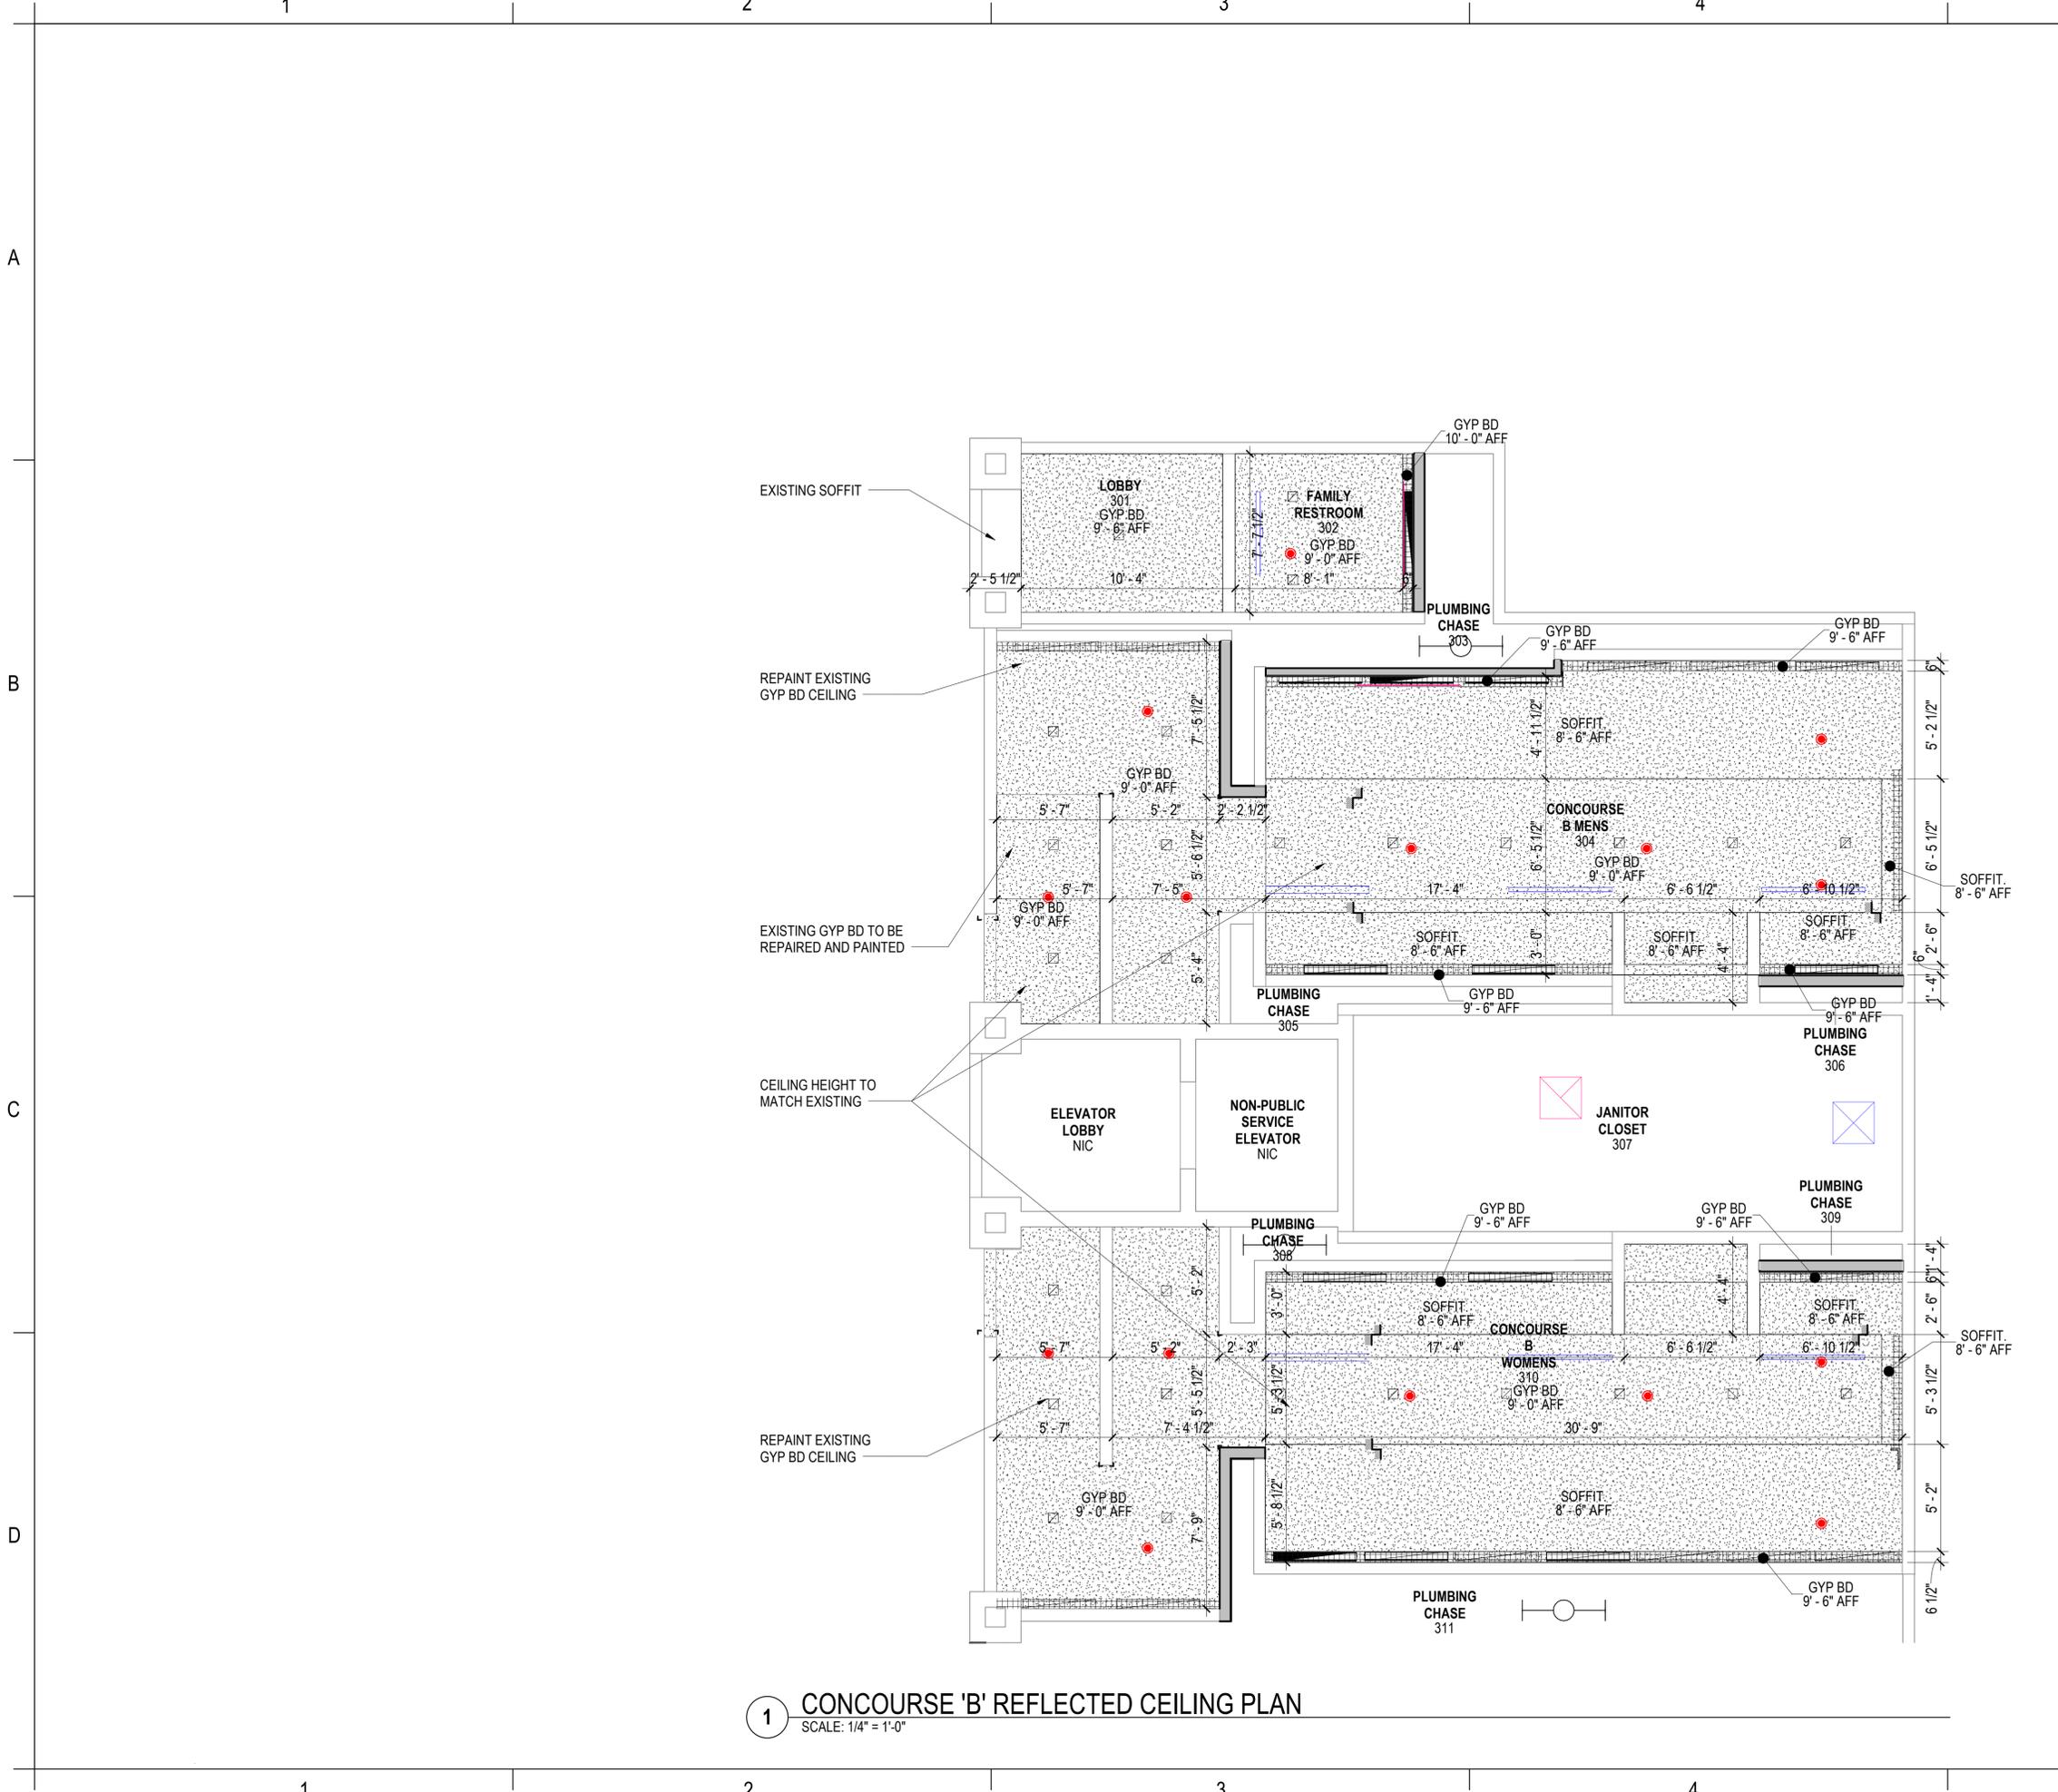

1 CONCOURSE 'B' REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

NOTES - RCP

- 1 ALL ELEVATIONS ARE ABOVE FINISHED FLOOR.
- 2 REFER TO ELECTRICAL DRAWINGS FOR POWER AND LIGHTING INFORMATION
- 3 REFER TO MECHANICAL DRAWINGS FOR VENTILATION AND HEATING VENTILATION AND AIR CONDITIONING INFORMATION
- 4 ALL CEILING GRIDS TO BE CENTERED IN ROOMS - TYPICAL UNLESS NOTED OR DIMENSIONED OTHERWISE
- 5 LIGHT FIXTURES IN PLASTER CEILINGS SHALL BE CENTERED IN ROOMS - TYPICAL UNLESS NOTED OTHERWISE
- 6 ALL EXPOSED DUCTWORK, PIPES, CONDUIT AND STRUCTURE SHALL BE CLEAN AND FREE OF ANY MANUFACTURER OR CONSTRUCTION DEFECTS
- 7 THE SUSPENDED CEILING SYSTEM, MECHANICAL DUCTWORK AND LIGHTING FIXTURES SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE ABOVE

KEYNOTES

RCP LEGEND

- PAINTED GYPSUM WALLBOARD CEILING
- OPEN CEILING EXPOSED STRUCTURE
- RECESSED LIGHTING SOFFIT
- MECHANICAL DIFFUSER, SEE MECHANICAL
- MECHANICAL GRILLE, SEE MECHANICAL
- LIGHTING, SEE ELECTRICAL
- LIGHTING FIXTURES, SEE ELECTRICAL
- RECESSED SPEAKER, SEE ELECTRICAL
- CHANGE IN CEILING HEIGHT
- RECESSED FIRE SPRINKLERHEAD W/ COVER, SEE FIRE PROTECTION




INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:	
Designed by:	KCL
Drawn by:	JCL
Checked by:	EL
Project Number:	24-201.01
Notes:	

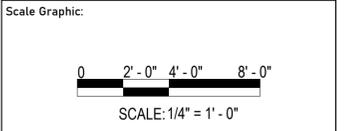

REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT
WALTON BEACH
AIRPORT**

Drawing Name: REFLECTED CEILING PLAN - 2ND FLOOR	
Date: 09-19-2025	Sheet Number: AR-112
Scale: As indicated	Drawing Number: 24-201.01



INFRASTRUCTURE
CONSULTING & ENGINEERING


ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:	
Designed by:	KCL
Drawn by:	JCL
Checked by:	EL
Project Number:	24-201.01



Notes:

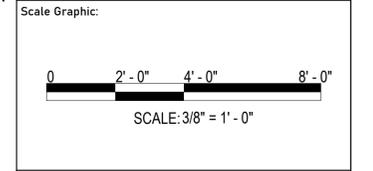


REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT
WALTON BEACH
AIRPORT**

Drawing Name:
**ENLARGED FLOOR PLAN -
BAGCLAIM**

Date:	09-19-2025	Sheet Number:	A-401
Scale:	3/8" = 1'-0"	Drawing Number:	24-201.01

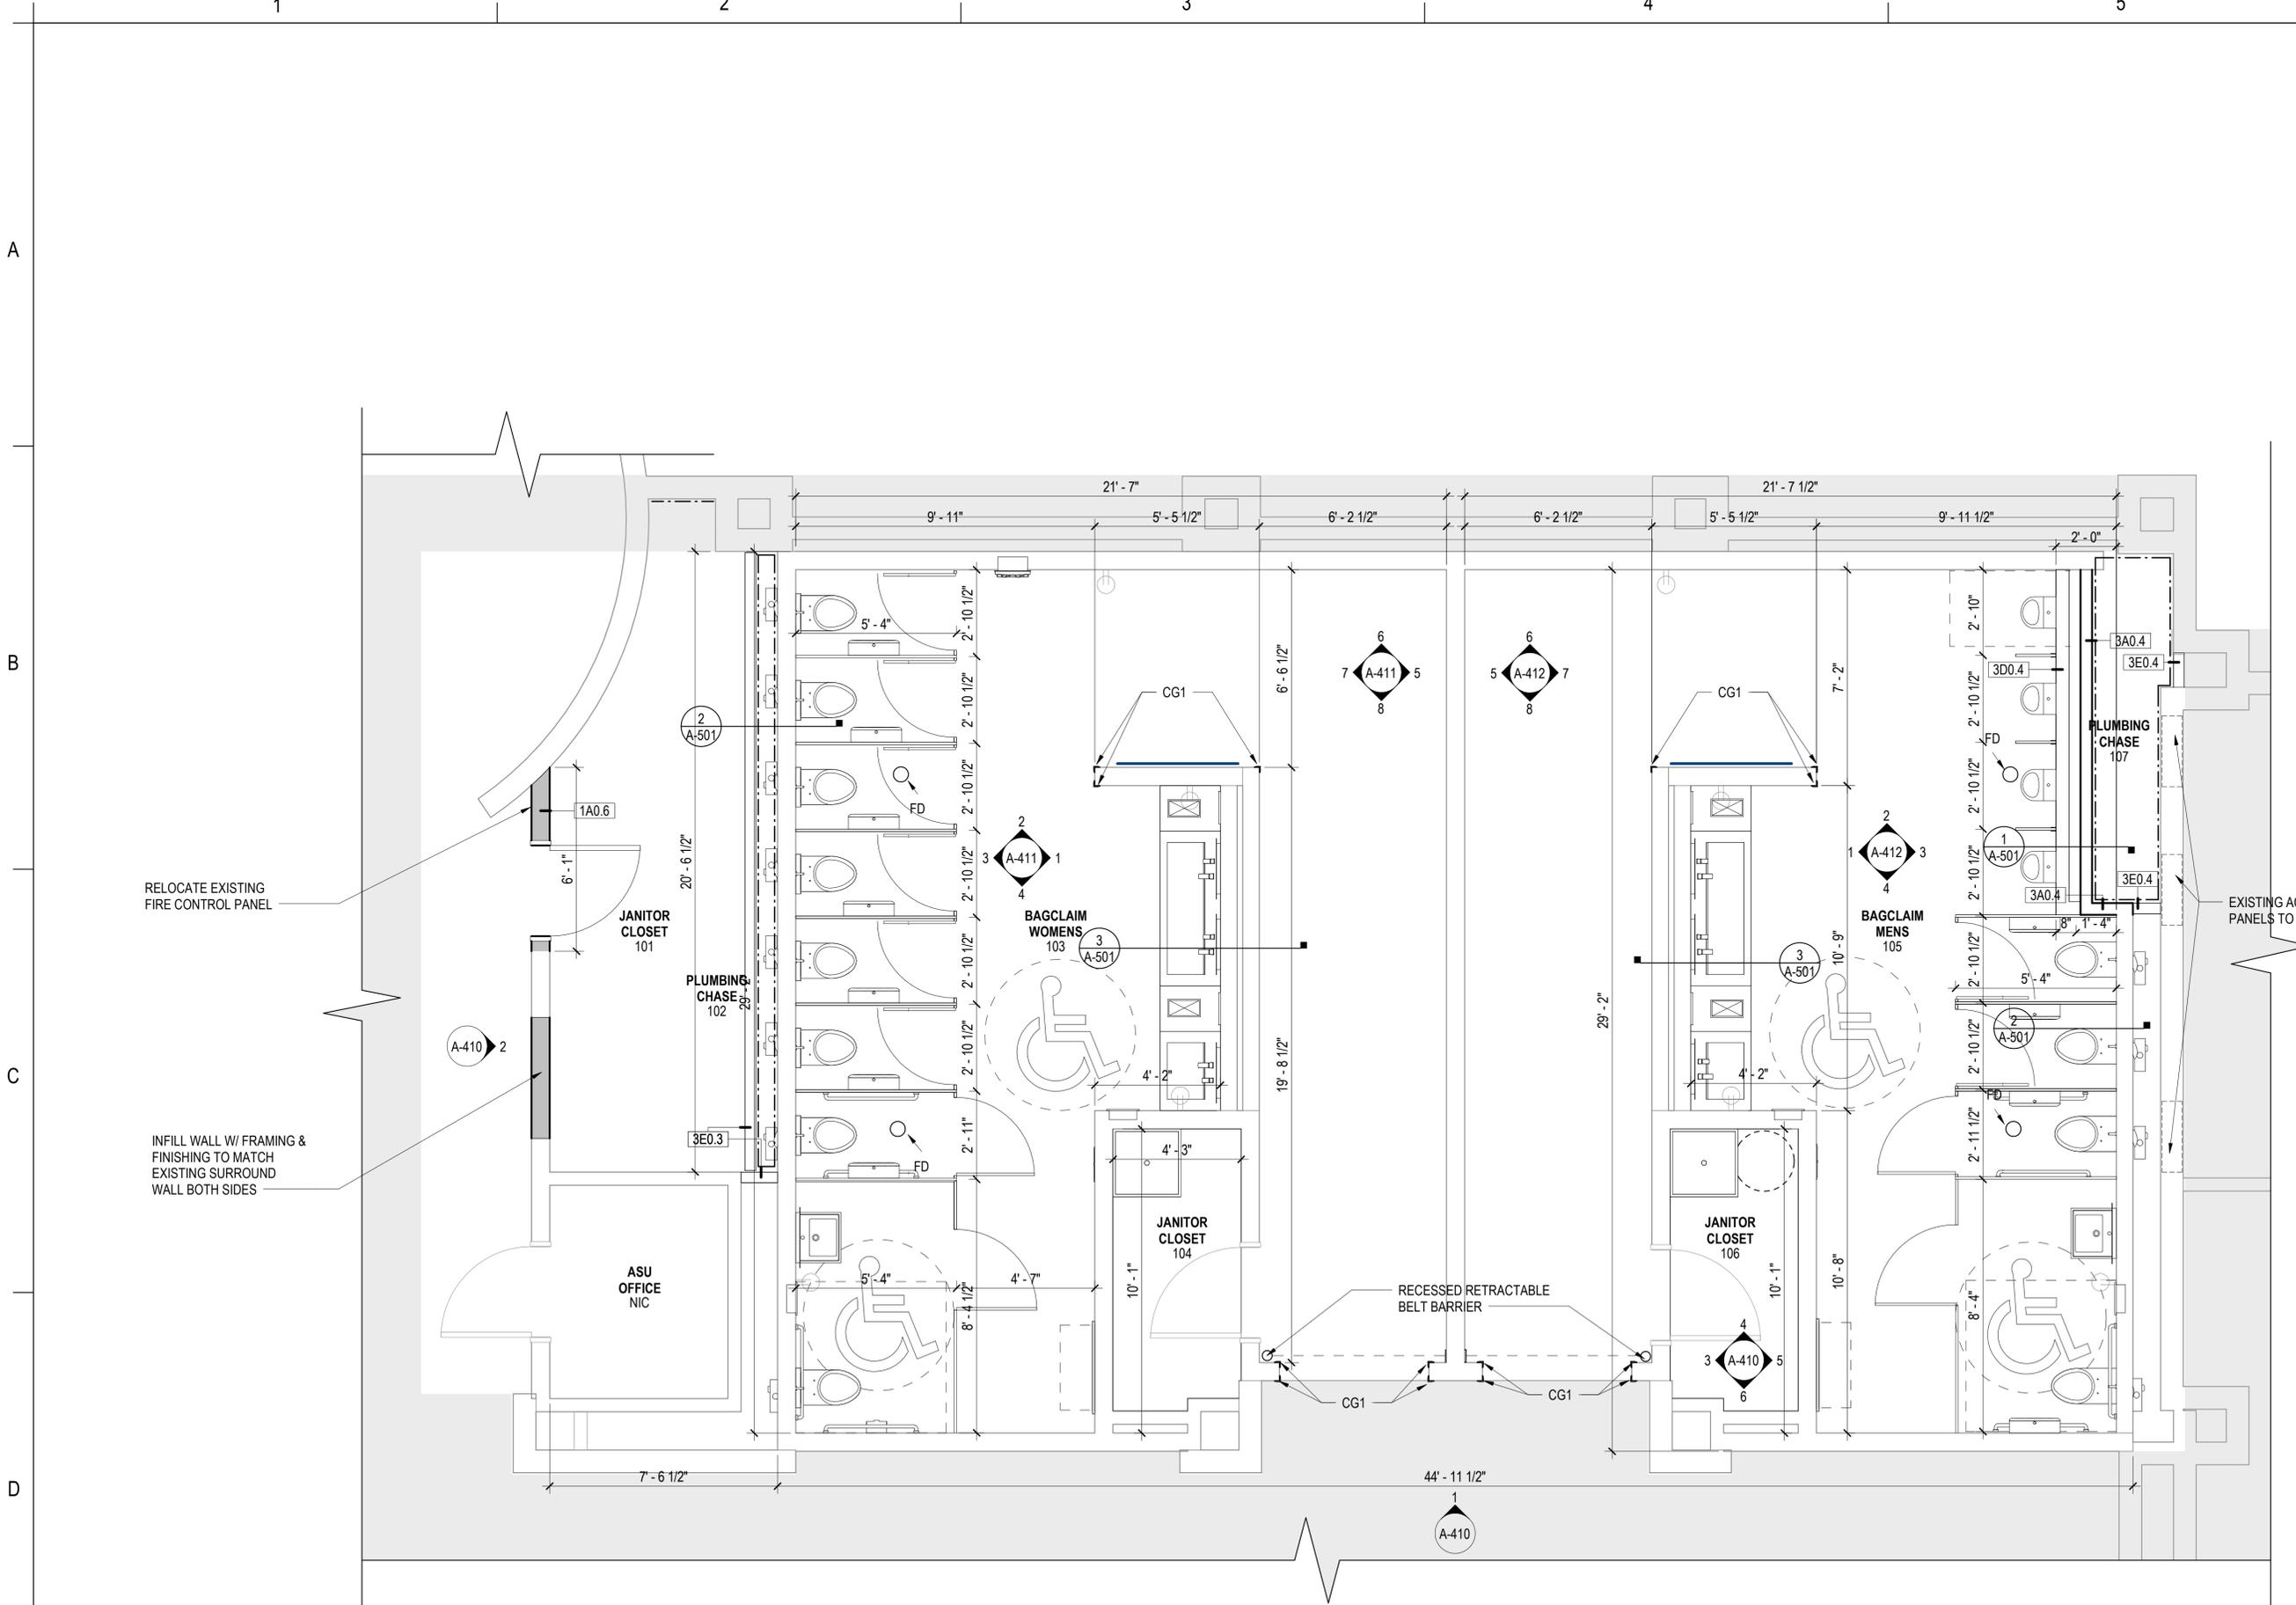

1 ENLARGED BAGCLAIM FLOOR PLAN
SCALE: 3/8" = 1'-0"



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:

Designed by: **KGL**

Drawn by: **JCL**


Checked by: **EL**

Project Number:
24-201.01



Notes:

Scale Graphic:



REVISIONS

No.	Description	Date

Project Name:

**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:


ENLARGED FLOOR PLAN - CONCOURSE 'A'

Date: **09-19-2025**

Sheet Number:
A-402


Scale:
3/8" = 1'-0"

Drawing Number:
24-201.01

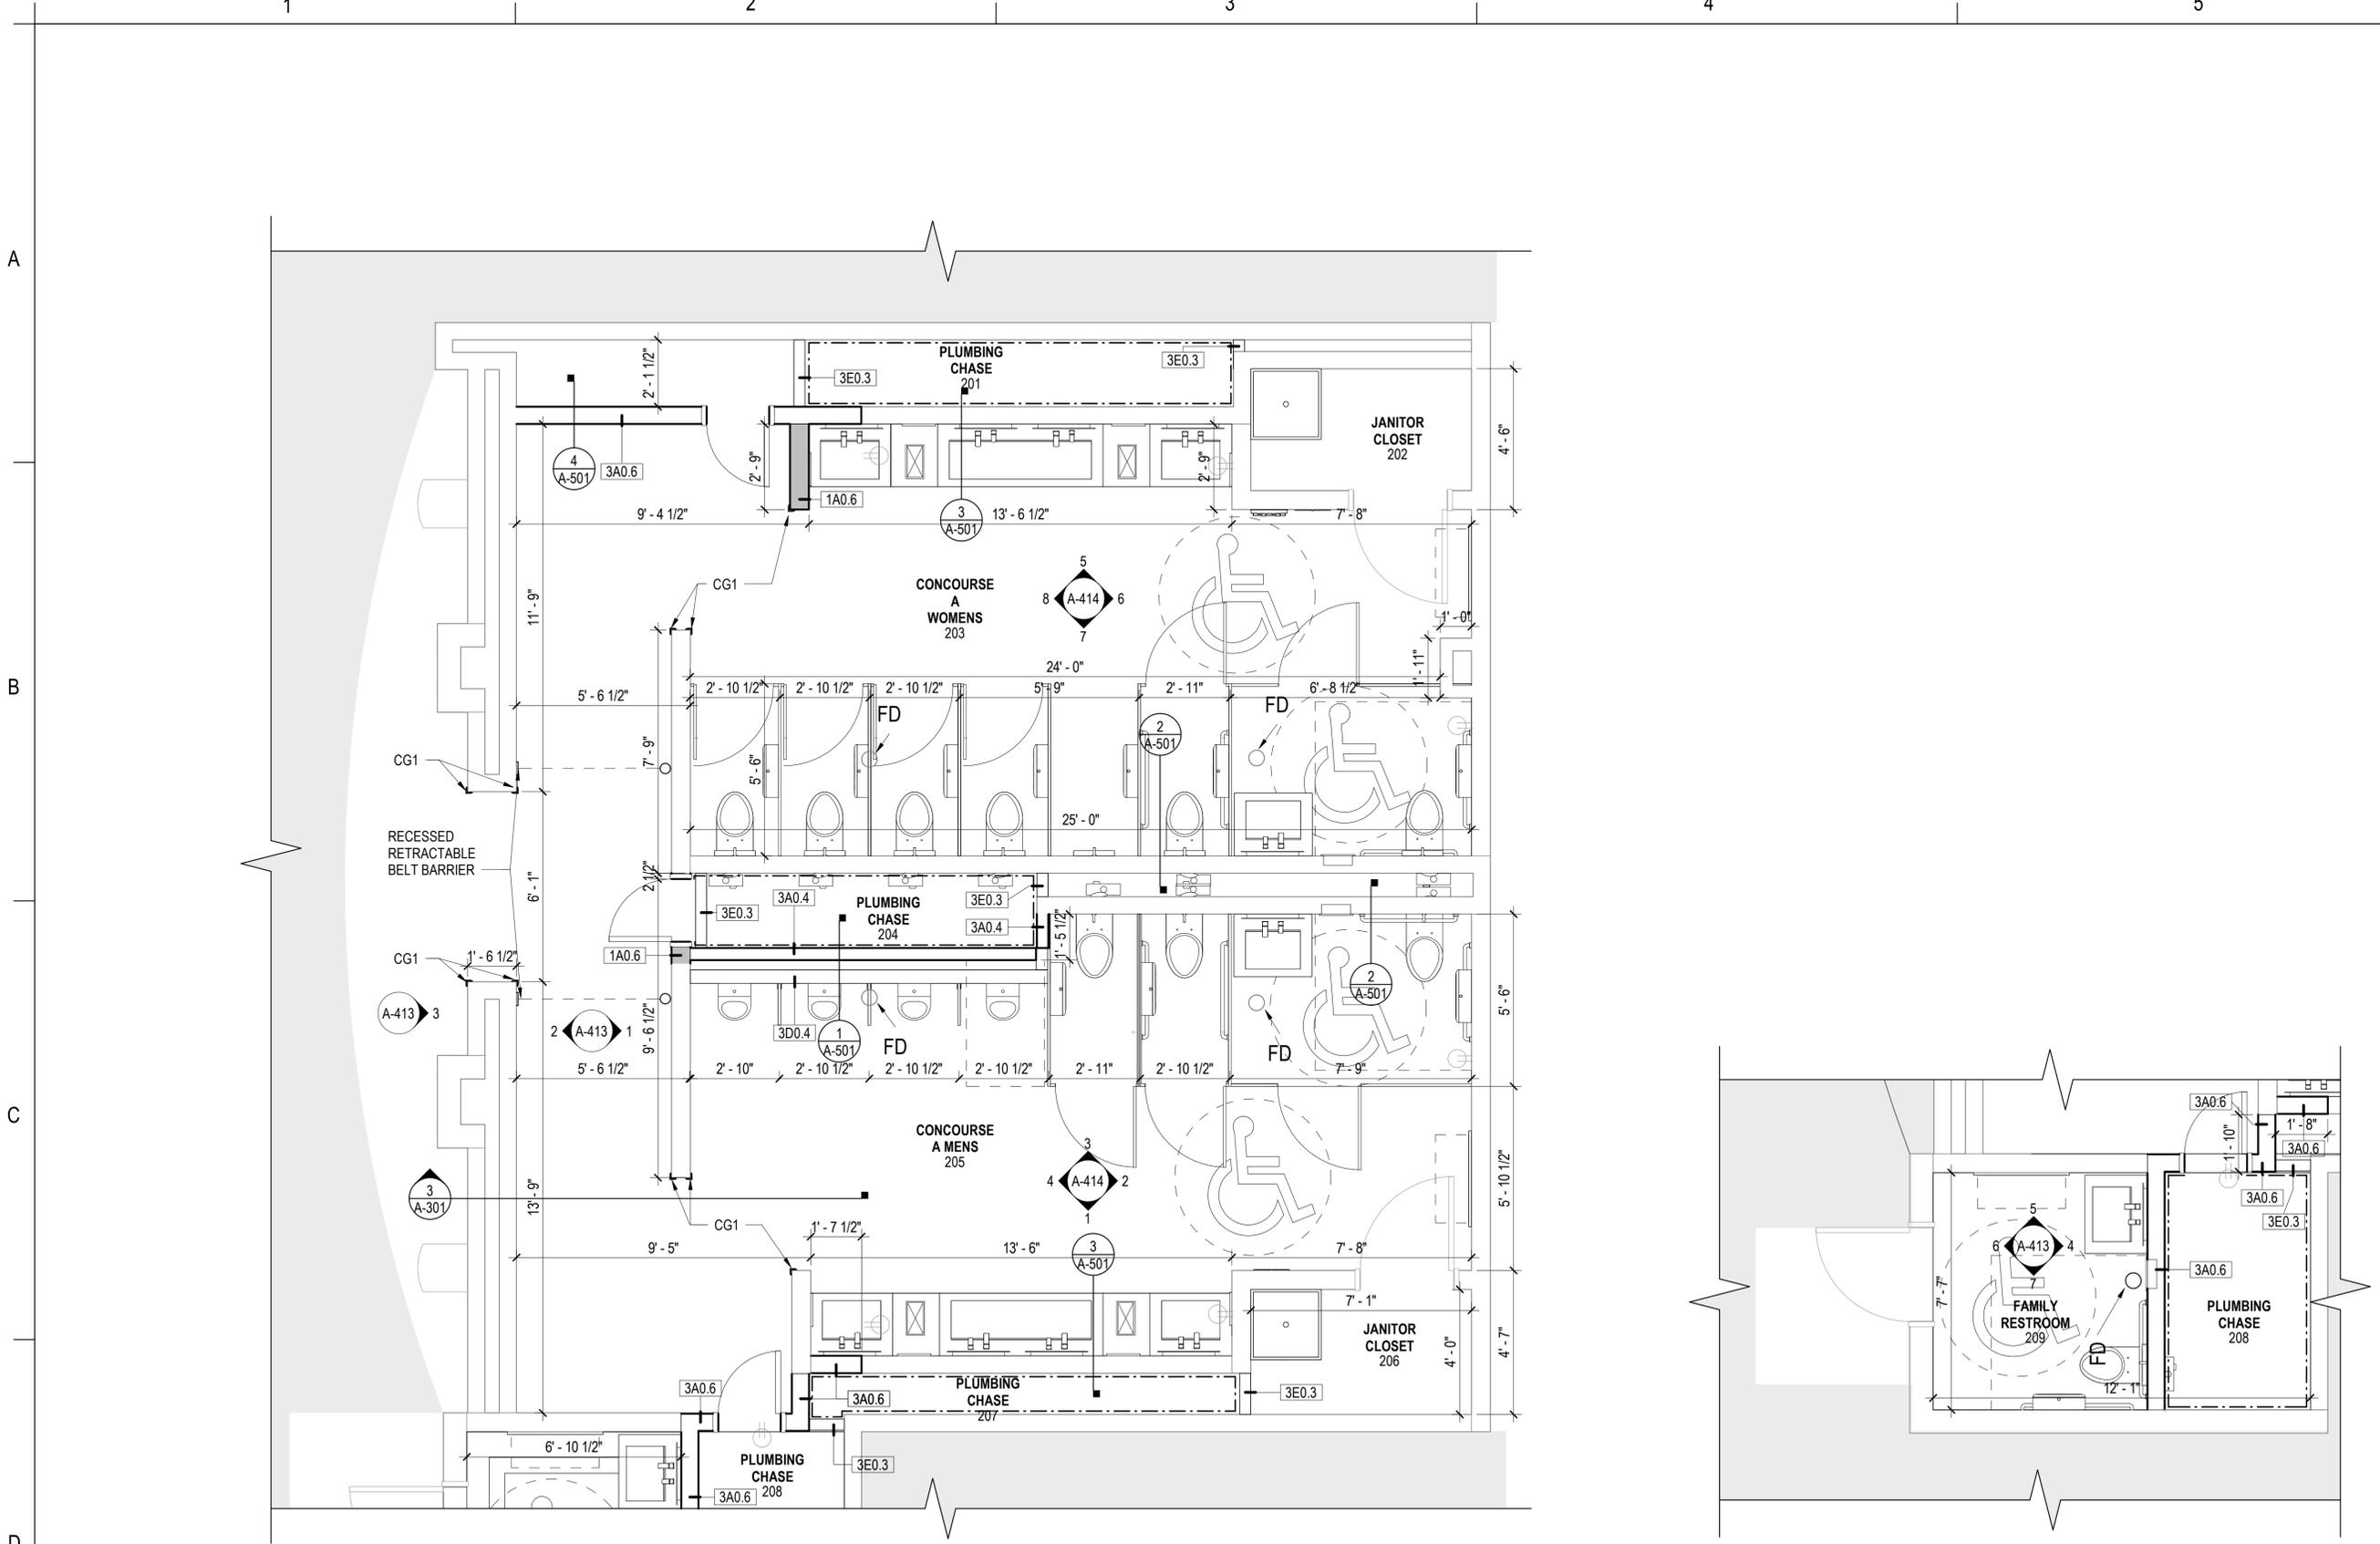


1 ENLARGED 'A' FLOOR PLAN
SCALE: 3/8" = 1'-0"


2 ENLARGED 'A' FAMILY FLOOR PLAN
SCALE: 3/8" = 1'-0"

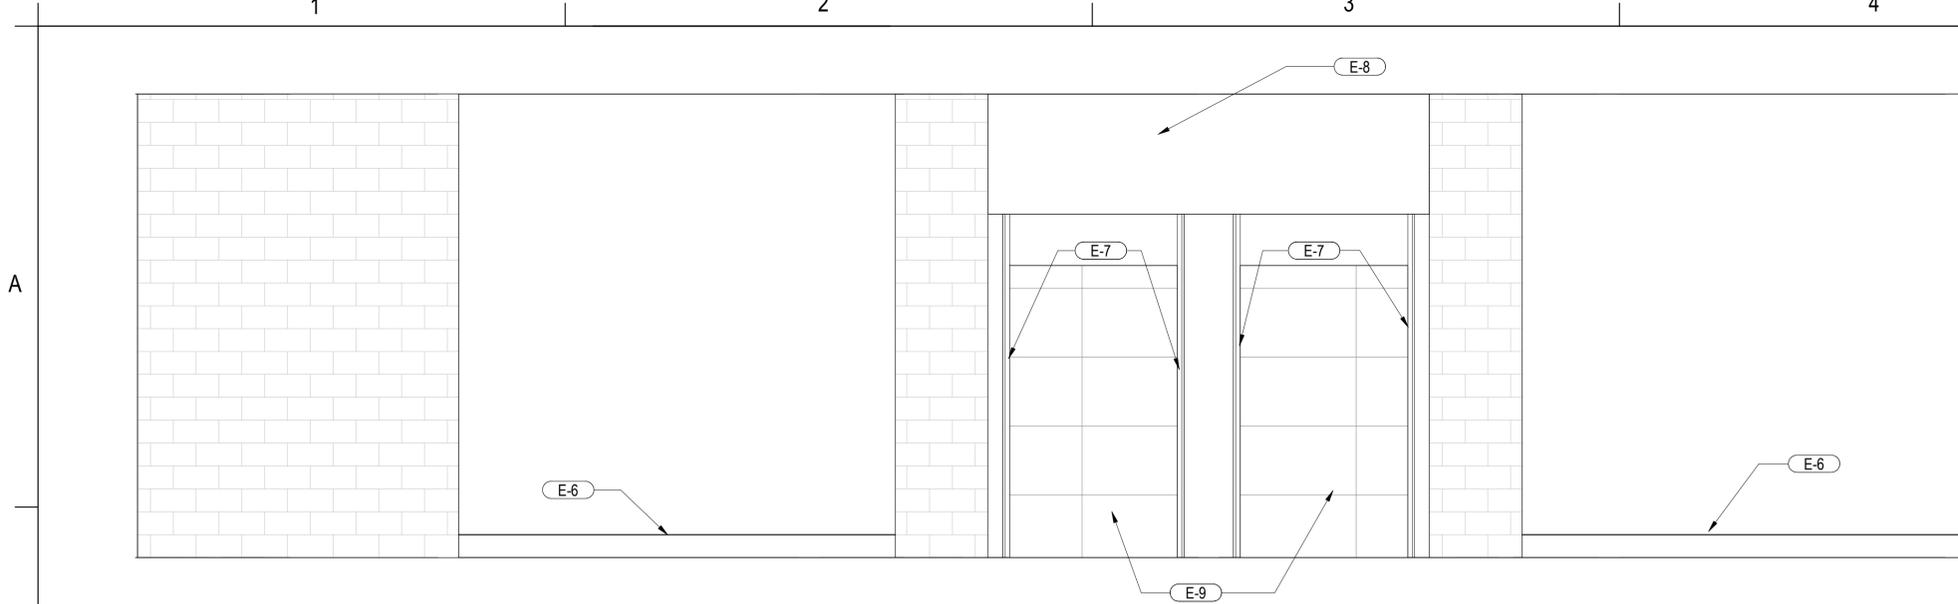


1 BAGCLAIM ENTRANCE
SCALE: 3/8" = 1'-0"

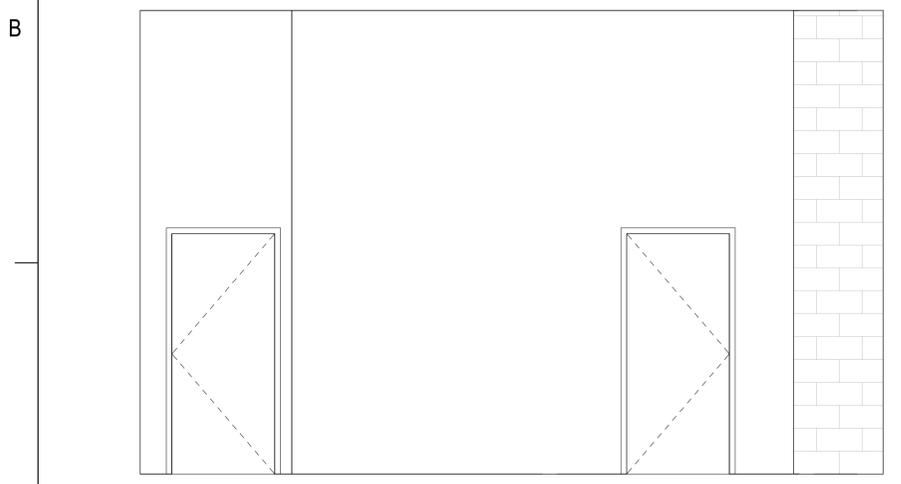


2 BAGCLAIM SUPPORT ROOMS
SCALE: 3/8" = 1'-0"

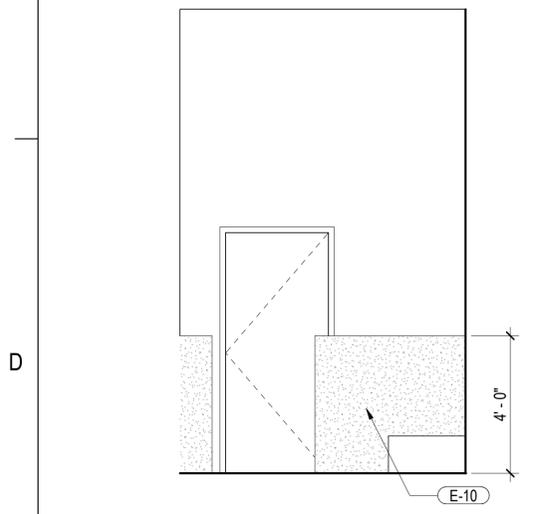


3 BAGCLAIM JANITOR CLOSET 1
SCALE: 3/8" = 1'-0"

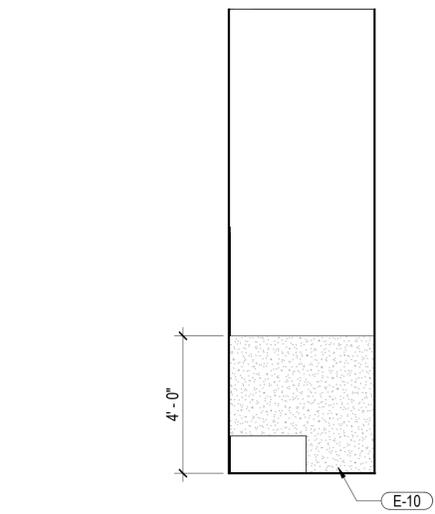

4 BAGCLAIM JANITOR CLOSET 2
SCALE: 3/8" = 1'-0"

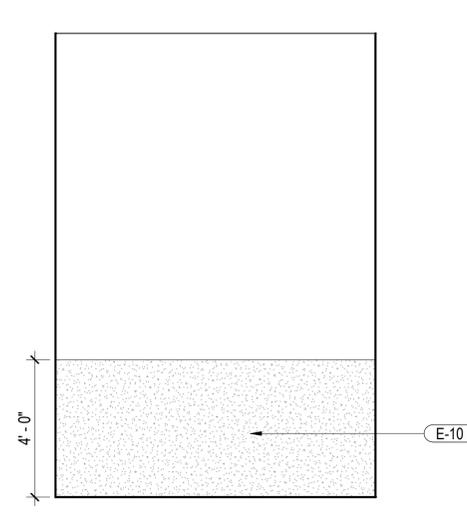


5 BAGCLAIM JANITOR CLOSET 3
SCALE: 3/8" = 1'-0"

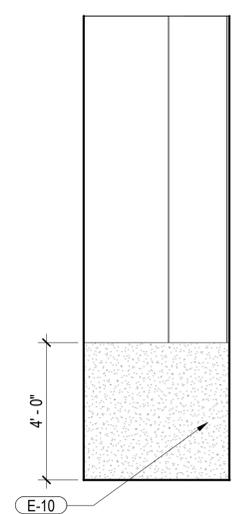


6 BAGCLAIM JANITOR CLOSET 4
SCALE: 3/8" = 1'-0"

- NOTES - INTERIOR ELEVATIONS**
- SEE TECHNICAL SPECIFICATIONS & INTERIOR FINISH DRAWINGS FOR INTERIOR FINISH INFORMATION.
 - FLOORING TRANSITIONS ARE TO BE COORDINATED WITH SELECTED PRODUCTS AND INSTALL PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE BARRIER FREE TRANSITIONS AT ALL FLOOR CHANGES. SEE TRANSITION DETAILS, SHEET A-510, FOR MORE INFORMATION.
 - REFER TO ARCHITECTURAL PLANS FOR STANDARD MOUNTING HEIGHTS OF BATHROOM ACCESSORIES AND FIXTURES, INCLUDING ADA STANDARDS.
 - ALL METAL GRILLS, DIFFUSERS, PANEL BOXES AND REGISTERS LOCATED WITHIN OCCUPIED AREAS ARE TO BE PAINTED TO MATCH THE ADJACENT WALL FINISH AS NOTED ON THE FINISH SCHEDULES AND DRAWINGS.
 - SEE SPECIFICATIONS SECTION 09 90 00 FOR PAINT SYSTEM REQUIREMENTS.
 - SEE ARCHITECTURAL DETAIL DRAWINGS FOR INTERIOR CASEWORK & ADDITIONAL FINISH CONSTRUCTION DETAILS.
 - REFER TO INTERIOR ELEVATION DRAWINGS FOR ACCENT WALL LOCATIONS / EXTENTS.
 - PAINTS ARE LOW OR NO VOC.
 - INTERIOR HOLLOW METAL DOORS AND / OR HOLLOW METAL FRAMES ARE PAINTED IN A SEMI-GLOSS FINISH. SEE MATERIAL & COLOR SCHEDULE FOR PAINT COLOR.
 - ALL CONTROL JOINTS TO MATCH THE COLOR OF THE ADJACENT FLOORING MATERIAL.
 - REFER TO ARCHITECTURAL REFLECTED CEILING PLANS, FOR CEILING HEIGHTS.
- KEYNOTES**
- E-6 NEW RUBBER BASE
 - E-7 CONTINUOUS 2X2 STAINLESS STEEL CORNER GUARD
 - E-8 FINISH AND PAINT DRYWALL ON THIS SIDE OF WALL
 - E-9 WALL TILE BEYOND
 - E-10 FIBRE REINFORCED PLASTIC

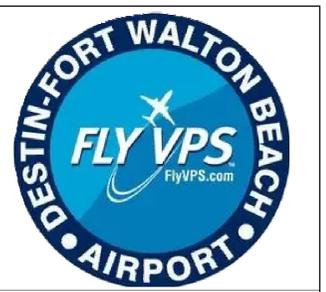

INFRASTRUCTURE
CONSULTING & ENGINEERING
ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:
Designed by: **KGL**
Drawn by: **JCL**
Checked by: **EL**
Project Number: **24-201.01**

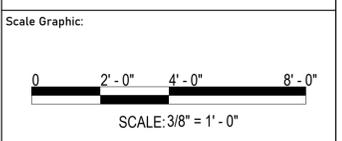

REVISIONS


No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
INTERIOR ELEVATIONS - BAGCLAIM FAMILY & ENTRANCE

Date: 09-19-2025
Scale: 3/8" = 1'-0"


Sheet: **A-410**
Drawing Number: 24-201.01

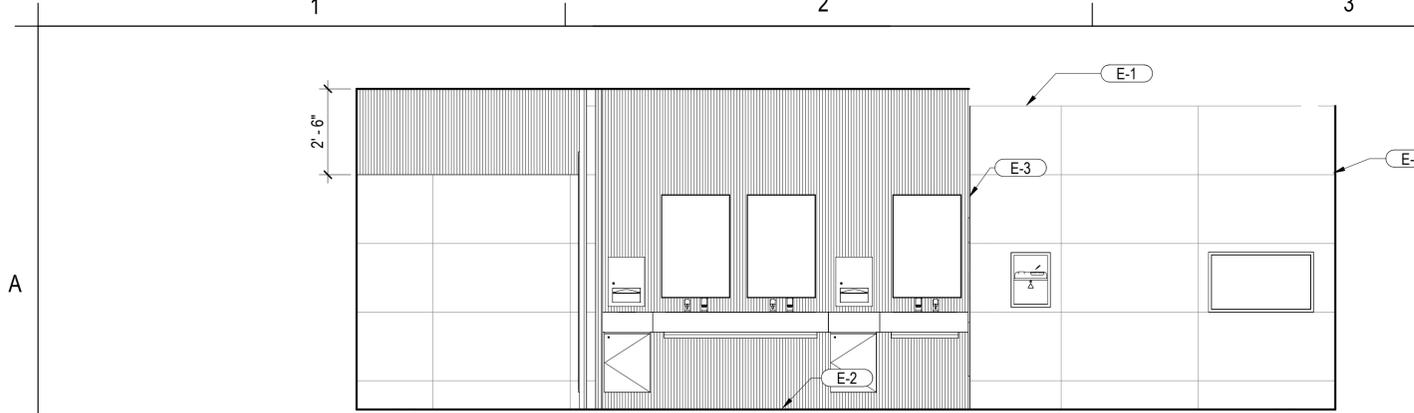


1 BAGCLAIM WOMENS 1
SCALE: 3/8" = 1'-0"




2 BAGCLAIM WOMENS 2
SCALE: 3/8" = 1'-0"

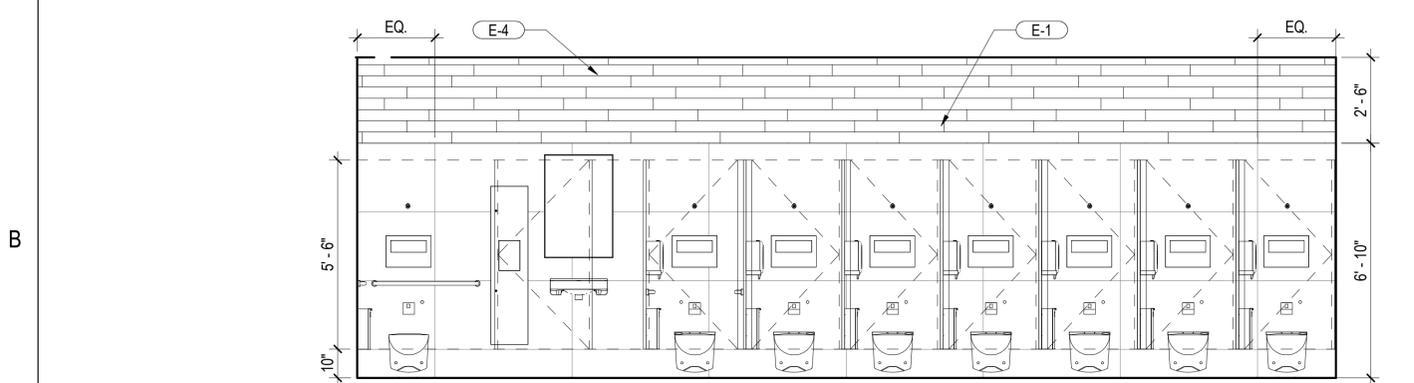


3 BAGCLAIM WOMENS 3
SCALE: 3/8" = 1'-0"

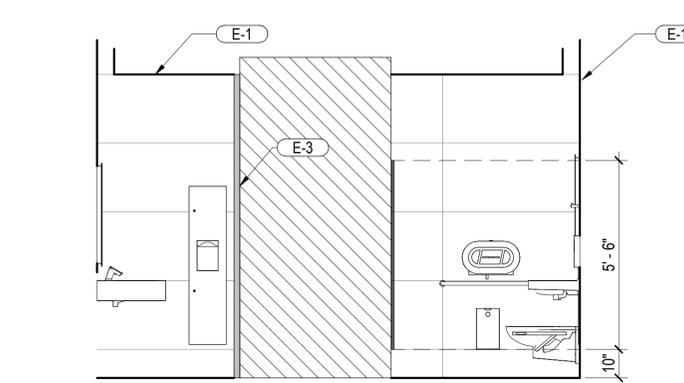


4 BAGCLAIM WOMENS 4
SCALE: 3/8" = 1'-0"

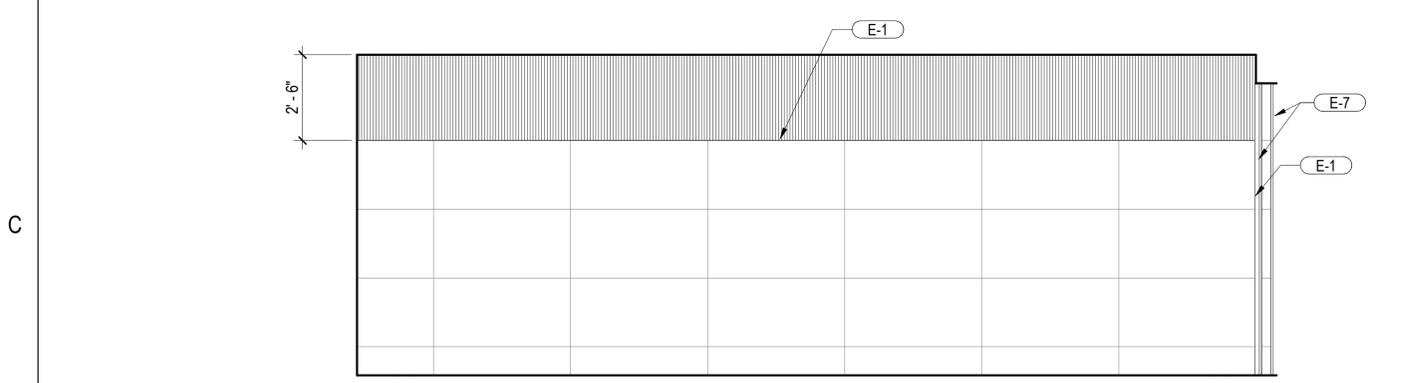


5 BAGCLAIM WOMENS 5
SCALE: 3/8" = 1'-0"

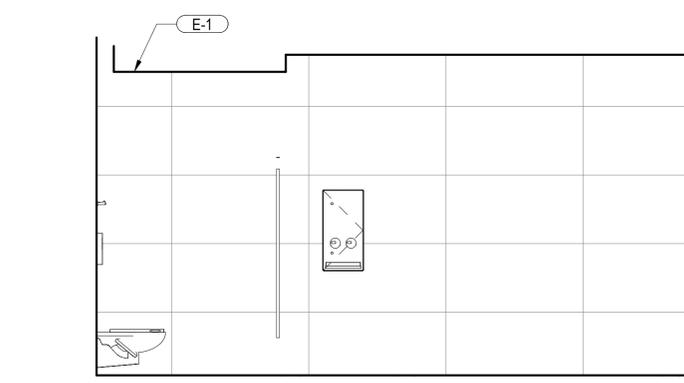

6 BAGCLAIM WOMENS 6
SCALE: 3/8" = 1'-0"

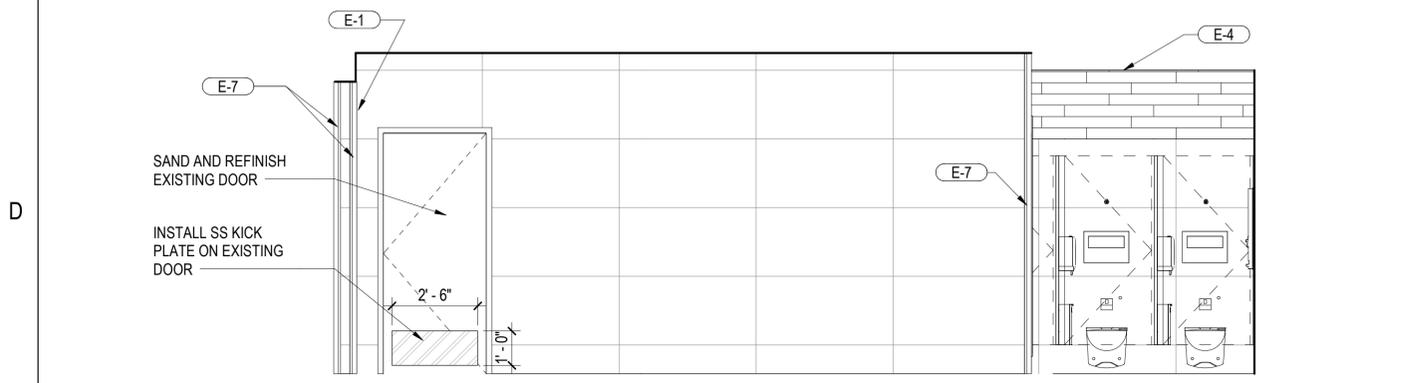

7 BAGCLAIM WOMENS 7
SCALE: 3/8" = 1'-0"

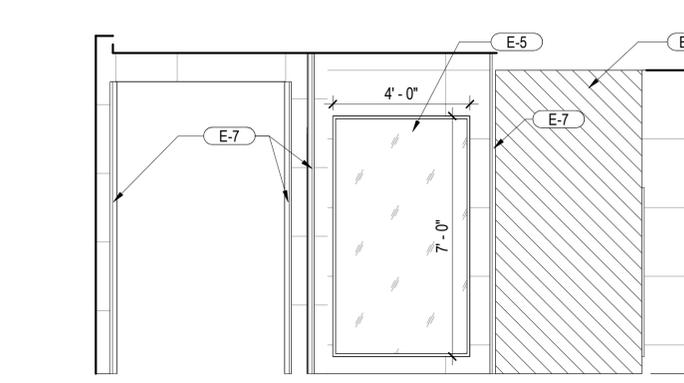

8 BAGCLAIM WOMENS 8
SCALE: 3/8" = 1'-0"

KEYNOTES

- E-1 START FULL-SIZE TILE AT THIS LOCATION
- E-2 CONTINUOUS STAINLESS STEEL COVE, TYP
- E-3 CONTINUOUS CORNER TRIM, TYP
- E-4 LINE OF SOFFIT
- E-5 BACKLIT FULL-SIZE MIRROR WITH FRAME
- E-7 CONTINUOUS 2X2 STAINLESS STEEL CORNER GUARD
- E-11 MURAL PICTURE

FINISH LEGEND

- TILE TYPE CT5
- TILE TYPE CT1 (FLOOR)
- TILE TYPE CT2 (FLOOR BAND)
- TILE TYPE CT3 (WALL)
- TILE TYPE CT4 (WALL MOSAIC)
- WATER PROOFING MEMBRANE SYSTEM WITH AGGREGATE FINISH (WP), REF. SPECIFICATION SECTION 07 12 10
- EXISTING TO REMAIN
- TOILET PARTITION / URINAL SCREEN
- GRAPHIC MURAL



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE


5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:

Designed by:	KGL
Drawn by:	JCL
Checked by:	EL
Project Number:	24-201.01



Notes:
REF. A-101

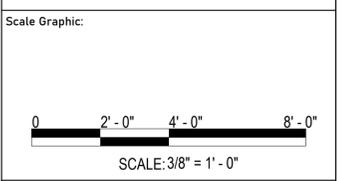


REVISIONS

No.	Description	Date


Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
INTERIOR ELEVATIONS - BAGCLAIM WOMENS


Date:	09-19-2025	Sheet Number:	A-411
Scale:	As indicated	Drawing Number:	24-201.01

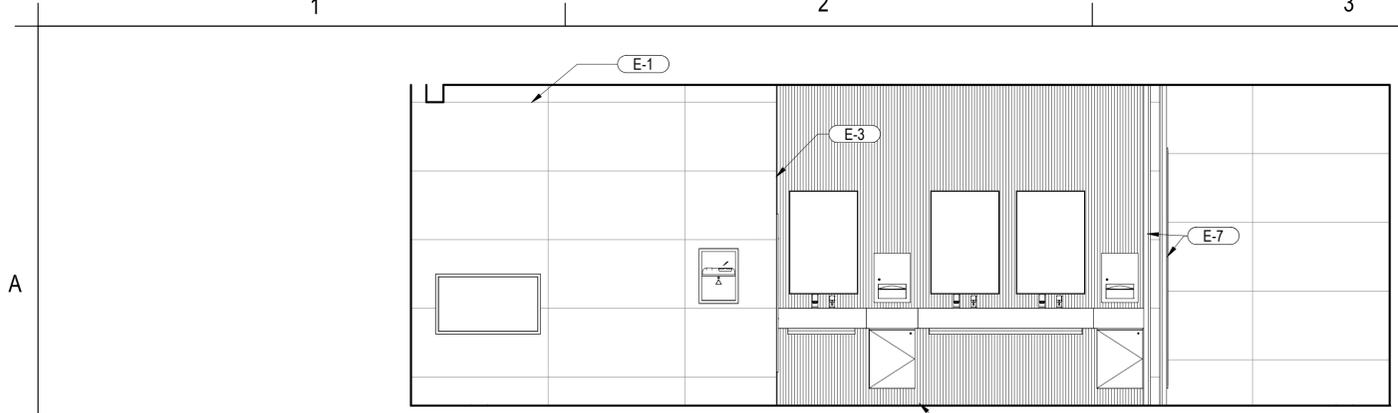


1 BAGCLAIM MENS 1
SCALE: 3/8" = 1'-0"

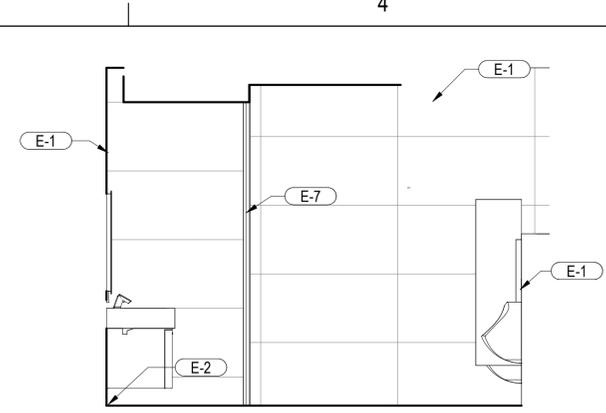


2 BAGCLAIM MENS 2
SCALE: 3/8" = 1'-0"

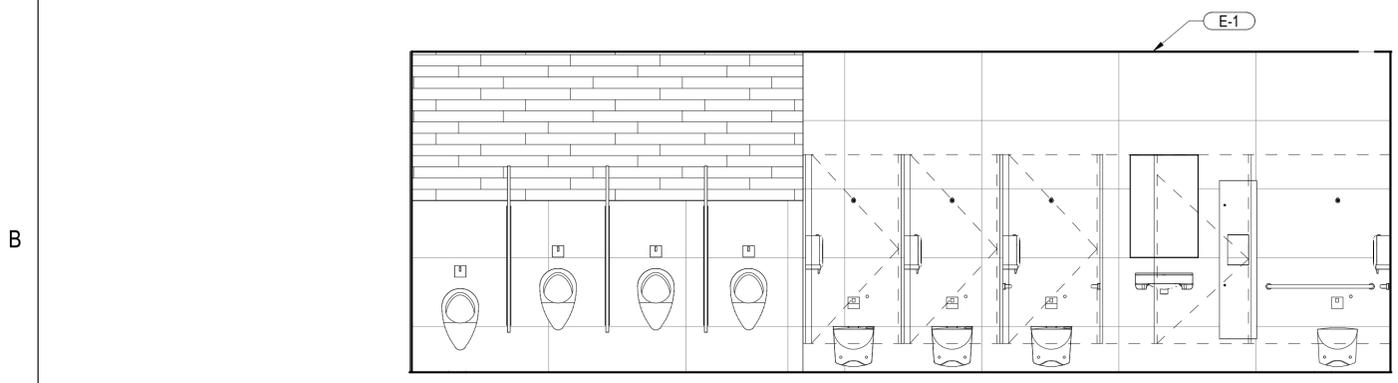


3 BAGCLAIM MENS 3
SCALE: 3/8" = 1'-0"

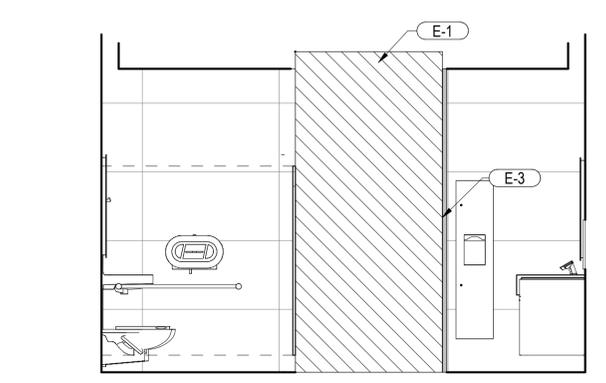


4 BAGCLAIM MENS 4
SCALE: 3/8" = 1'-0"

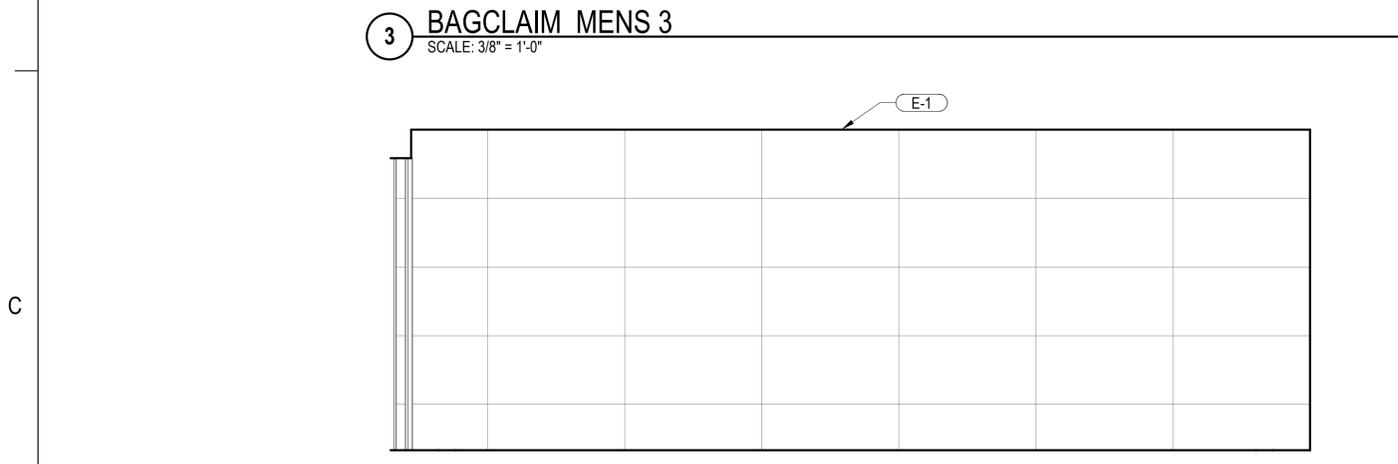


5 BAGCLAIM MENS 5
SCALE: 3/8" = 1'-0"

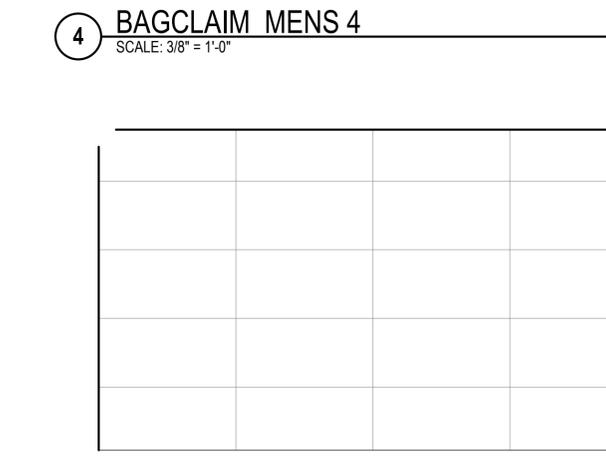

6 BAGCLAIM MENS 6
SCALE: 3/8" = 1'-0"

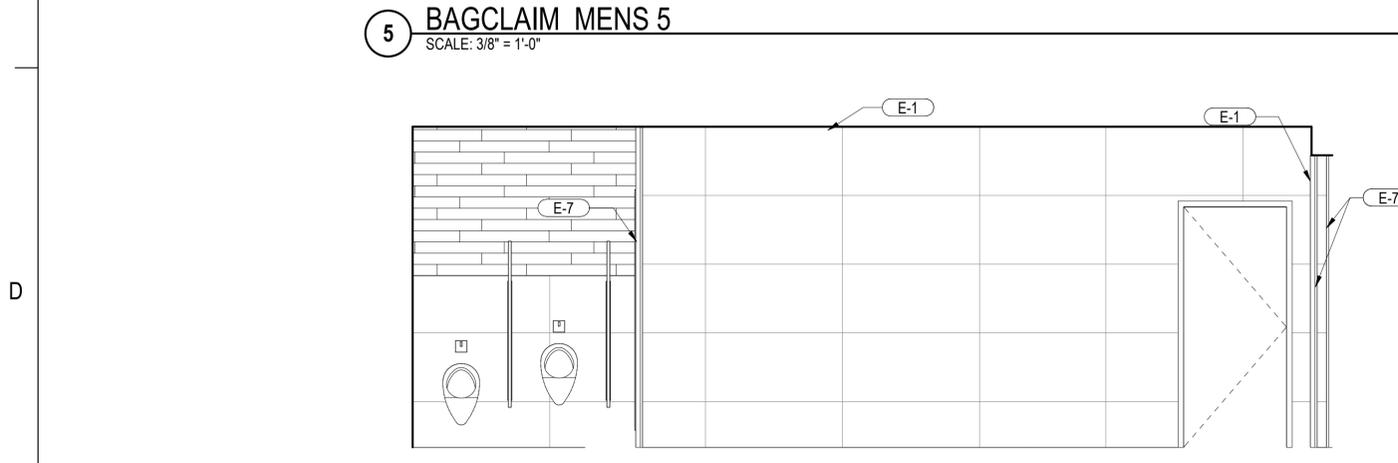

7 BAGCLAIM MENS 7
SCALE: 3/8" = 1'-0"

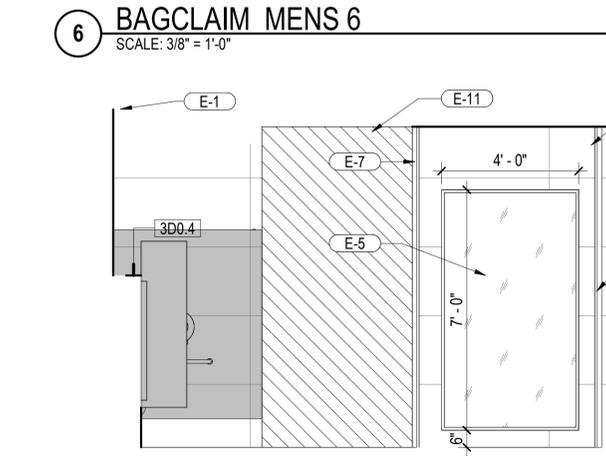


8 BAGCLAIM MENS 8
SCALE: 3/8" = 1'-0"

- KEYNOTES**
- E-1 START FULL-SIZE TILE AT THIS LOCATION
 - E-2 CONTINUOUS STAINLESS STEEL COVE, TYP
 - E-3 CONTINUOUS CORNER TRIM, TYP
 - E-5 BACKLIT FULL-SIZE MIRROR WITH FRAME
 - E-7 CONTINUOUS 2X2 STAINLESS STEEL CORNER GUARD
 - E-11 MURAL PICTURE
 - E-12 SOLID SURFACE SHELF

FINISH LEGEND

	TILE TYPE CT5
	TILE TYPE CT1 (FLOOR)
	TILE TYPE CT2 (FLOOR BAND)
	TILE TYPE CT3 (WALL)
	TILE TYPE CT4 (WALL MOSAIC)
	WATER PROOFING MEMBRANE SYSTEM WITH AGGREGATE FINISH (WP), REF. SPECIFICATION SECTION 07 12 10
	EXISTING TO REMAIN
	TOILET PARTITION / URINAL SCREEN
	GRAPHIC MURAL

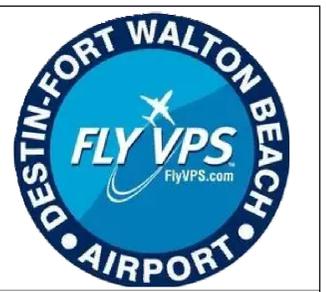


INFRASTRUCTURE CONSULTING & ENGINEERING ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:
Designed by: **KGL**
Drawn by: **JCL**
Checked by: **EL**
Project Number: **24-201.01**



Notes:

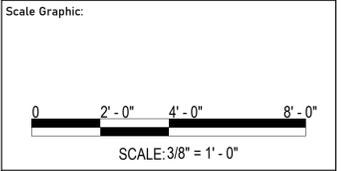

REVISIONS

No.	Description	Date

Project Name:
RESTROOM RENOVATIONS VPS - DESTIN-FORT WALTON BEACH AIRPORT

Drawing Name:
INTERIOR ELEVATIONS - BAGCLAIM MENS

Date: 09-19-2025
Sheet Number: **A-412**
Scale: As indicated
Drawing Number: 24-201.01

KEYNOTES

- E-1 START FULL-SIZE TILE AT THIS LOCATION
- E-7 CONTINUOUS 2X2 STAINLESS STEEL CORNER GUARD



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant

Designed by:

KGL

Drawn by:

JCL

Checked by:

EL

Project Number:


24-201.01

Notes:



FINISH LEGEND	
	TILE TYPE CT5
	TILE TYPE CT1 (FLOOR)
	TILE TYPE CT2 (FLOOR BAND)
	TILE TYPE CT3 (WALL)
	TILE TYPE CT4 (WALL MOSAIC)
	WATER PROOFING MEMBRANE SYSTEM WITH AGGREGATE FINISH (WP), REF. SPECIFICATION SECTION 07 12 10
	EXISTING TO REMAIN
	TOILET PARTITION / URINAL SCREEN
	GRAPHIC MURAL

Scale Graphic:



REVISIONS

No.	Description	Date

Project Name:

**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:

INTERIOR ELEVATIONS - CONCOURSE 'A' FAMILY & ENTRANCE

Date:

09-19-2025

Sheet:


A-413

Scale:

As indicated


Drawing Number:

24-201.01

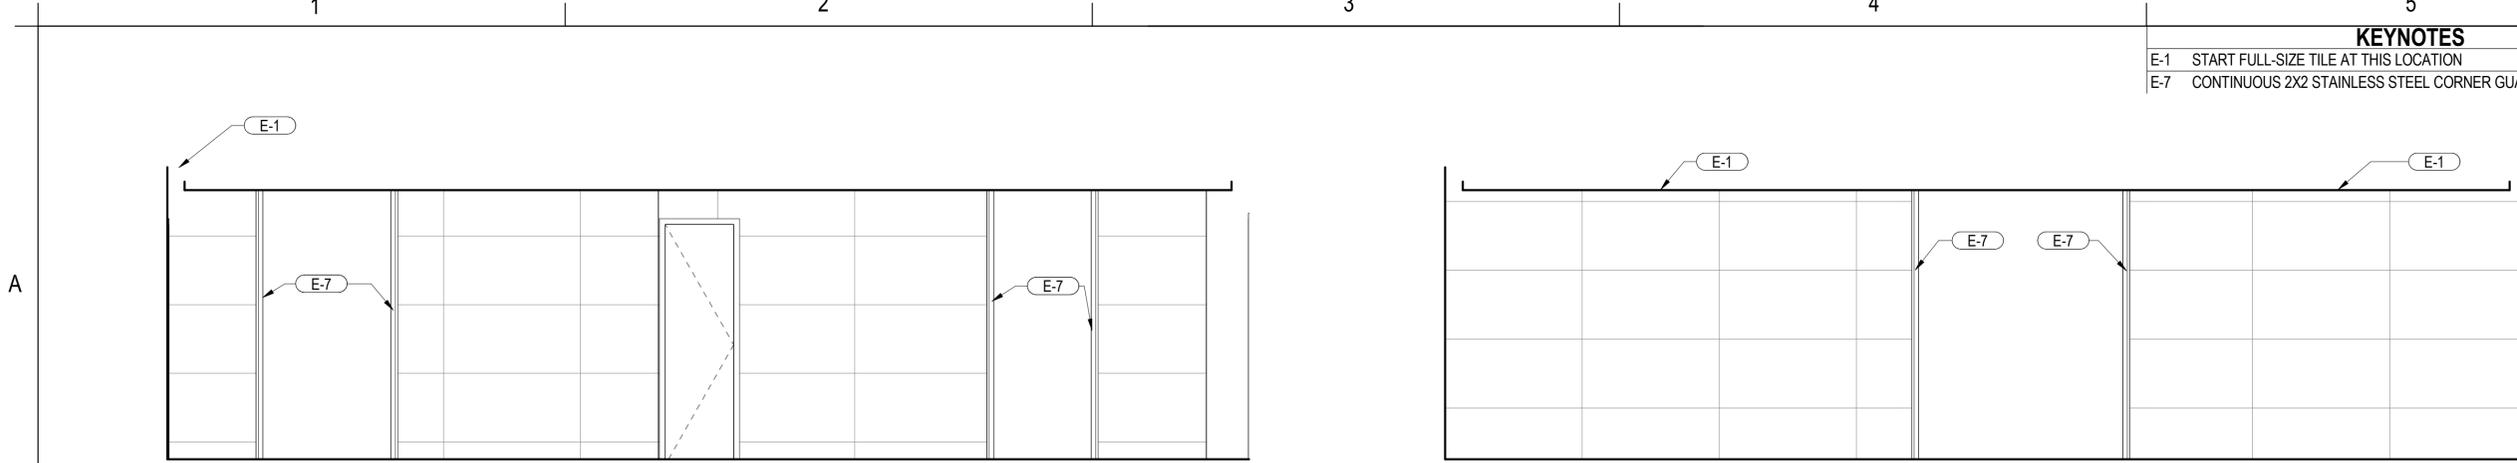


1 'A' ENTRANCE 1
SCALE: 3/8" = 1'-0"


2 'A' ENTRANCE 2
SCALE: 3/8" = 1'-0"

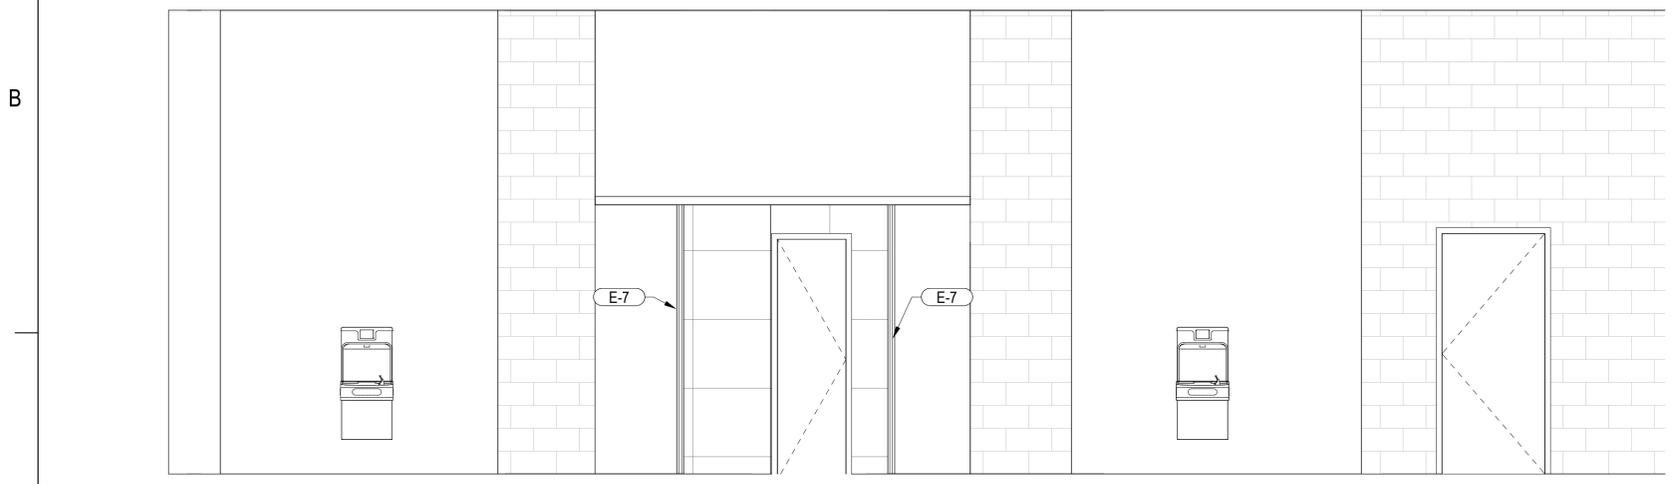


3 'A' ENTRANCE
SCALE: 3/8" = 1'-0"

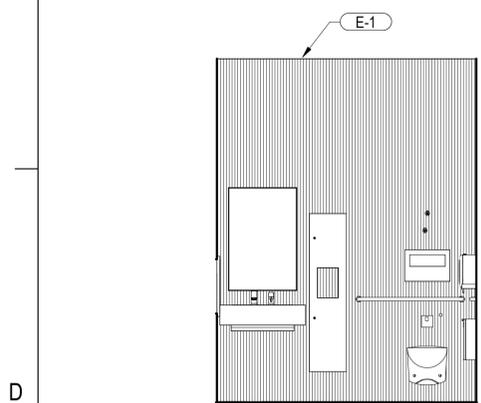


4 'A' FAMILY 1
SCALE: 3/8" = 1'-0"

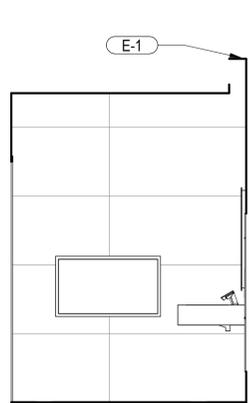

5 'A' FAMILY 2
SCALE: 3/8" = 1'-0"

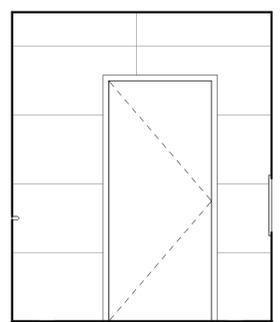

6 'A' FAMILY 3
SCALE: 3/8" = 1'-0"

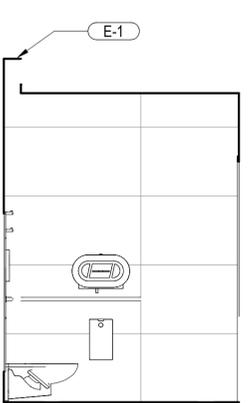

7 'A' FAMILY 4
SCALE: 3/8" = 1'-0"

1

2

3

4


5

A


B

C


D

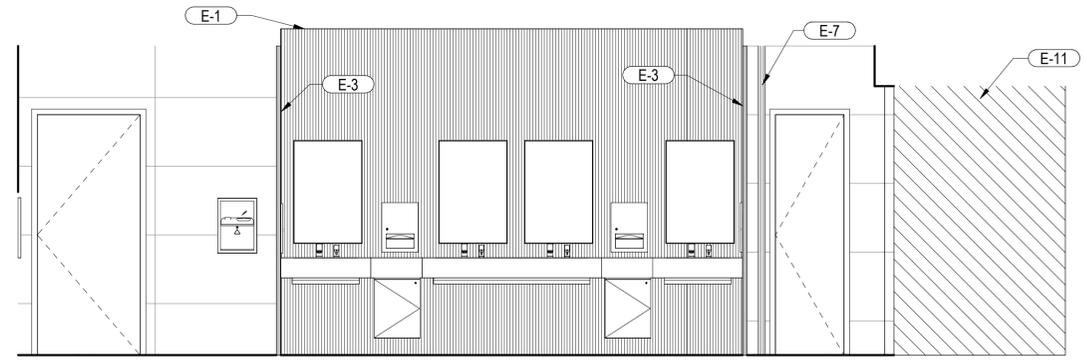


1 'A' MENS 1
SCALE: 3/8" = 1'-0"

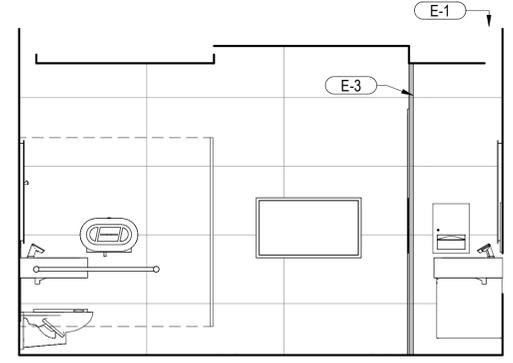


2 'A' MENS 2
SCALE: 3/8" = 1'-0"

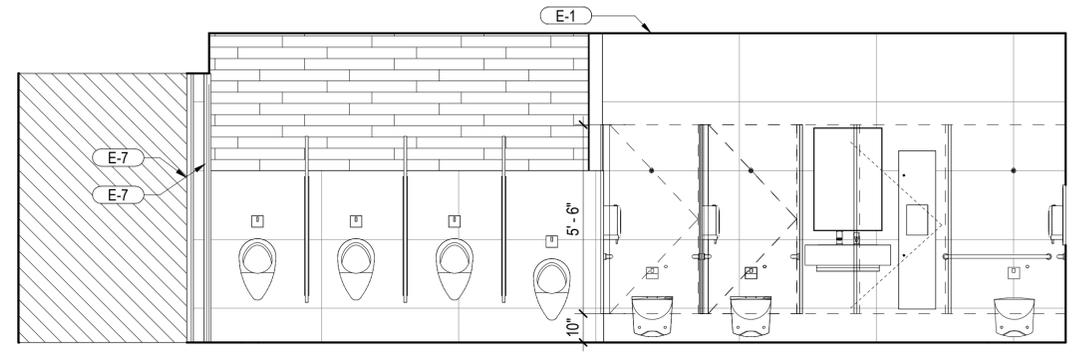


3 'A' MENS 3
SCALE: 3/8" = 1'-0"

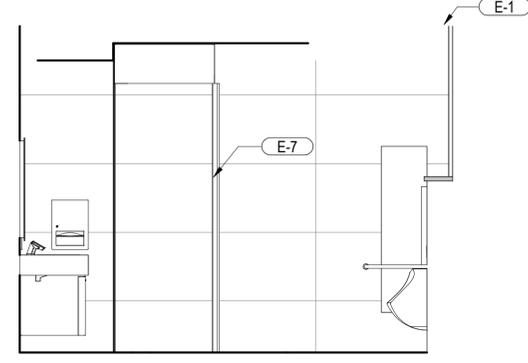


4 'A' MENS 4
SCALE: 3/8" = 1'-0"

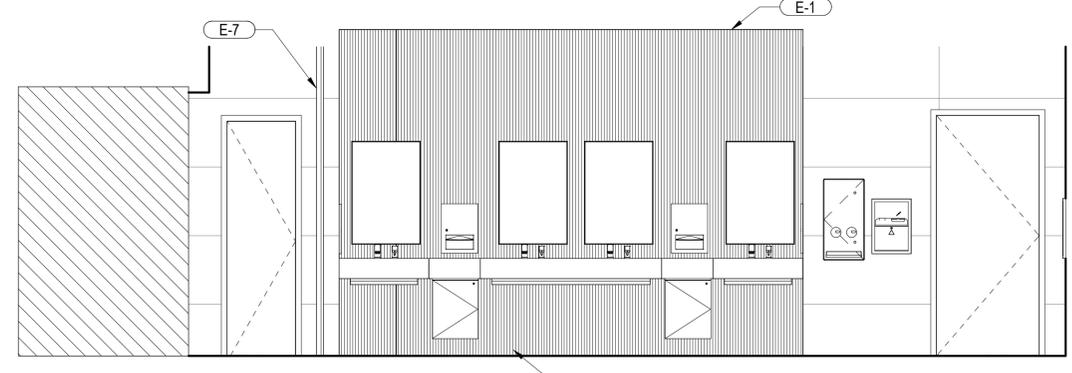


5 'A' WOMENS 1
SCALE: 3/8" = 1'-0"

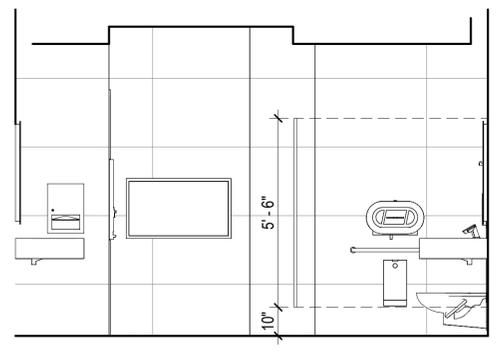

6 'A' WOMENS 2
SCALE: 3/8" = 1'-0"

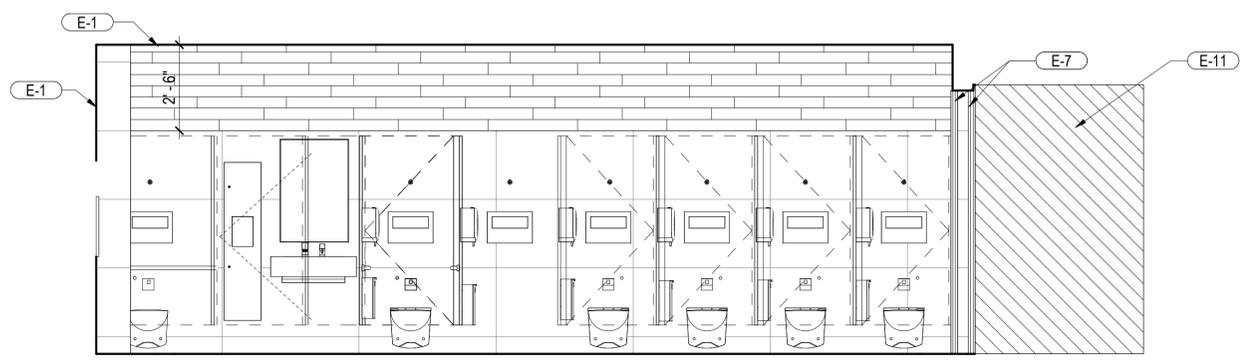

7 'A' WOMENS 3
SCALE: 3/8" = 1'-0"

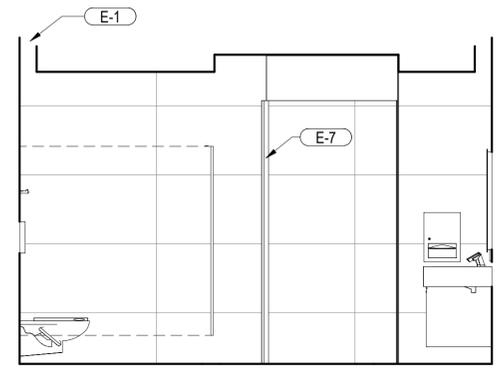

8 'A' WOMENS 4
SCALE: 3/8" = 1'-0"

- KEYNOTES**
- E-1 START FULL-SIZE TILE AT THIS LOCATION
 - E-2 CONTINUOUS STAINLESS STEEL COVE, TYP
 - E-3 CONTINUOUS CORNER TRIM, TYP
 - E-7 CONTINUOUS 2X2 STAINLESS STEEL CORNER GUARD
 - E-11 MURAL PICTURE




INFRASTRUCTURE
CONSULTING & ENGINEERING


ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:
Designed by: **KGL**
Drawn by: **JQL**
Checked by: **EL**
Project Number: **24-201.01**



Notes:

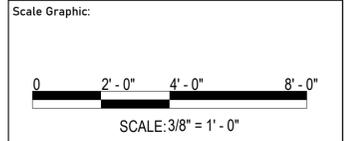

REVISIONS		
No.	Description	Date

FINISH LEGEND	
	TILE TYPE CT5
	TILE TYPE CT1 (FLOOR)
	TILE TYPE CT2 (FLOOR BAND)
	TILE TYPE CT3 (WALL)
	TILE TYPE CT4 (WALL MOSAIC)
	WATER PROOFING MEMBRANE SYSTEM WITH AGGREGATE FINISH (WP), REF. SPECIFICATION SECTION 07 12 10
	EXISTING TO REMAIN
	TOILET PARTITION / URINAL SCREEN
	GRAPHIC MURAL

Project Name: **RESTROOM RENOVATIONS VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name: **INTERIOR ELEVATIONS - CONCOURSE 'A' MENS & WOMENS**

Date: 09-19-2025
Drawing Number: **A-414**

Scale: As indicated

BID SET


1

2

3

4

5

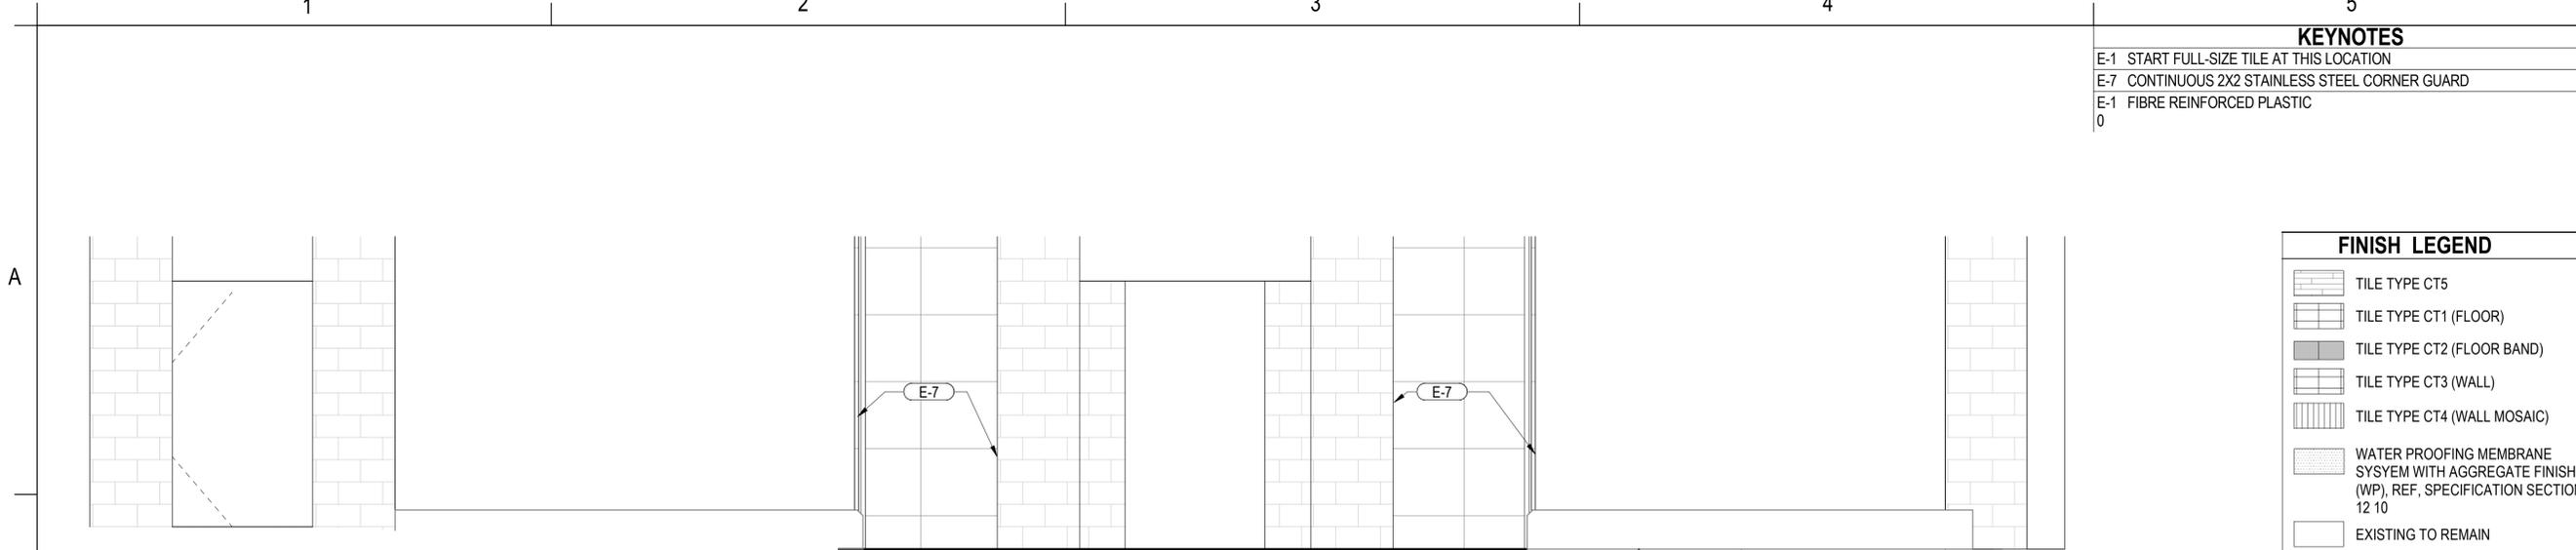


1 'B' ENTRANCE
SCALE: 3/8" = 1'-0"

FINISH LEGEND


- TILE TYPE CT5
- TILE TYPE CT1 (FLOOR)
- TILE TYPE CT2 (FLOOR BAND)
- TILE TYPE CT3 (WALL)
- TILE TYPE CT4 (WALL MOSAIC)
- WATER PROOFING MEMBRANE SYSTEM WITH AGGREGATE FINISH (WP), REF. SPECIFICATION SECTION 07 12 10
- EXISTING TO REMAIN
- TOILET PARTITION / URINAL SCREEN
- GRAPHIC MURAL

KEYNOTES


- E-1 START FULL-SIZE TILE AT THIS LOCATION
- E-7 CONTINUOUS 2X2 STAINLESS STEEL CORNER GUARD
- E-1 FIBRE REINFORCED PLASTIC

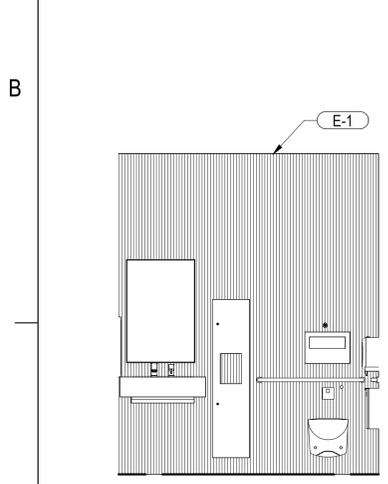


2 'B' FAMILY 1
SCALE: 3/8" = 1'-0"

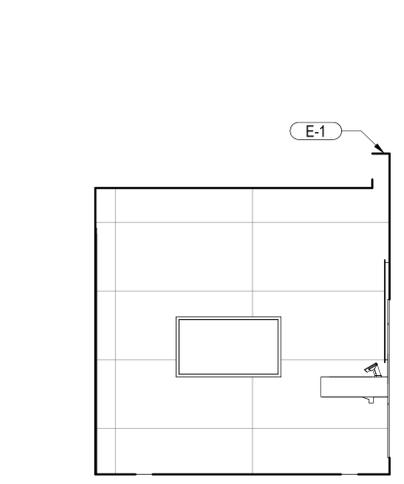


3 'B' FAMILY 2
SCALE: 3/8" = 1'-0"

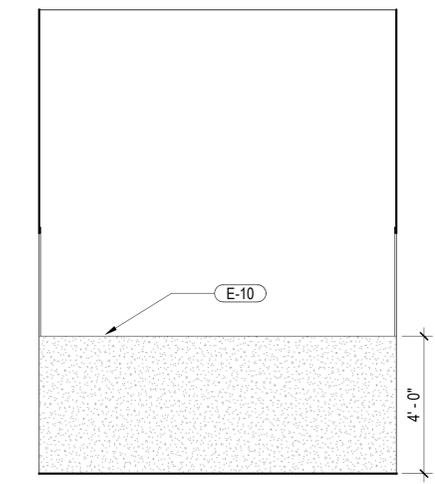


4 'B' JANITORIAL 1
SCALE: 3/8" = 1'-0"

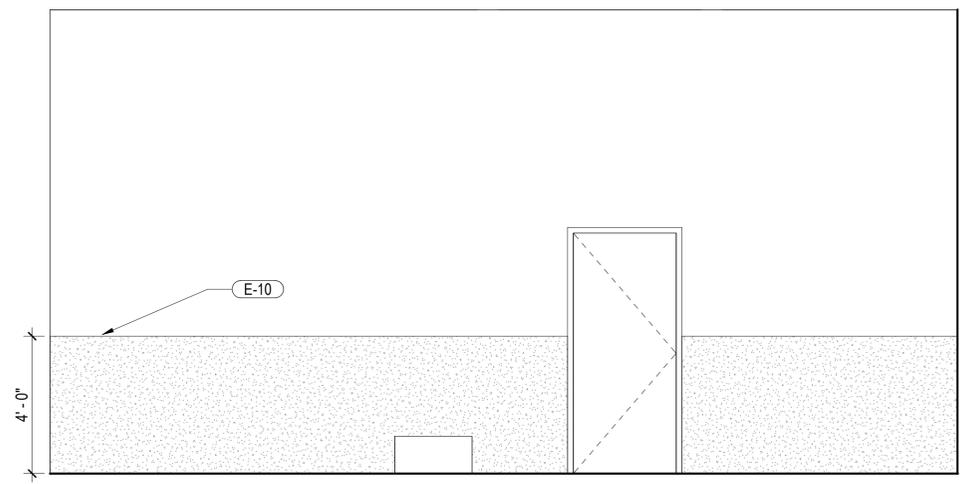


5 'B' JANITORIAL 2
SCALE: 3/8" = 1'-0"

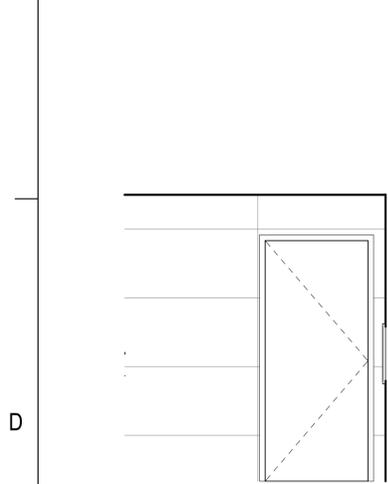


6 'B' FAMILY 3
SCALE: 3/8" = 1'-0"

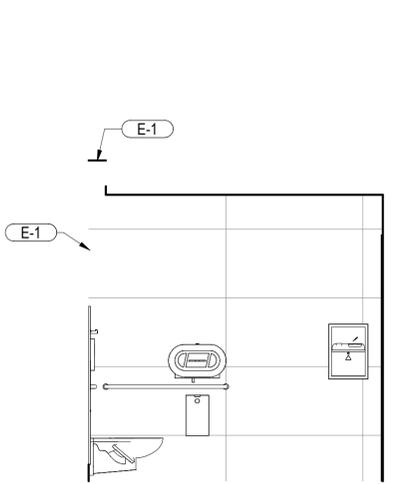

7 'B' FAMILY 4
SCALE: 3/8" = 1'-0"

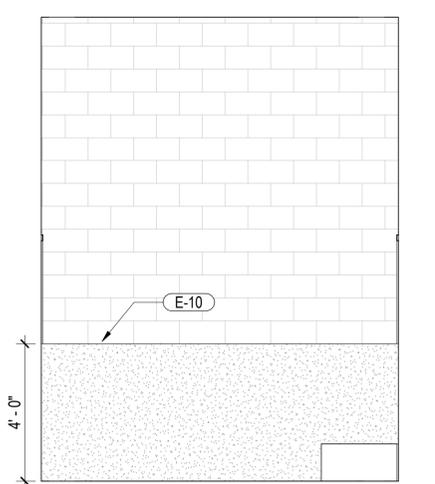

8 'B' JANITORIAL 3
SCALE: 3/8" = 1'-0"

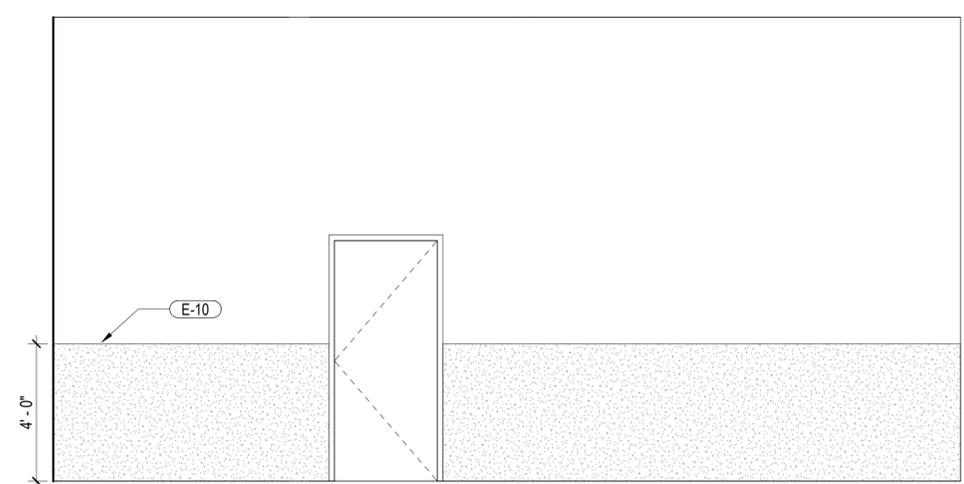


9 'B' JANITORIAL 4
SCALE: 3/8" = 1'-0"



INFRASTRUCTURE CONSULTING & ENGINEERING ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Designed by: **KGL**
Drawn by: **JCL**
Checked by: **EL**
Project Number: **24-201.01**

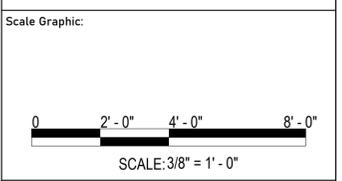


REVISIONS

No.	Description	Date


Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
INTERIOR ELEVATIONS - CONCOURSE 'B' FAMILY & IAN CLOSE
Date: 09-19-2025
Scale: As indicated
Drawing Number: 24-201.01
A-415


BD SET

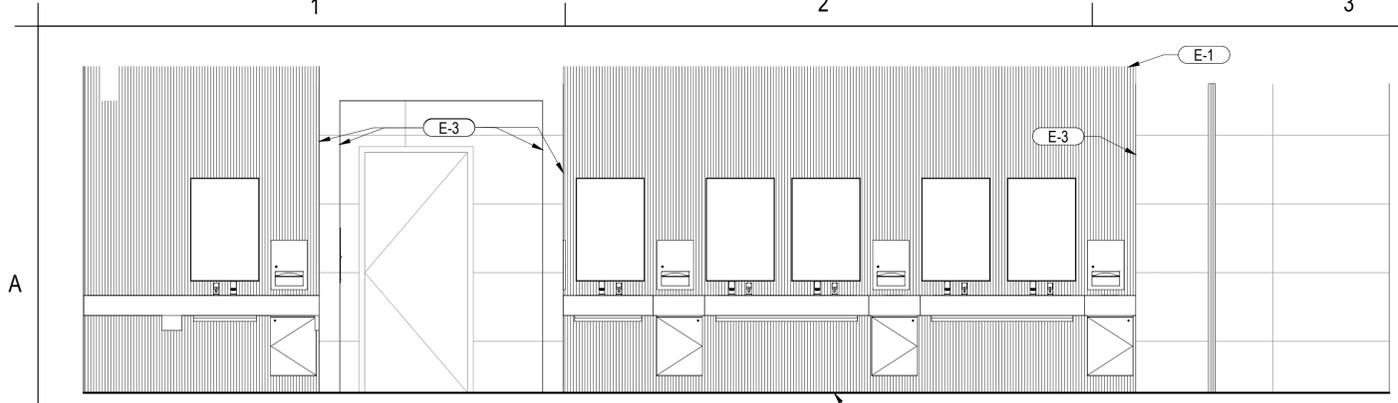


1 'B' MENS 1
SCALE: 3/8" = 1'-0"

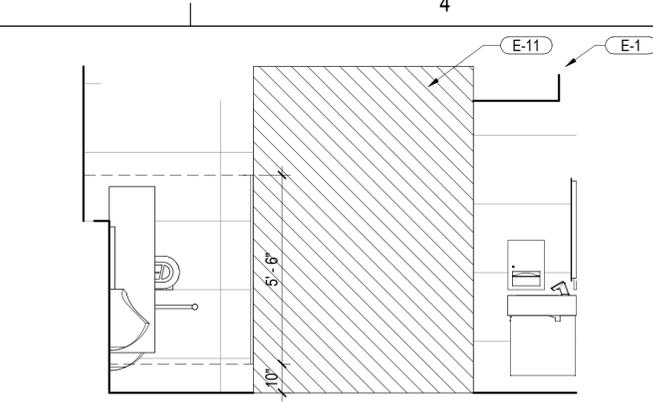

2 'B' MENS 2
SCALE: 3/8" = 1'-0"

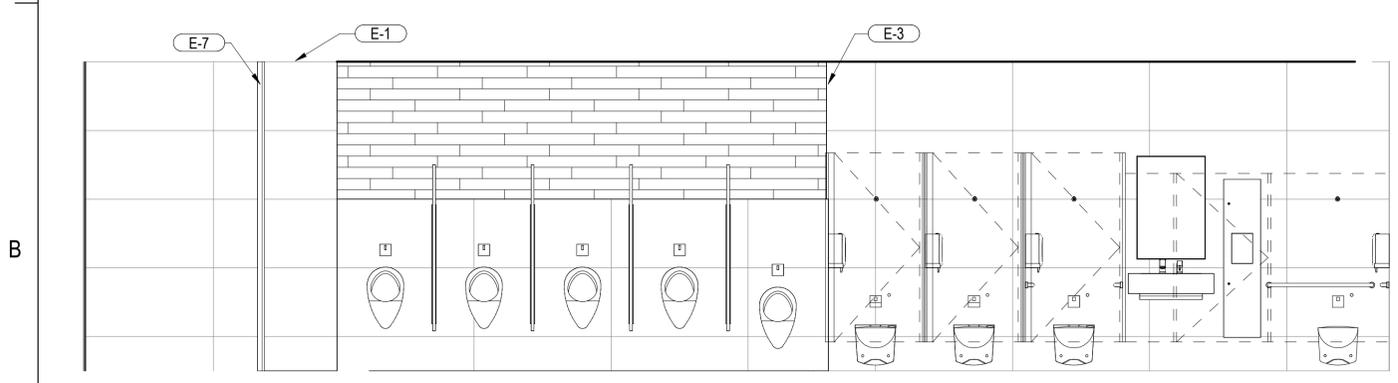


3 'B' MENS 3
SCALE: 3/8" = 1'-0"

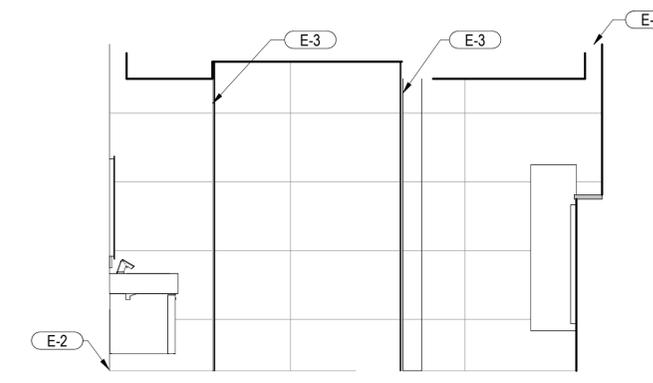

4 'B' MENS 4
SCALE: 3/8" = 1'-0"




5 'B' MENS 5
SCALE: 3/8" = 1'-0"

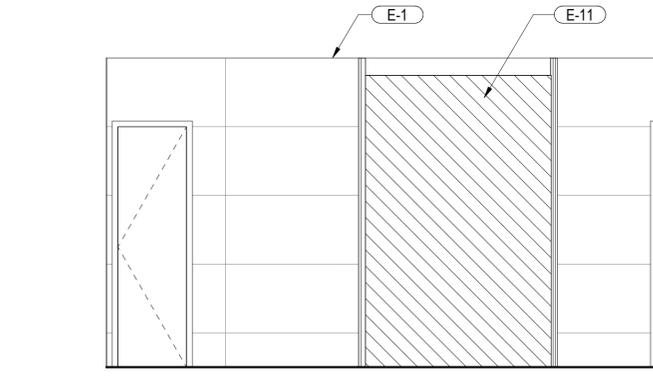

6 'B' MENS 6
SCALE: 3/8" = 1'-0"



7 'B' MENS 7
SCALE: 3/8" = 1'-0"

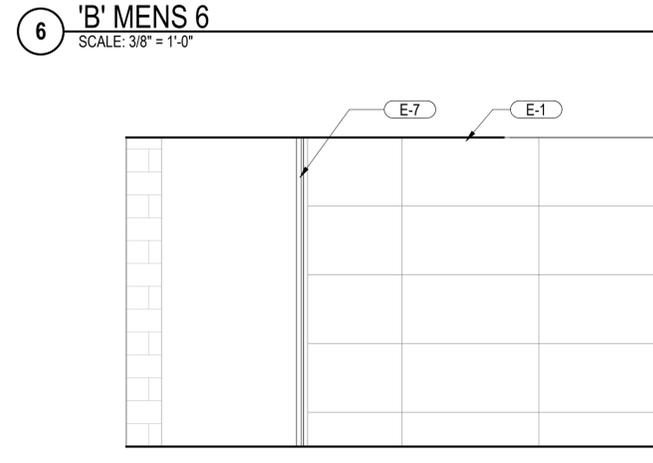

8 'B' MENS 8
SCALE: 3/8" = 1'-0"


- KEYNOTES**
- E-1 START FULL-SIZE TILE AT THIS LOCATION
 - E-2 CONTINUOUS STAINLESS STEEL COVE, TYP
 - E-3 CONTINUOUS CORNER TRIM, TYP
 - E-7 CONTINUOUS 2X2 STAINLESS STEEL CORNER GUARD
 - E-11 MURAL PICTURE

- FINISH LEGEND**
- TILE TYPE CT5
 - TILE TYPE CT1 (FLOOR)
 - TILE TYPE CT2 (FLOOR BAND)
 - TILE TYPE CT3 (WALL)
 - TILE TYPE CT4 (WALL MOSAIC)
 - WATER PROOFING MEMBRANE SYSTEM WITH AGGREGATE FINISH (WP), REF. SPECIFICATION SECTION 07 12 10
 - EXISTING TO REMAIN
 - TOILET PARTITION / URINAL SCREEN
 - GRAPHIC MURAL




INFRASTRUCTURE CONSULTING & ENGINEERING ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:
Designed by: **KGL**
Drawn by: **JCL**
Checked by: **EL**
Project Number: **24-201.01**



Notes:

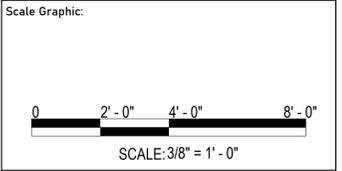

REVISIONS


No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**


Drawing Name:
INTERIOR ELEVATIONS - CONCOURSE 'B' MENS

Date: 09-19-2025
Scale: As indicated
Sheet Number: **A-416**
Drawing Number: 24-201.01


BD SET

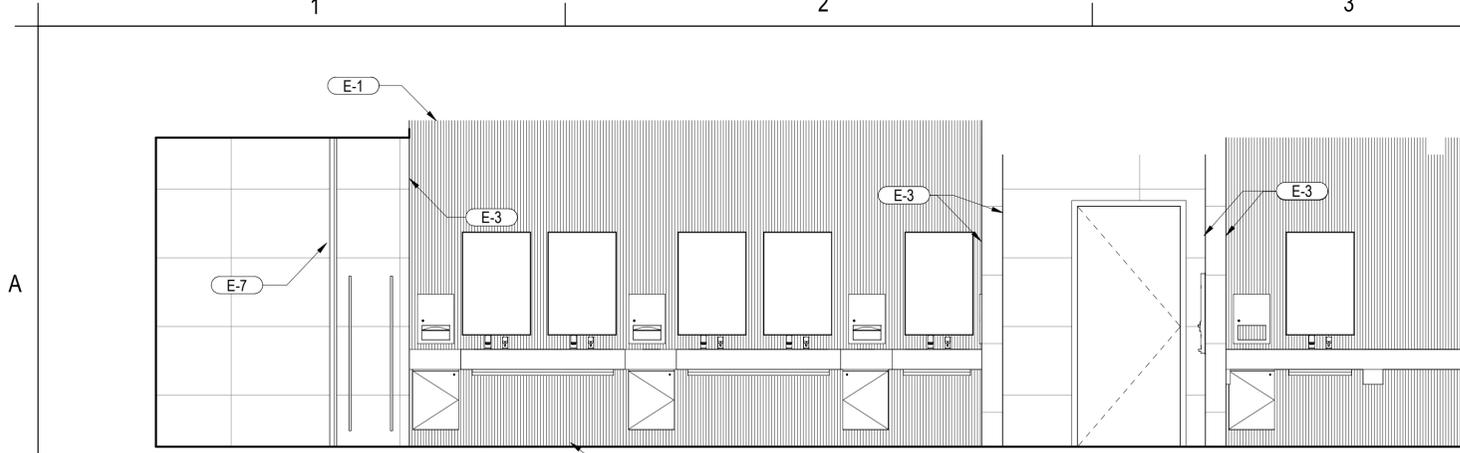


1 'B' WOMENS 1
SCALE: 3/8" = 1'-0"

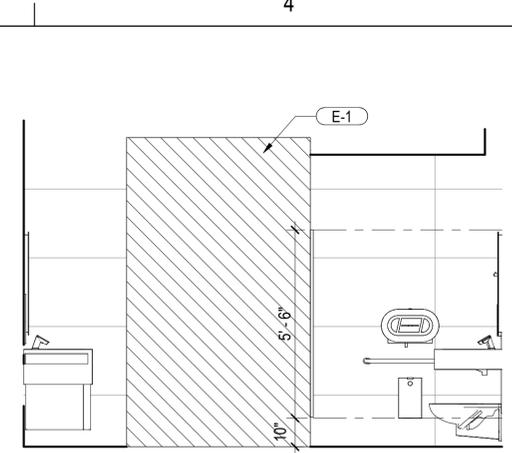


2 'B' WOMENS 2
SCALE: 3/8" = 1'-0"

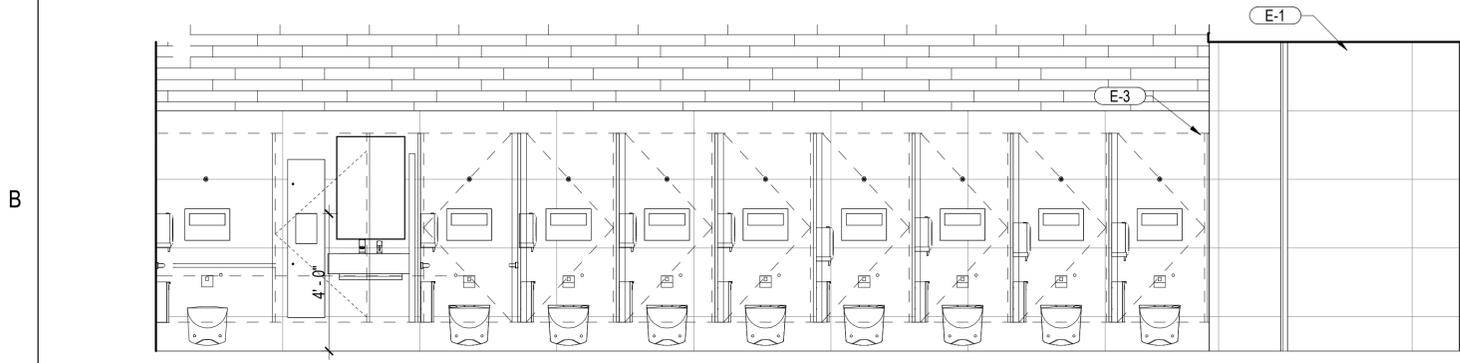


3 'B' WOMENS 3
SCALE: 3/8" = 1'-0"

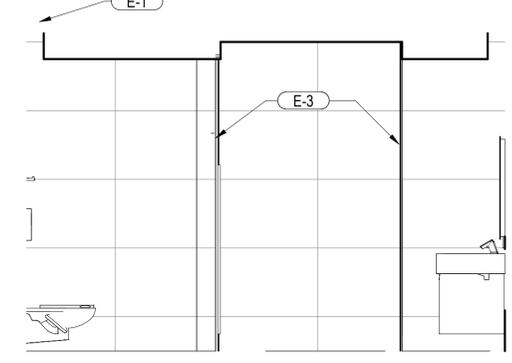


4 'B' WOMENS 4
SCALE: 3/8" = 1'-0"

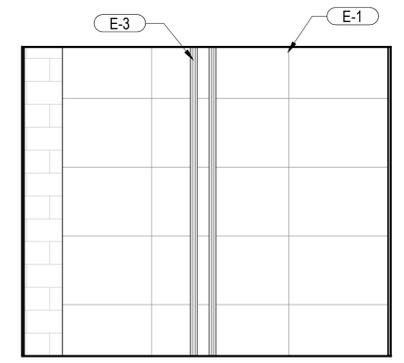


5 'B' WOMENS 5
SCALE: 3/8" = 1'-0"

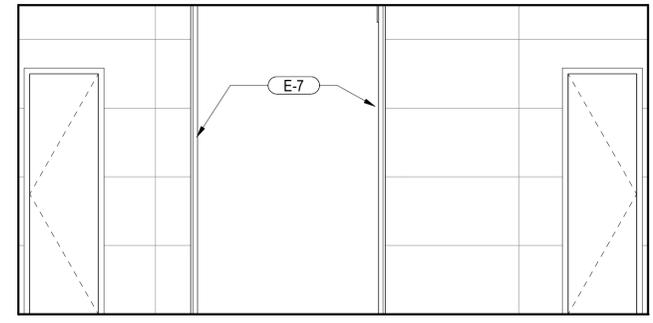

6 'B' WOMENS 6
SCALE: 3/8" = 1'-0"

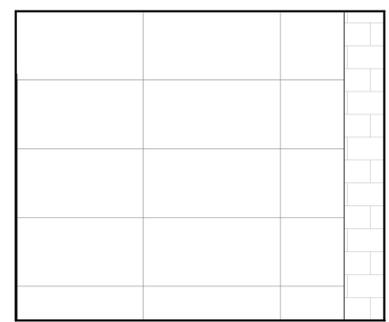

7 'B' WOMENS 7
SCALE: 3/8" = 1'-0"

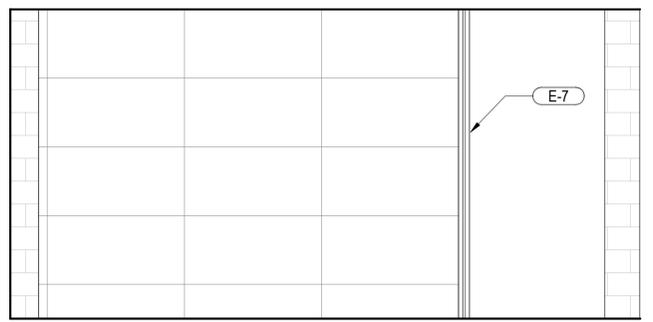

8 'B' WOMENS 8
SCALE: 3/8" = 1'-0"

KEYNOTES

- E-1 START FULL-SIZE TILE AT THIS LOCATION
- E-2 CONTINUOUS STAINLESS STEEL COVE, TYP
- E-3 CONTINUOUS CORNER TRIM, TYP
- E-7 CONTINUOUS 2X2 STAINLESS STEEL CORNER GUARD

FINISH LEGEND

- TILE TYPE CT5
- TILE TYPE CT1 (FLOOR)
- TILE TYPE CT2 (FLOOR BAND)
- TILE TYPE CT3 (WALL)
- TILE TYPE CT4 (WALL MOSAIC)
- WATER PROOFING MEMBRANE SYSTEM WITH AGGREGATE FINISH (WP), REF, SPECIFICATION SECTION 07 12 10
- EXISTING TO REMAIN
- TOILET PARTITION / URINAL SCREEN
- GRAPHIC MURAL



INFRASTRUCTURE CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:

Designed by: KGL

Drawn by: JCL


Checked by: EL

Project Number: 24-201.01



Notes:

Scale Graphic:



REVISIONS

No.	Description	Date

Project Name:

**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:


INTERIOR ELEVATIONS - CONCOURSE 'B' WOMENS

Date: 09-19-2025

Sheet Number: A-417

Scale: As indicated

Drawing Number: 24-201.01

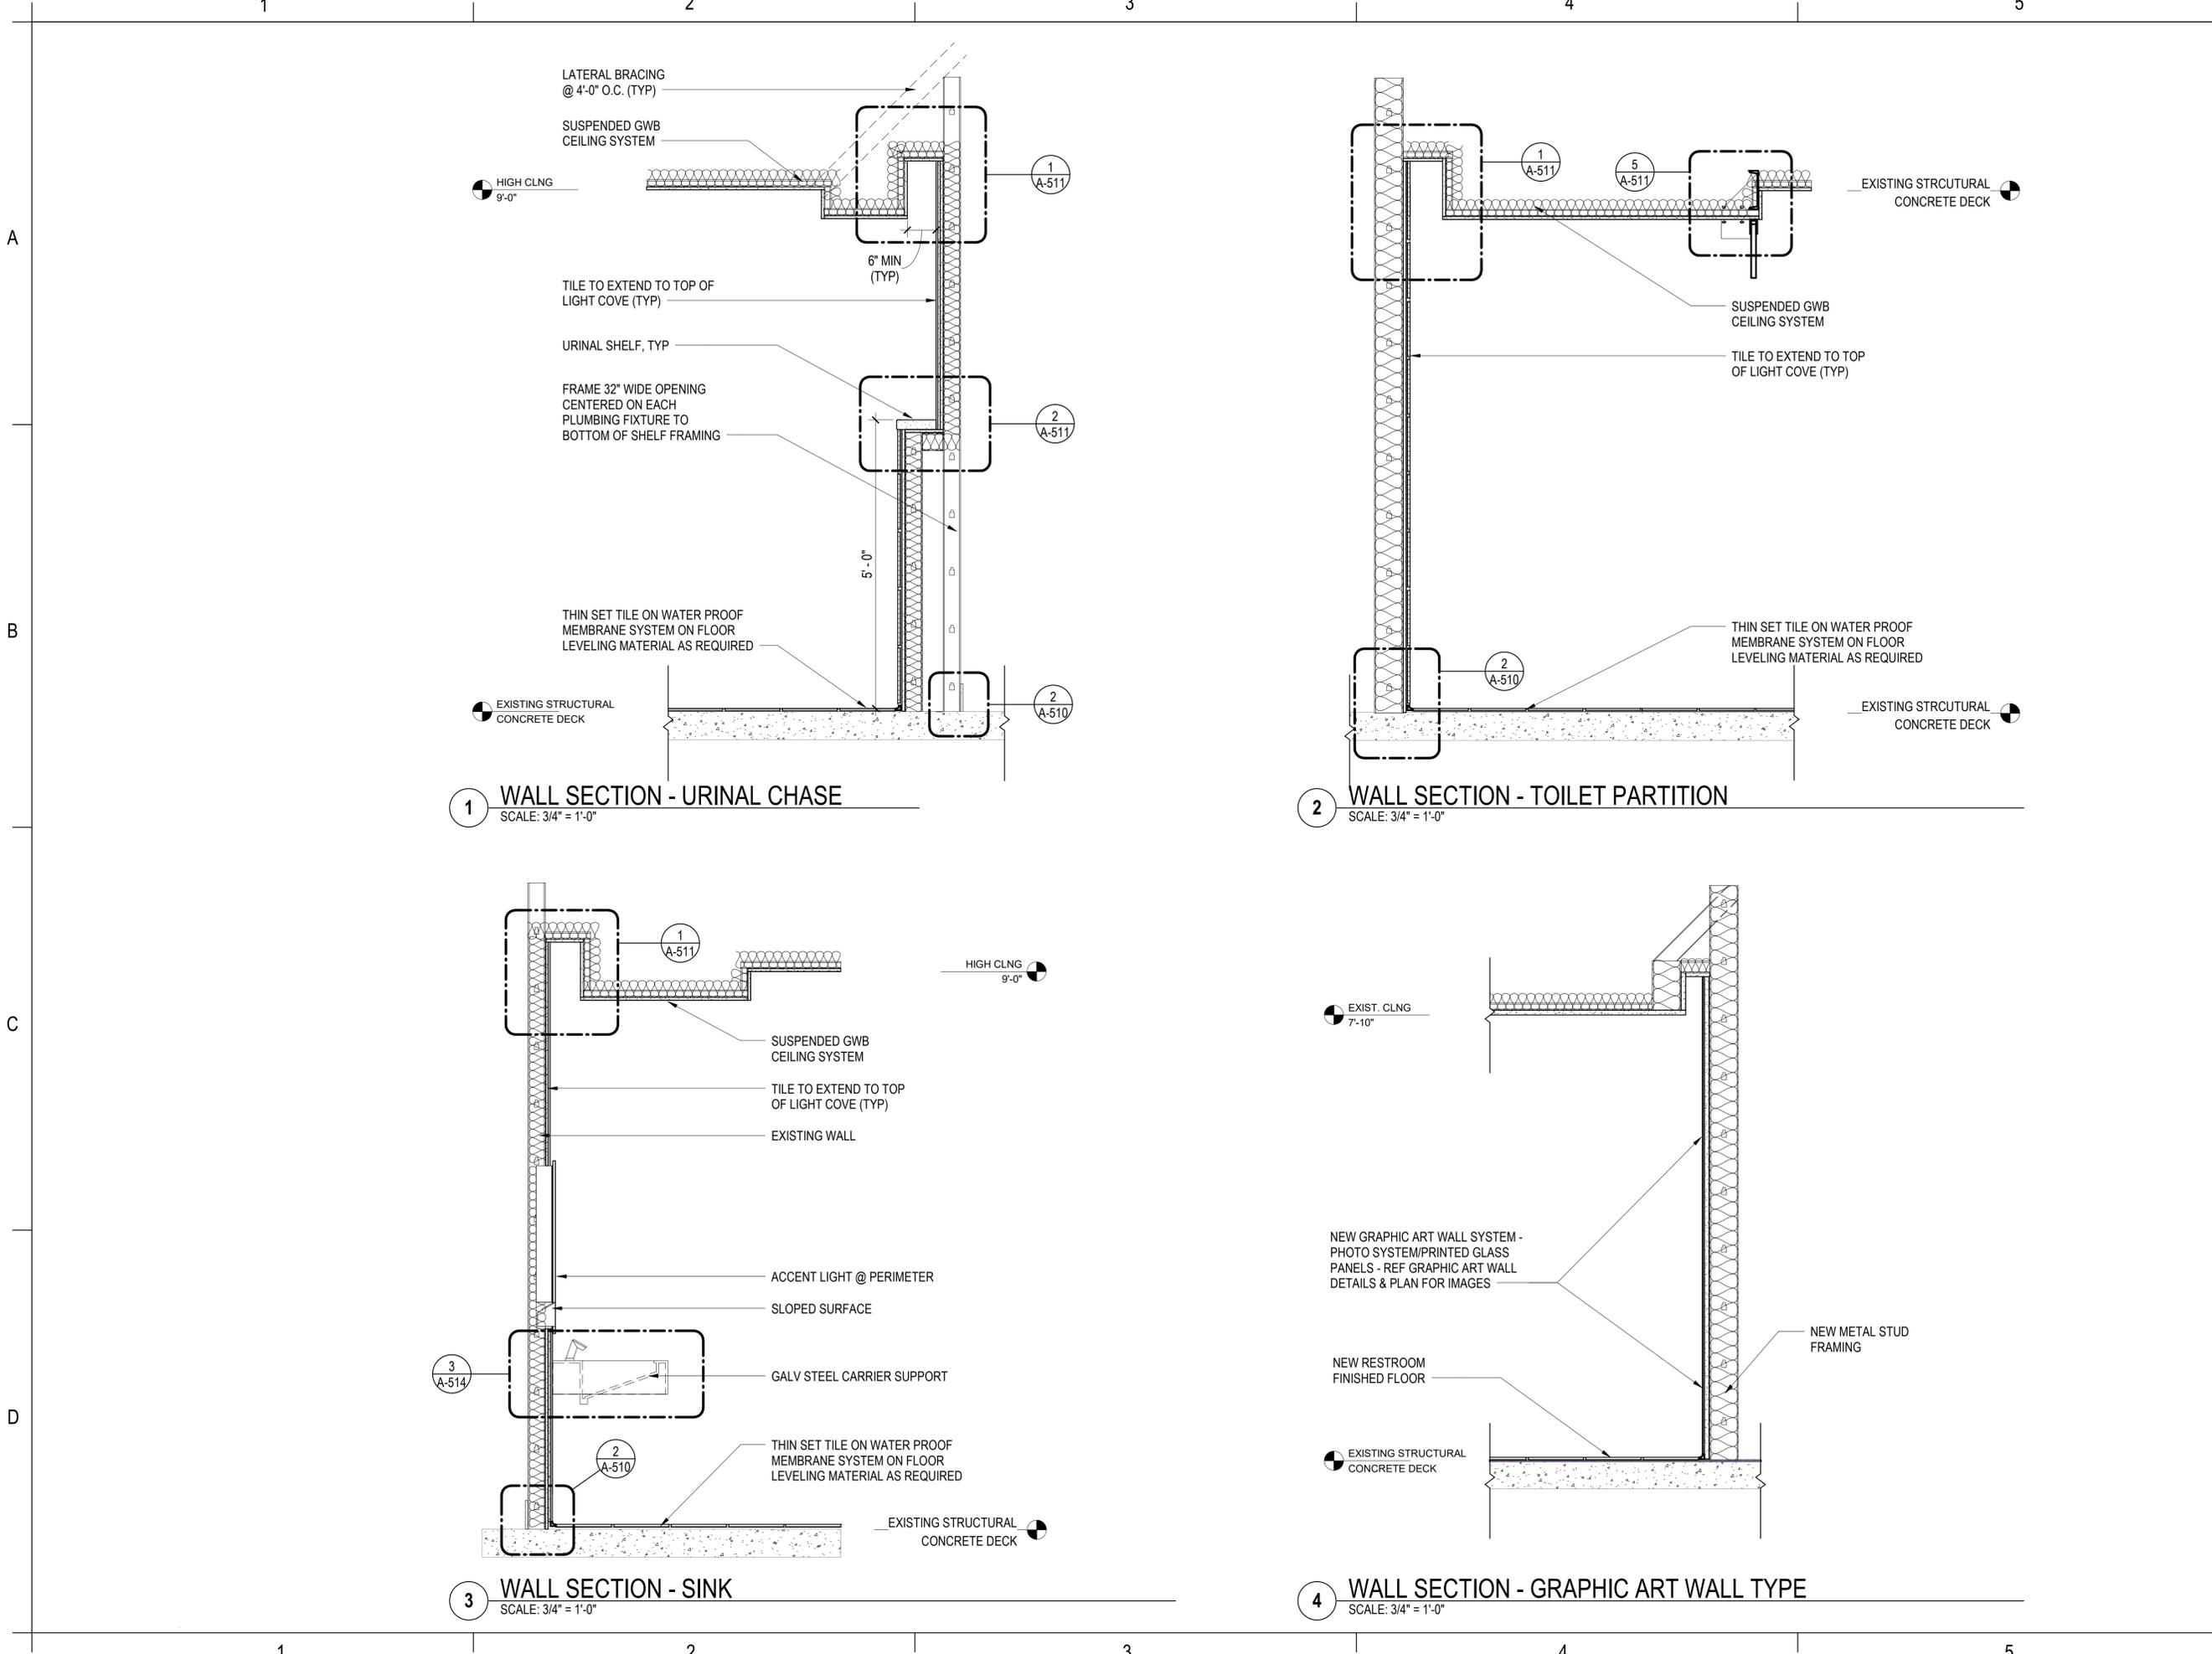


INFRASTRUCTURE
CONSULTING & ENGINEERING
ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:
Designed by: **KGL**
Drawn by: **KGL**
Checked by: **EL**
Project Number: **24-201.01**



Notes:

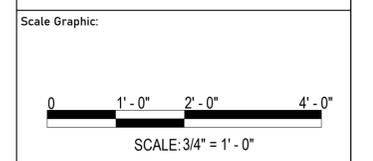

REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
WALL SECTIONS

Date: 09-19-2025
Scale: 3/4" = 1'-0"
Sheet Number: **A-501**
Drawing Number: **24-201.01**



INFRASTRUCTURE
CONSULTING & ENGINEERING


ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928


Consultant:	
Designed by:	KGL
Drawn by:	KGL
Checked by:	EL
Project Number:	24-201.01
Notes:	



A

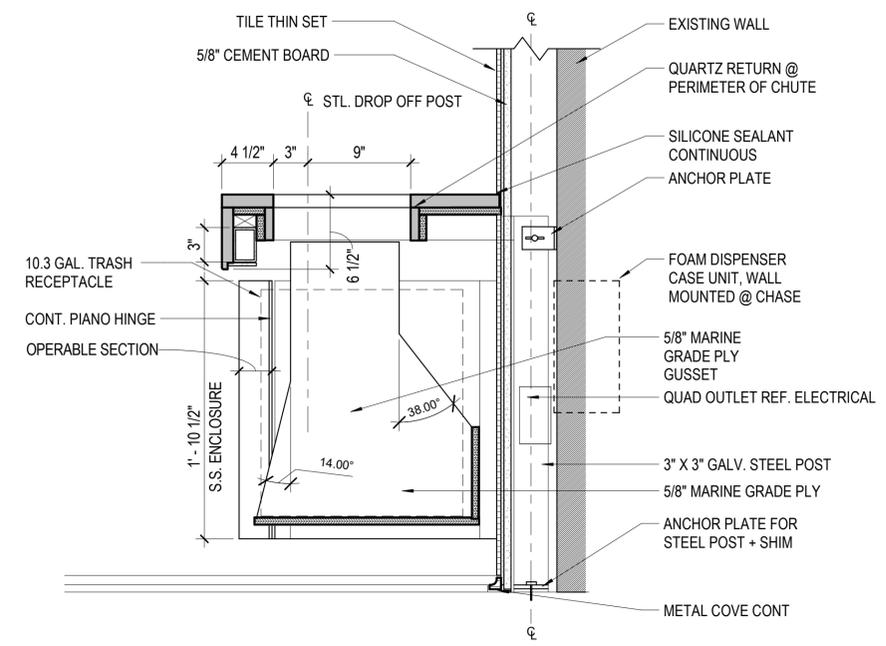


1 DETAIL SECTION - TRASH RECEPTACLES
SCALE: 1 1/2" = 1'-0"

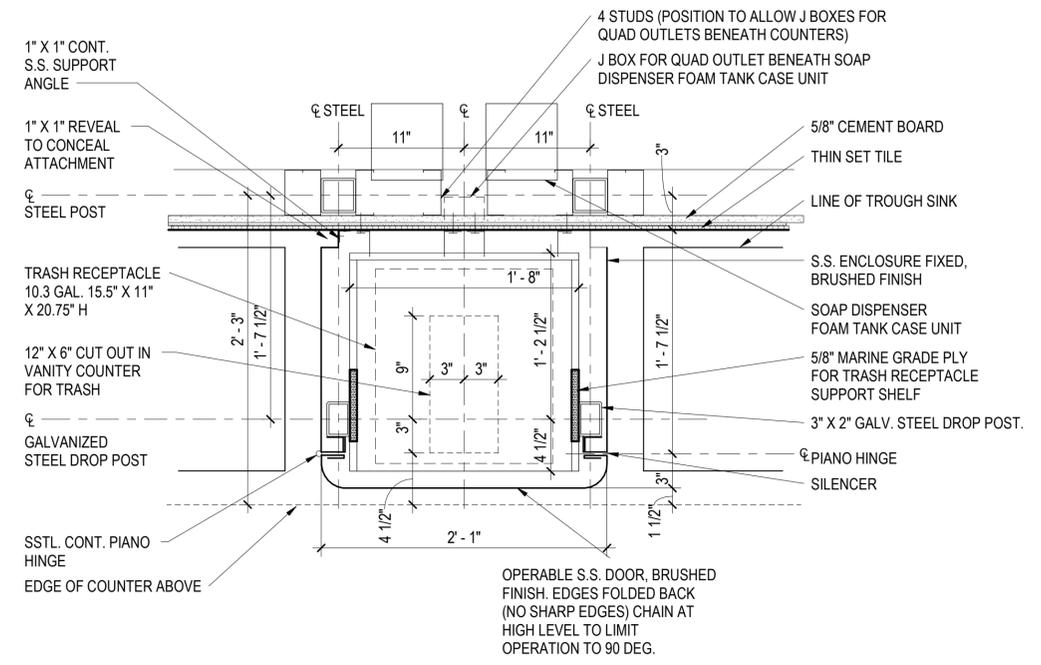


2 DETAIL SECTION - TRASH RECEPTACLES
SCALE: 1 1/2" = 1'-0"

B

C

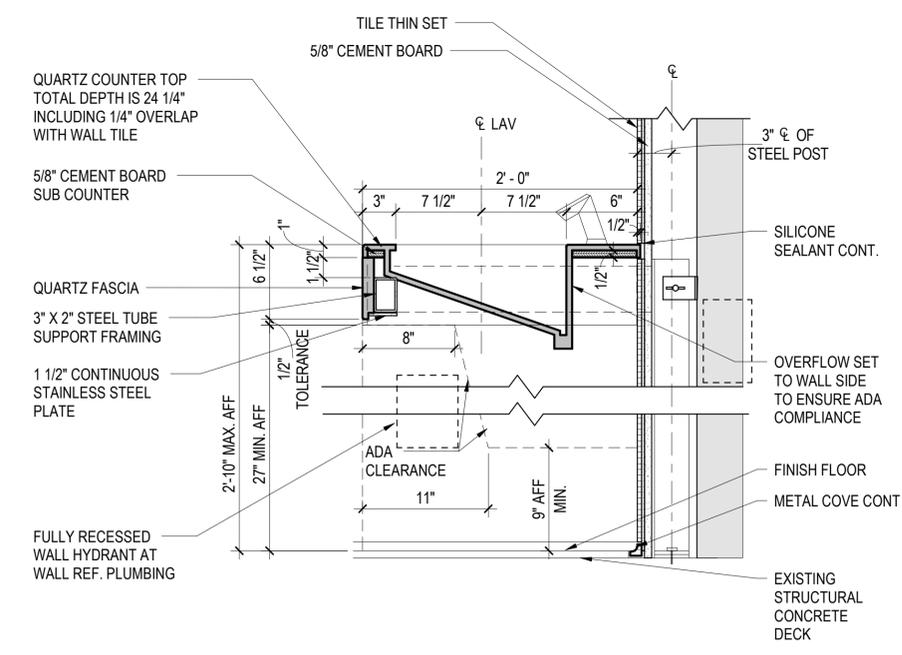


3 DETAIL SECTION - TROUGH SINKS
SCALE: 1 1/2" = 1'-0"

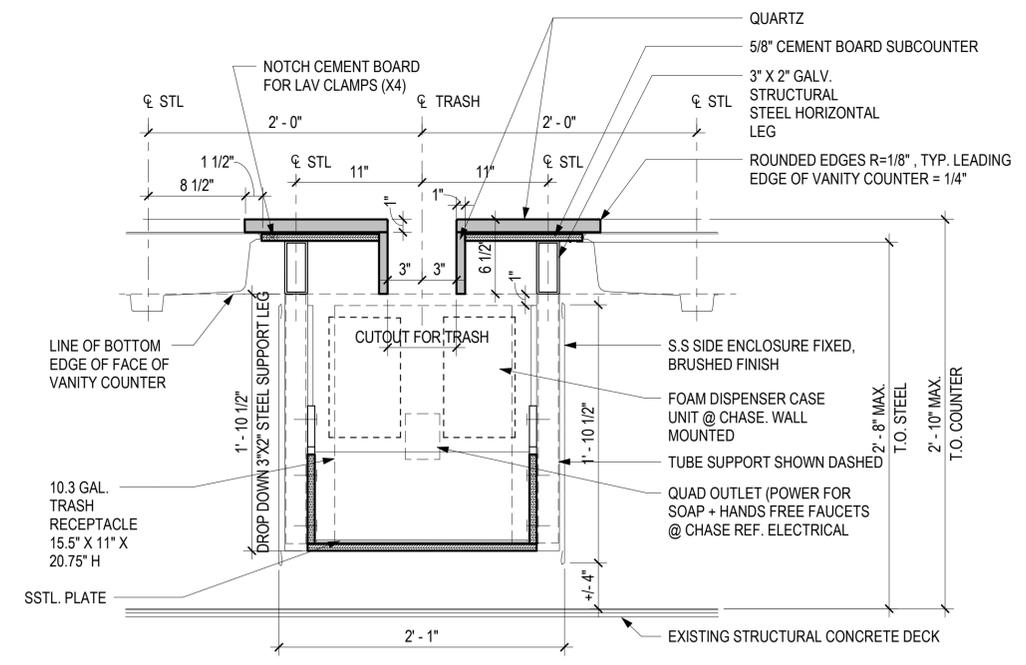

4 DETAIL SECTION - TRASH RECEPTACLES
SCALE: 1 1/2" = 1'-0"

D

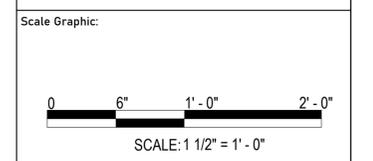

REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
DETAIL VIEWS - TROUGH SINKS

Date:	09-19-2025	Sheet Number:	A-514
Scale:	1 1/2" = 1'-0"	Drawing Number:	24-201.01



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:

Designed by: **KGL**

Drawn by: **KGL**


Checked by: **EL**

Project Number:
24-201.01



Notes:

Scale Graphic:



REVISIONS

No.	Description	Date

Project Name:

**RESTROOM
RENOVATIONS
VPS - DESTIN-FORT
WALTON BEACH
AIRPORT**

Drawing Name:

**DETAIL VIEWS - TROUGH
SINKS**

Date: **09-19-2025**


Sheet Number:
A-515

Scale: **1 1/2" = 1'-0"**


Drawing Number:
24-201.01

© ICE-ENG 2025


BD SET

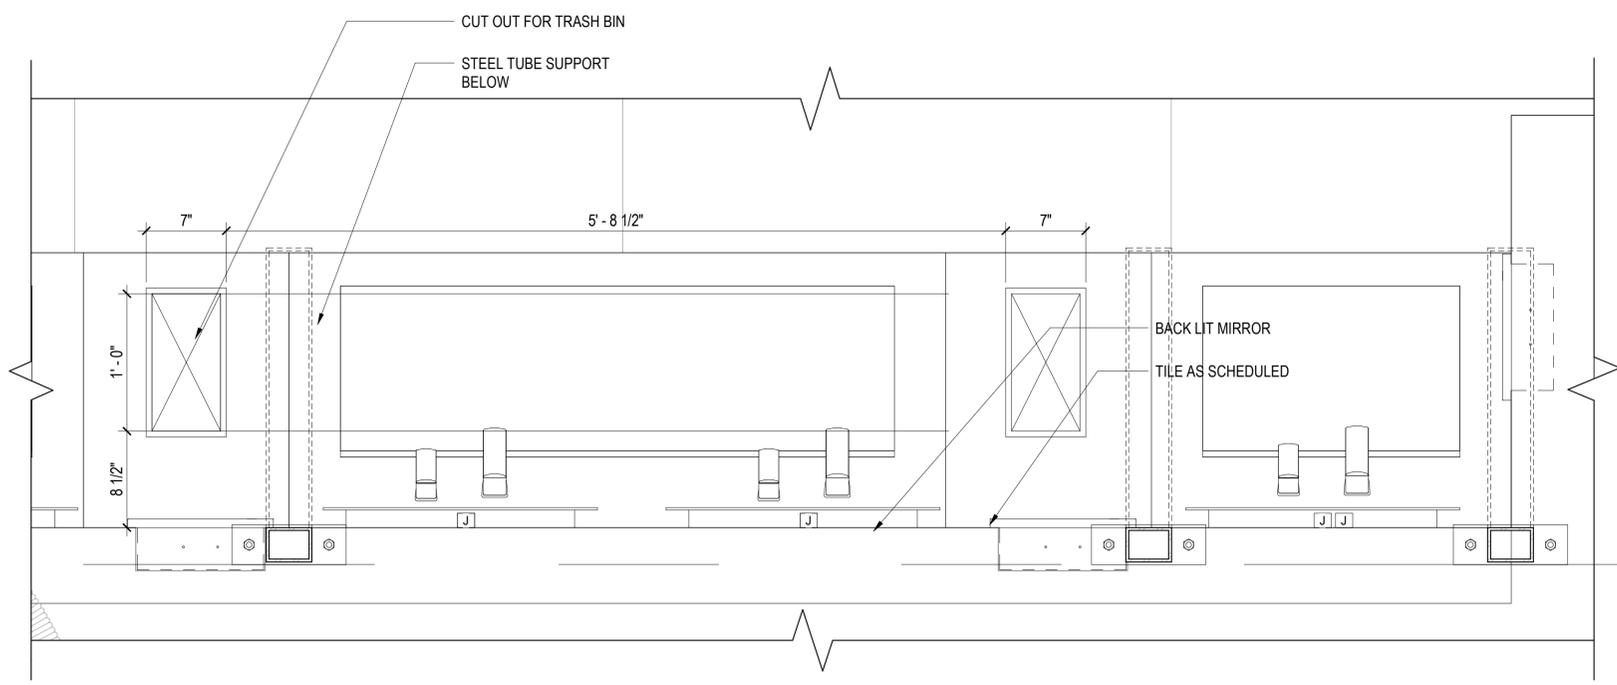


1 ENLARGED 'B' WOMENS & JANITORIAL FLOOR PLAN
SCALE: 1 1/2" = 1'-0"

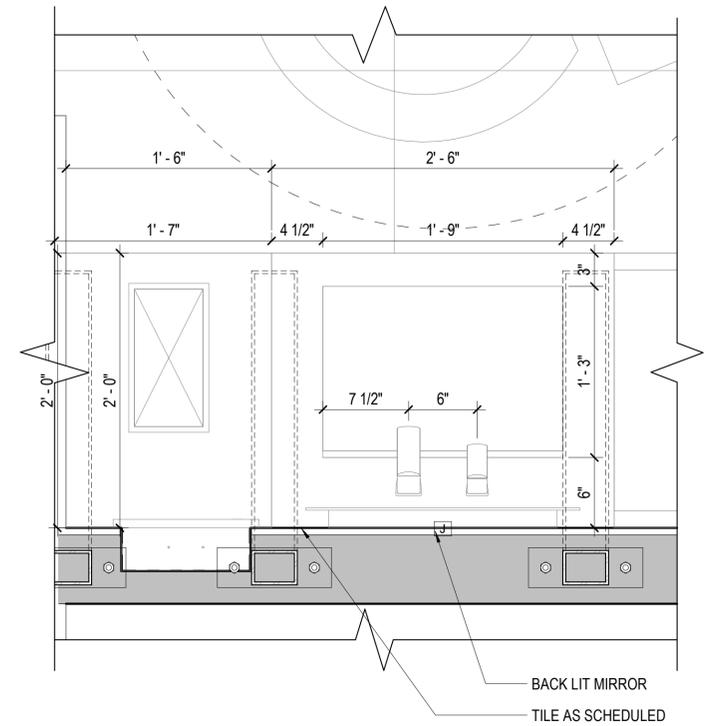

2 ENLARGED 'B' WOMENS & JANITORIAL FLOOR PLAN
SCALE: 1 1/2" = 1'-0"

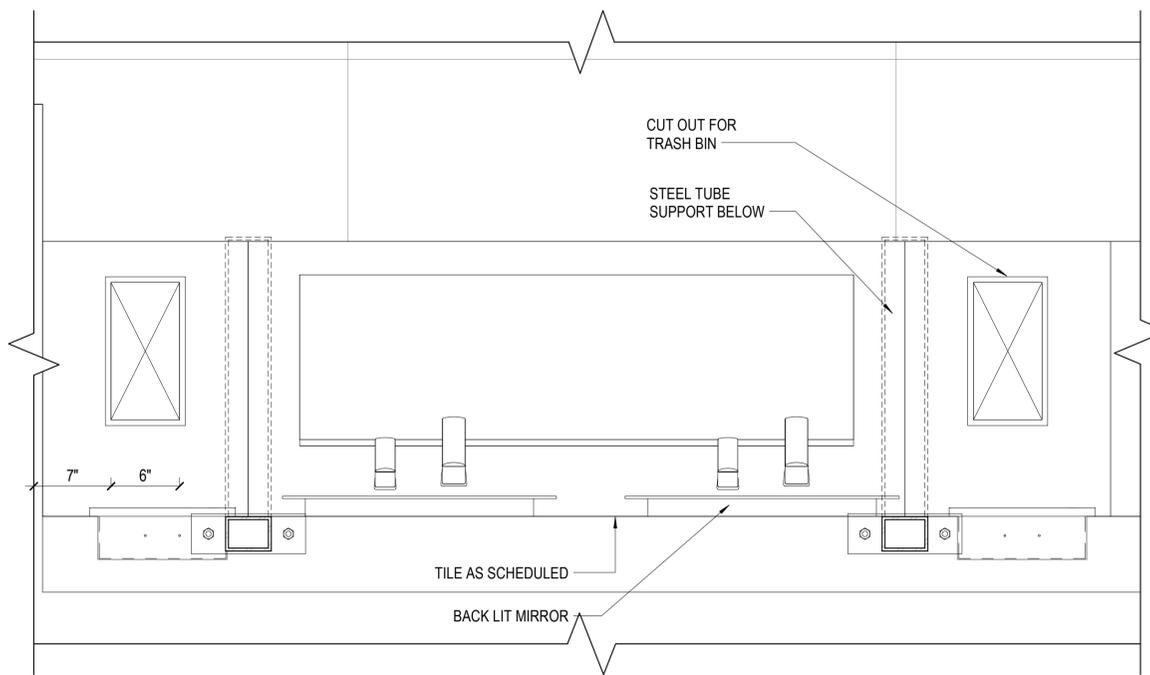

3 ENLARGED 'B' WOMENS & JANITORIAL FLOOR PLAN
SCALE: 1 1/2" = 1'-0"

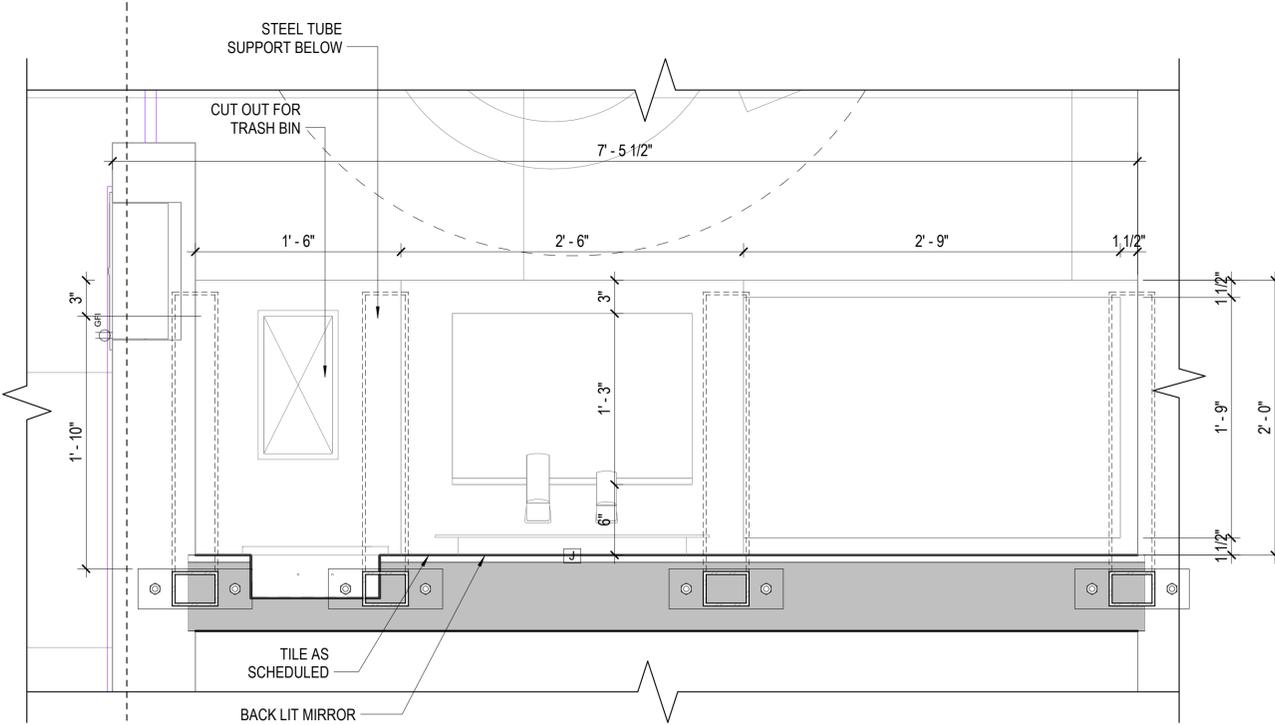

4 ENLARGED 'B' WOMENS & JANITORIAL FLOOR PLAN
SCALE: 1 1/2" = 1'-0"

SCHEDULE - DOOR - ALL

DOOR NUMBER	TYPE	SIZE			DOOR LEAF		FRAME		DETAILS		RATING		DOOR HARDWARE SET	COMMENTS
		HEIGHT	WIDTH	THICKNESS	TYPE	DOOR FINISH	TYPE	FRAME FINISH	HEAD	JAMB	FIRE	STC		
101	D1Q	7'-0"	3'-0"	2"	WDSC	WS1	HM	P4	H1	J1			2	ACOUSTIC MORTISED DOOR BOTTOM SEAL. MATCH FRAME COLOR W/ ADJACENT EXISTING DOOR
102E	D1Q	7'-0"	3'-0"	2"	HM		X-HM						(none)	EXISTING DOOR TO REMAIN (NIC)
104E	D1Q	7'-0"	3'-0"	2"	WDSC	WS1	X-HM	P3	H1	J1			1	
106E	D1Q	7'-0"	3'-0"	2"	WDSC	WS1	X-HM	P3	H1	J1			1	
201	D1AA	7'-0"	2'-0"	2"	WDSC	WS1	HM	P3	H1	J1			1	
202E	D1Q	7'-0"	3'-0"	2"	WDSC	WS1	X-HM	P3	H1	J1			4	
206E	D1Q	7'-0"	3'-0"	2"	WDSC	WS1	HM	P3	H1	J1			4	
208	D1AA	7'-0"	2'-0"	2"	WDSC	WS1	X-HM	P3	H1	J1			1	ACOUSTIC MORTISED DOOR BOTTOM SEAL.
209E	D1Q	7'-0"	3'-0"	2"	WDSC	WS1	HM	P3	H1	J1			3	
219	D1BB	7'-0"	3'-4"	2"	WDSC	P2	WD						5	TEMPORARY COSNTRUCTION BARRIER DOOR - BAGCLAIM
220	D1Q	7'-0"	3'-0"	2"	WDSC	P2	WD						5	TEMPORARY COSNTRUCTION BARRIER DOOR - CONCOURSE B
223	D1AA	7'-0"	2'-0"	2"	WDSC	WS1	HM	P3	H1	J1			1	ACOUSTIC MORTISED DOOR BOTTOM SEAL. CONCEALED HINGES.
228	D1Q	7'-0"	3'-0"	2"	(none)	(none)	(none)						(none)	NIC
229	D1BB	7'-0"	3'-4"	2"	WDSC	P2	WD						5	TEMPORARY CONSTRUCTION BARRIER DOOR - CONCOURSE A
302E	D1Q	7'-0"	3'-0"	2"	WDSC	WS1	X-HM	P3	H1	J1			3	
303	D1AA	7'-0"	2'-0"	2"	WDSC	WS1	HM	P3	H1	J1			1	ACOUSTIC MORTISED DOOR BOTTOM SEAL.
305	D1AA	7'-0"	2'-0"	2"	WDSC	WS1	HM	P3	H1	J1			1	
306E	D1Q	7'-0"	3'-0"	2"	WDSC	WS1	X-HM	P3	H1	J1			2	45 MIN
307E	D1Q	7'-0"	3'-0"	2"	WDSC	WS1	X-HM	P3	H1	J1			2	45 MIN
308	D1AA	7'-0"	2'-0"	2"	WDSC	WS1	HM	P3	H1	J1			1	
311	D1AA	7'-0"	2'-0"	2"	WDSC	WS1	HM	P3	H1	J1			1	ACOUSTIC MORTISED DOOR BOTTOM SEAL.

NOTE: CONTRACTOR TO VERIFY IN THE FIELD AND COORDINATE ALL DOOR SIZES WITH EXISTING DOOR FRAMES (X-HM) TO REMAIN.



INFRASTRUCTURE CONSULTING & ENGINEERING ARCHITECTURE 5550 W. Idlewild Ave. Suite 115 Tampa, FL 33634 813-803-8928

Consultant: Designed by: KGL Drawn by: JCL Checked by: EL Project Number: 24-201.01



TYPE	DESCRIPTION
-	NONE
AC	ACCESS
AL	ALUMINUM
HM	HOLLOW METAL
MSS	METAL SCREEN AND STORM
PAM	PRE-ASSEMBLED METAL
SS	STANDARD STEEL
WD	WOOD
X-HM	EXISTING HOLLOW METAL TO REMAIN



No.	Description	Date

Key Name	Hardware
1	STOREROOM
2	STOREROOM W/ CLOSER
3	PRIVACY
4	STOREROOM W/ KICKPLATE
5	STOREROOM, TEMPORARY CONSTRUCTION BARRIER DOOR


Project Name: RESTROOM RENOVATIONS VPS - DESTIN-FORT WALTON BEACH AIRPORT

Drawing Name: DOOR SCHEDULE & ELEVATIONS Date: 09-19-2025 Sheet Number: A-601 Scale: As indicated Drawing Number: 24-201.01


1 H1 - HOLLOW METAL FRAME HEAD DETAIL SCALE: 1 1/2" = 1'-0"

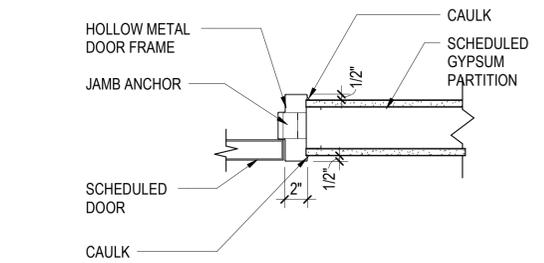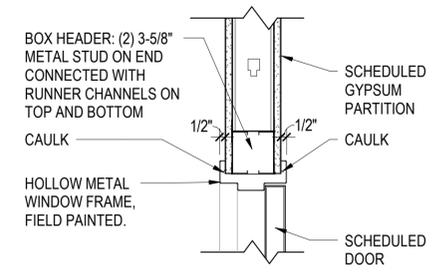

2 J1 - HOLLOW METAL FRAME JAMB DETAIL (INTERIOR) SCALE: 1 1/2" = 1'-0"

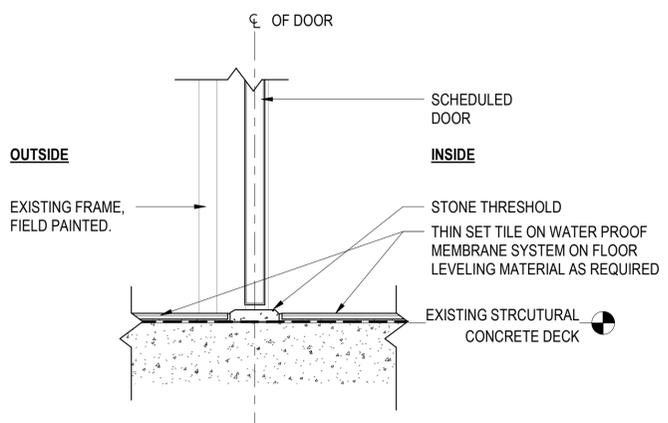

3 S2 - HOLLOW METAL FRAME SILL DETAIL @ FAMILY RESTROOM SCALE: 1 1/2" = 1'-0"

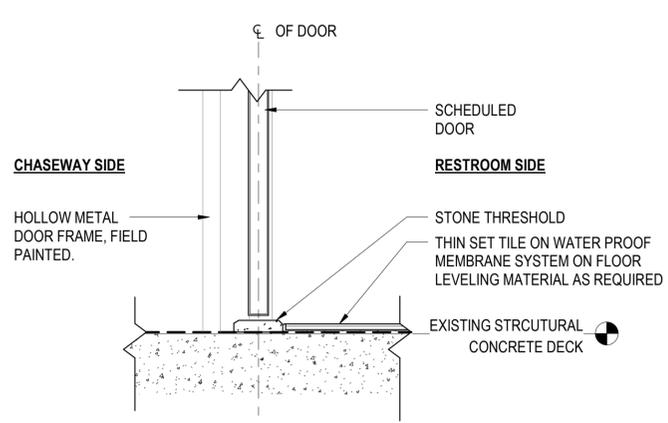

4 S1 - HOLLOW METAL FRAME SILL DETAIL @ CHASEWAY DOORS SCALE: 1 1/2" = 1'-0"

LEGEND - DOOR LEAF

Table with 2 columns: DESCRIPTION, containing items like HOLLOW METAL, WOOD FLUSH (SOLID CORE), OVERHEAD COILING, FOLDING, PLYWOOD- TEMPORARY CONSTRUCTION DOOR.


LEGEND - DOOR FRAME

Table with 2 columns: TYPE, DESCRIPTION, containing items like AC, AL, HM, MSS, PAM, SS, WD, X-HM.

KEY - DOOR HARDWARE SETS

Table with 2 columns: Key Name, Hardware, containing items like 1 STOREROOM, 2 STOREROOM W/ CLOSER, etc.

SEE SPECIFICATIONS MANUAL FOR DETAILED DOOR HARDWARE SET PERFORMANCE SPECIFICATIONS



DOOR ELEVATION

SCALE: 1/4" = 1'-0"

KEYNOTES

T-2 HAND WASHING SOAP RESERVOIR
 T-4 SOAP TUBING

STERN MULTIFEED SOAP DISPENSER KIT:
 25 L SOAP RESERVOIR AT STAINLESS STEEL TABLE LOCATIONS (A15).
 6 L (1.6 US GALLON) RESERVOIRS WITH SS WALL MOUNTING BRACKETS AS NEEDED. MOUNT APPROX. 3'-0" AFF.

CONTRACTOR TO COORDINATE W/ MANUFACTURER ON RECOMMENDATIONS FOR QUANTITY OF TUBE FEEDS PER RESERVOIR. QUANTITY OF RESERVOIRS, SIZES OF RESERVOIRS AND VERIFY TUBE FEED LENGTHS ARE BELOW THE MANUFACTURERS RECOMMENDED MAXIMUM DISTANCES. SUBMIT MARKUP OF PLAN FOR ARCHITECT REVIEW WITH SIZES AND QUANTITIES OF SOAP DISPENSING EQUIPMENT COMPONENTS.

SECURE TUBING RUNS THROUGH WALLS AS NEEDED W/ FOAM INSULATION OR EQUAL. INSTALL ALL THROUGH WALL PENETRATIONS WITH "WALL EYE" WALL PORT OR WALL GROMMET EQUIVALENT.

SOAP DISPENSERS NOT SHOWN TO BE CONNECTED TO A MULTI-FEED SOAP RESERVOIR (FAMILY & ADA STALL LAVATORIES) TO BE STANDARD BELOW COUNTER SOAP RESERVOIRS.

WALL RECESSED RETRACTABLE BELT BARRIER:
 BETLRAC CONCEALED MOUNT WALL UNIT - * PLEASE DO NOT ENTER*
 50-3012FY/S6 BY LAVI INDUSTRIES
 SETON EASY EXTEND SAFETY BARRIER RECEIVER CLIP OR COMPATIBLE EQUAL.
 MOUNT 36" AFF.


ACCESSORIES			
#	DESCRIPTION	BASIS OF DESIGN	COMMENTS
	<varies>	<varies>	
A01	TRASH RECEPTACLE, PLASTIC	10.3 GAL, 15.5" X 11" X 20.75" H	
A02	SURFACE-MOUNTED SANITARY NAPKIN DISPOSAL	BOBRICK, B-35139	BRUSHED SS
A03	CLASSIC SERIES SURFACE MOUNTED TWIN JUMBO-ROLL TOILET TISSUE DISPENSER	BOBRICK, B-2892	SATIN FINISH
A04	CLASSIC SERIES SURFACE MOUNTED SEAT COVER DISPENSER	BOBRICK, B-221	SATIN FINISH
A05	GRAB BAR - REAR WALL	BOBRICK, B-6806-36	
A06	LED Backlit Mirror	BOBRICK, B-164 2436	
A07	RECESSED PAPER TOWEL DISPENSER	BOBRICK, B-359033	SATIN FINISH
A08	GRAB BAR - 42" SIDE WALL	BOBRICK, B-6806-42	
A09	SANITARY NAPKIN DISPENSER	BOBRICK, B-47064-25	CONTURA SERIES, SEMI-RECESSED, 25 CENT OPERATION
A10	RECESSED SHARP DISPOSAL	BOBRICK, B-35016	RECESSED, CONTRACTOR TO VERIFY WALL DEPTH COMPATIBILITY PRIOR TO SUBMITTAL REVIEW & ORDERING
A11	RECESSED PAPER TOWEL DISPENSER/ WASTE RECEPTACLE	BOBRICK, B-38034	RECESSED, CONTRACTOR TO VERIFY WALL DEPTH COMPATIBILITY PRIOR TO SUBMITTAL REVIEW & ORDERING
A12	FULL LENGTH MIRROR	SIMILAR TO BOBRICK B-290	REF. TO RESTROOM ELEVATIONS FOR SIZES
A13	BABY CHANGING TABLE	KB310-SSRE	Baby Changing Station
A14	COAT HOOK WITH BUMPER	BOBRICK, B-9541	FINO COLLECTION
A15	STAINLESS STEEL TABLE	ULINE H-8448	STAINLESS STEEL WORKTABLE W/ BOTTOM SHELF - 24"x 24"

A


B

C

D

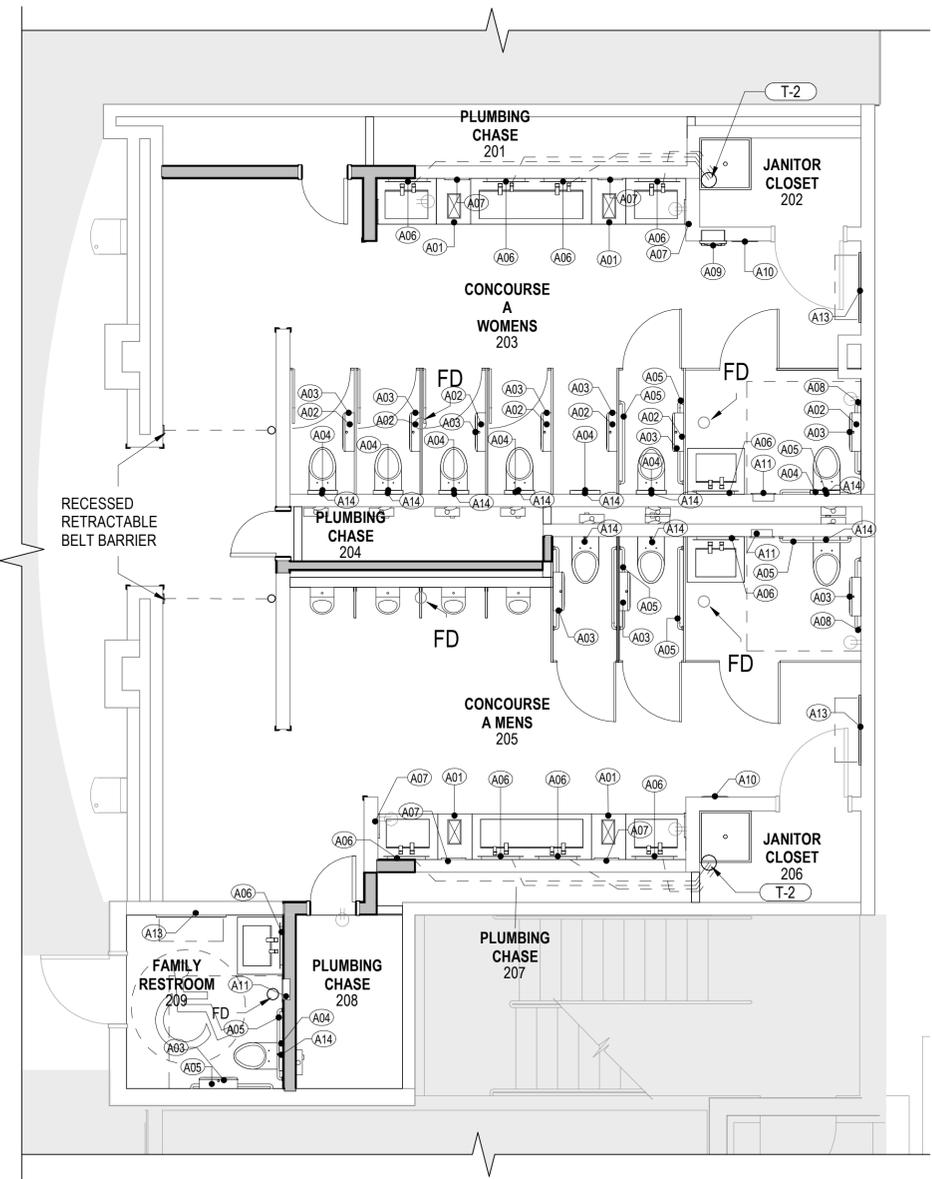

1 FINISH FLOOR PLAN: A
 SCALE: 1/4" = 1'-0"

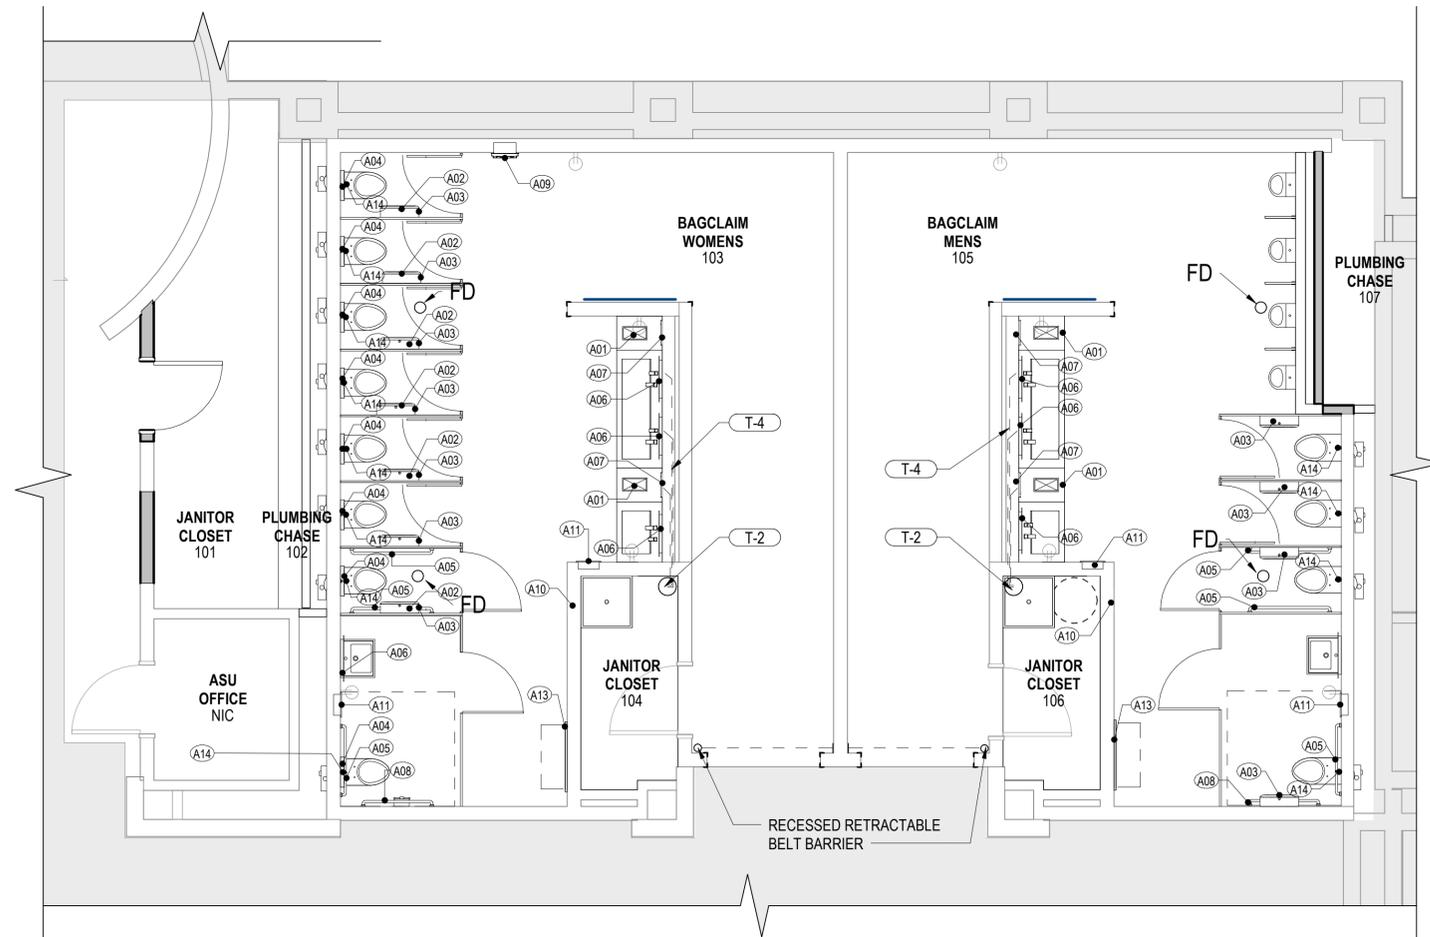


2 FINISH FLOOR PLAN: BAGCLAIM
 SCALE: 1/4" = 1'-0"



INFRASTRUCTURE
 CONSULTING & ENGINEERING
ARCHITECTURE
 5550 W. Idlewild Ave. Suite 115
 Tampa, FL 33634
 813-803-8928

Consultant:
 Designed by: **KCL**
 Drawn by: **JL**
 Checked by: **EL**
 Project Number: **24-201.01**

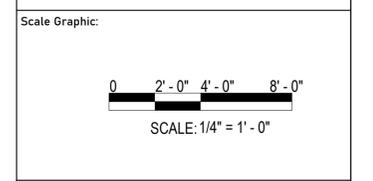


REVISIONS		
No.	Description	Date

Project Name:
RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT


Drawing Name:
ACCESSORY PLAN

Date: 09-19-2025
 Sheet Number: **A-801**
 Scale: 1/4" = 1'-0"
 Drawing Number: 24-201.01


BID SET

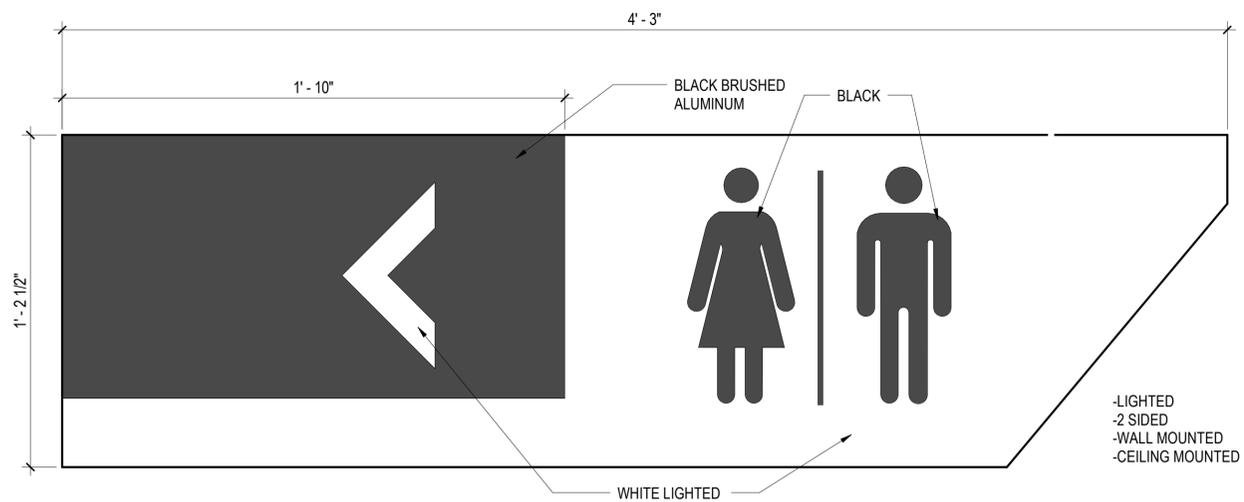


1 SIGN TYPE 1 - RESTROOMS
SCALE: 3" = 1'-0"

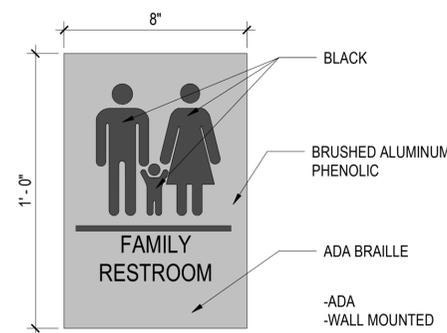


6 SIGN TYPE 3 - FAMILY ROOM
SCALE: 3" = 1'-0"

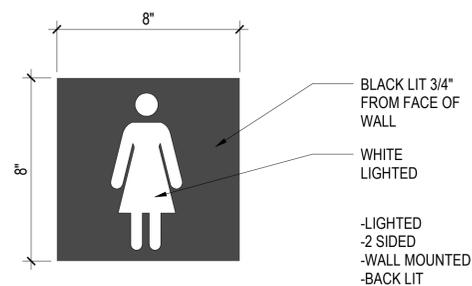


2 SIGN TYPE 2 - FEMALE
SCALE: 3" = 1'-0"

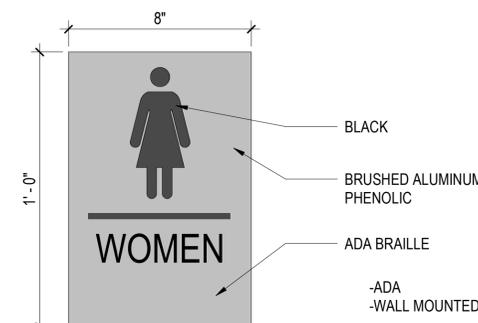

4 SIGN TYPE 3 - FEMALE
SCALE: 3" = 1'-0"

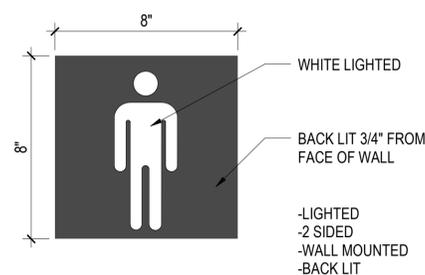

3 SIGN TYPE 2 - MALE
SCALE: 3" = 1'-0"

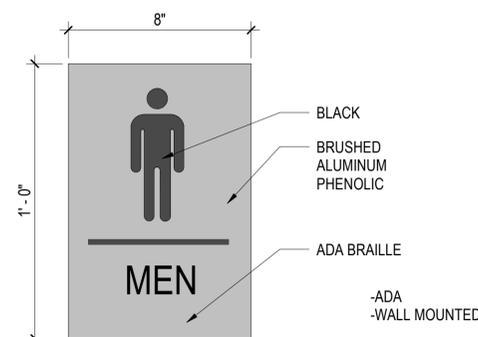


5 SIGN TYPE 3 - MALE
SCALE: 3" = 1'-0"




JE INFRASTRUCTURE
CONSULTING & ENGINEERING
ARCHITECTURE
5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Consultant:
Designed by: **KGL**
Drawn by: **JGS**
Checked by: **EL**
Project Number: **24-201.01**



Notes:

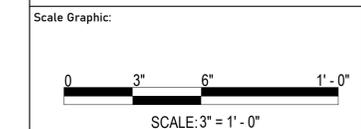

REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
SIGNAGE RESTROOM

Date: **09-19-2025** Sheet Number: **A-513**
Scale: **3" = 1'-0"** Drawing Number: **24-201.01**

FIRE PROTECTION GENERAL NOTES 1/2

- 1. FIRE PROTECTION SYSTEM TO COMPLY WITH NFPA-13 AND STATE FIRE PREVENTION CODE.
2. FINAL INSPECTION AND APPROVAL BY THE AUTHORITY HAVING JURISDICTION.
3. THESE DOCUMENTS ARE FOR PRICING PURPOSES ONLY AND SHALL NOT BE USED AS "WORKING PLANS"...

FIRE PROTECTION GENERAL NOTES 2/2

- 33. FIRE PROTECTION CONTRACTOR SHALL WALK THE SITE AND FIELD VERIFY EXISTING SPRINKLER SYSTEM PRIOR TO CONSTRUCTION.
34. PROVIDE ARMORER TO ALL PENDANTS INSTALLED IN A DRY OR PREACTION SYSTEM.
35. THE CONTRACTOR SHALL INSTALL UPRIGHT SPRINKLERS DURING CONSTRUCTION THROUGHOUT EXPOSED CEILING AREAS...

COMPLIANCE NOTES

FLORIDA ADMINISTRATIVE CODE: 61G15-32.004

SCOPE OF WORK

PARTIAL RENOVATION OF AN AUTOMATIC FIRE PROTECTION SYSTEM DESIGNED IN COMPLIANCE WITH THE APPLICABLE NFPA STANDARDS LISTED WITHIN THESE DOCUMENTS.

ACCEPTANCE TEST CRITERIA

SHALL COMPLY WITH NFPA-13. SPRINKLER SYSTEM SHALL BE PROPERLY INSPECTED AND MAINTAINED IN ACCORDANCE WITH NFPA-25 STANDARD FOR INSPECTION, TESTING, AND MAINTENANCE OF WATER BASED SYSTEM.

FAC 61G15-32.004(4)

a. POINT OF SERVICE

CITY MAIN FEEDING EXSITING BACKFLOW PREVENTER (BY CIVIL DIVISION). REFER TO CIVIL PLAN FOR LOCATION.

b. APPLICABLE NFPA STANDARDS TO BE APPLIED

FLORIDA BUILDING CODE (8TH EDITION)
NFPA 13 (2019)
NFPA 24 (2019)
NFPA 25 (2020)

c. CLASSIFICATION OF HAZARD OCCUPANCY FOR EACH ROOM OR AREA

LIGHT HAZARD = BATHROOM AREA
ORDINARY HAZARD 1 = JANITOR CLOSET, STORAGE ROOM

d. DESIGN APPROACH

LIGHT HAZARD

SPRINKLER SYSTEM TO BE ATTACHED TO SPRINKLER RISER. SYSTEM SHALL BE EXTENDED INTO ENTIRE BUILDING IN ACCORDANCE WITH NFPA-13, U.L. LIGHT HAZARD, LISTED AND APPROVED UPRIGHT, SIDEWALL & PENDANT (K-FACTOR AS NOTED) SPRINKLERS TO BE PROVIDED...

ORDINARY HAZARD (GROUP 1)

SPRINKLER SYSTEM TO BE ATTACHED TO SPRINKLER RISER. SYSTEM SHALL BE EXTENDED INTO ENTIRE BUILDING IN ACCORDANCE WITH NFPA-13, U.L. ORDINARY HAZARD, LISTED AND APPROVED UPRIGHT, SIDEWALL & PENDANT (K-FACTOR AS NOTED) SPRINKLERS TO BE PROVIDED...

ORDINARY HAZARD (GROUP 2)

SPRINKLER SYSTEM TO BE ATTACHED TO SPRINKLER RISER. SYSTEM SHALL BE EXTENDED INTO ENTIRE BUILDING IN ACCORDANCE WITH NFPA-13, U.L. ORDINARY HAZARD, LISTED AND APPROVED UPRIGHT, SIDEWALL & PENDANT (K-FACTOR AS NOTED) SPRINKLERS TO BE PROVIDED...

e. CHARACTERISTICS OF THE WATER SUPPLY TO BE USED

STREET MAIN IS CIRCULATING. MINIMUM DURATION OF 60-90 MINUTES.

f. FLOW TEST DATA:

CONTRACTOR SHALL PROVIDE FLOW TEST IN CONJUNCTION WITH HYDRAULIC CALCULATIONS.

g. VALVING AND ALARM REQUIREMENTS TO MINIMIZE POTENTIAL FOR IMPAIRMENTS AND UNRECOGNIZED FLOW OF WATER:

THE FIRE SUPPRESSION SYSTEM FOR THIS FACILITY IS SUPERVISED AND REPORTS SYSTEM STATUS (WATER FLOW, TAMPER SWITCHES, PRESSURE SWITCHES, ETC) TO A MONITORED ALARM PANEL.

THE BACKFLOW PREVENTION DEVICE SHALL BE PROVIDED WITH TAMPER SWITCHES AND CHAINED AND LOCKED IN THE OPEN POSITION (IF APPLICABLE).

h. MICROBIAL INDUCED CORROSION (MIC)

WATER SOURCE IS FROM EXISTING WELL. THERE ARE NO KNOWN CONDITIONS PRESENT THAT CONTRIBUTE TO MICROBIOLOGICAL CORROSION (M.I.C.). CONTRACTOR SHALL REEVALUATE WATER SUPPLY AND ENVIRONMENTAL CONDITIONS FOR EXISTENCE OF MICROBES AND CONDITIONS THAT CONTRIBUTE TO M.I.C. PRIOR TO START OF CONSTRUCTION...

i. BACKFLOW PREVENTION AND METERING SPECIFICATIONS

THE BACKFLOW PREVENTION DEVICE ASSEMBLY AND METERING EQUIPMENT BY CIVIL DIVISION AND MEET THE REQUIREMENTS OF THE LOCAL WATER PURVEYOR. THE MAXIMUM PRESSURE LOSS SHOULD NOT EXCEED 10 P.S.I. MAXIMUM WORKING PRESSURE 175 P.S.I. (IF APPLICABLE).

j. QUALITY AND PERFORMANCE SPECIFICATIONS OF ALL YARD AND INTERIOR FIRE PROTECTION COMPONENTS

ALL NEW YARD AND INTERIOR FIRE PROTECTION EQUIPMENT SHALL BE UL LISTED AND/OR FM APPROVED.

k. FIRE PUMP REQUIREMENT

THERE IS AN ADEQUATE WATER SUPPLY SERVING FIRE PROTECTION SYSTEM. NO FIRE PUMP IS REQUIRED.

l. WATER STORAGE TANK REQUIREMENT

THERE IS AN ADEQUATE WATER SUPPLY SERVING FIRE PROTECTION SYSTEM. NO WATER STORAGE TANK IS REQUIRED.

m. OWNER'S CERTIFICATE FOR STORAGE FACILITIES

PROPERTY IS NOT A STORAGE OCCUPANCY. OWNER'S CERTIFICATE IS NOT REQUIRED.

FIRE PROTECTION LEGEND

Table with 2 columns: SYMBOL and DESCRIPTION. Includes symbols for existing sprinkler, remove existing, new to existing, area of revision, standpipe, remove existing piping, existing piping, new piping, and revision reference.

FIRE SPRINKLER LEGEND

Table with 10 columns: SYMBOL, ORF, TEMP, RESPONSE, K-FAC, FINISH, MODEL (SIN), STYLE, NOTES, MFG. Lists various sprinkler models and their specifications.

- GENERAL NOTES:
1. ALL SPRINKLERS INSTALLED IN CORROSIIVE, UNCONDITIONED, ATTICS, OR EXTERIOR ENVIRONMENTS SHALL HAVE CORROSION RESISTANT FINISH...
2. TEMPERATURES NOTED MAY VARY DUE TO HEATING DUCTS, LIGHTS, AND OTHER HEAT SOURCES...

FIRE PROTECTION SPECIFICATIONS

- 1.0 GENERAL PROVISIONS
1. PROVIDE ALL LABOR, MATERIAL AND EQUIPMENT FOR A COMPLETE AND PROPERLY OPERATING FIREPROTECTION SYSTEM.
2. CODES AND STANDARDS: THE FIRE SPRINKLER PROTECTION SYSTEMS INSTALLATION, FLUSHING AND TESTING SHALL COMPLY WITH THE REQUIREMENTS OF NFPA 13 AND 24...
3.0 FIRE PROTECTION VALVES AND ACCESSORIES
1. SPRINKLERS (AS SPECIFIED, NO EXCEPTIONS):
A. UPRIGHT, PENDENT, AND SIDEWALL STYLES: WHITE FINISH IN SPACES EXPOSED TO VIEW...
B. CONCEALED STYLE: ROUGH BRONZE, WITH PAINTED WHITE COVER PLATE...

PIPE MATERIAL SPECIFICATION

Table with 4 columns: LOCATION USED, MATERIAL, DIAMETER, SCHEDULE. Lists pipe specifications for underground, in-building riser, fire riser, standpipe, commercial, residential, and exterior/dry.

A

B

C

D



INFRASTRUCTURE CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave., Suite 115
Tampa, FL 33634
813-803-8928

Engineering Professionals, Inc. Mechanical Engineers EB-0006437
912 W. Dr. Martin Luther King, Jr Blvd
Tampa, FL 33603 (813) 251-6848

Table with 2 columns: Field Name and Value. Includes fields for Consultant, Designed by (HC), Drawn by (HC), Checked by (SRH), Project Number, and Notes.

Table with 2 columns: Field Name and Value. Includes fields for Scale Graphic and Revisions.

Table with 3 columns: No., Description, Date. Used for tracking revisions.

Project Name: RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT

Drawing Name: FIRE PROTECTION LEGENDS, NOTES, SCHEDULES

Table with 2 columns: Field Name and Value. Includes Date (09/19/2025), Sheet Number (FP-001), Scale (12" = 1'-0"), and Drawing Number.



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Engineering Professionals, Inc.
Mechanical Engineers
EB-0006437

912 W. Dr. Martin Luther King, Jr Blvd
Tampa, FL 33603 (813) 251-6848

Designed by:	HC
Drawn by:	HC
Checked by:	SRH
Project Number:	

SHANE R. HAMILTON P.E.
FLORIDA LICENSE #75420

Notes:

Scale Graphic:

REVISIONS		
No.	Description	Date
1	Bid Set	09/19/2025

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
BATHROOMS RENOVATION PLAN

Date:	09/19/2025	Sheet Number:	FP-101
Scale:	As indicated	Drawing Number:	

KEYNOTES

- 1 RELOCATE EXISTING SPRINKLER HEADS TO ACCOMMODATE NEW LIGHT FIXTURES AND HVAC AIR DEVICES PER NFPA 13. MAINTAIN SPRINKLER COVERAGE DURING DEMOLITION. MINIMIZE DOWNTIME AND COORDINATE SPRINKLER SYSTEM SHUTDOWNS WITH OWNER.
- 2 NEW STORAGE AREA. ORDINARY 1 HAZARD, INSTALL NEW UPRIGHT SPRINKLERS TO PROVIDE DISCHARGE DENSITY OF 0.20 GPM PER NFPA 13.
- 3 EXTEND 1" BRANCH PIPE FROM EXISTING SPRINKLER LOCATION TO NEW LOCATION SERVING NEW UPRIGHT SPRINKLERS.
- 4 RELOCATE ANY EXISTING SPRINKLER HEADS.
- 5 FOLLOW NFPA 13 (2025) TABLE 11.2.5.1.2(a) & FIGURE 11.2.5.1.2(b) FOR OBSTRUCTIONS AGAINST WALLS.

SPRINKLER MAINTENANCE REQUIREMENT:

- ANY SPRINKLER THAT SHOWS SIGNS OF ANY OF THE FOLLOWING SHALL BE REPLACED:
- 1. LEAKAGE
 - 2. CORROSION DETRIMENTAL TO SPRINKLER PERFORMANCE
 - 3. PHYSICAL DAMAGE
 - 4. LOSS OF FLUID IN THE GLASS BULB HEAT-RESPONSIVE ELEMENT
 - 5. LOADING DETRIMENTAL TO SPRINKLER PERFORMANCE
 - 6. PAINT, OTHER THAN THAT APPLIED BY THE SPRINKLER MANUFACTURER, DETRIMENTAL TO SPRINKLER PERFORMANCE


REFERENCE: NFPA 25 (2023), SECTIONS 5.2.1.1.1

SPRINKLER INCORRECT ORIENTATION REQUIREMENT:

ANY SPRINKLER THAT HAS BEEN INSTALLED IN THE INCORRECT ORIENTATION SHALL BE CORRECTED BY REPOSITIONING THE BRANCH LINE, DROP, OR SPRIG, OR SHALL BE REPLACED.


REFERENCE: NFPA 25 (2023), SECTIONS 5.2.1.1.2

SPRINKLERS TO BE TURNED UP DURING CONSTRUCTION AND NEW SPRINKLERS INSTALLED IN NEW CEILING. COORDINATE SPRINKLER SYSTEM SHUTDOWNS WITH OWNER.

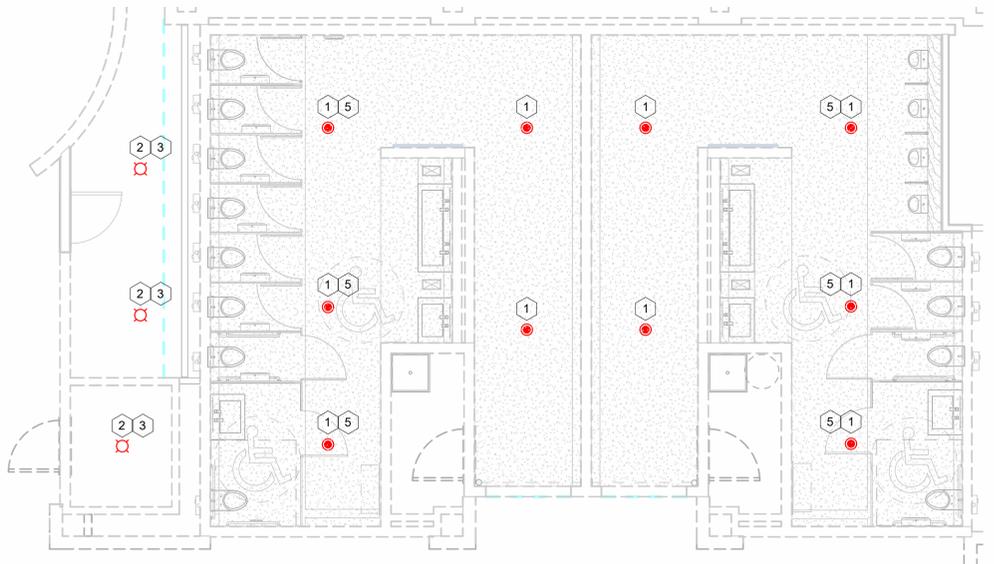


1 FP - BAGCLAIM RENOVATION PLAN
3/16" = 1'-0"

EPI 25.0099

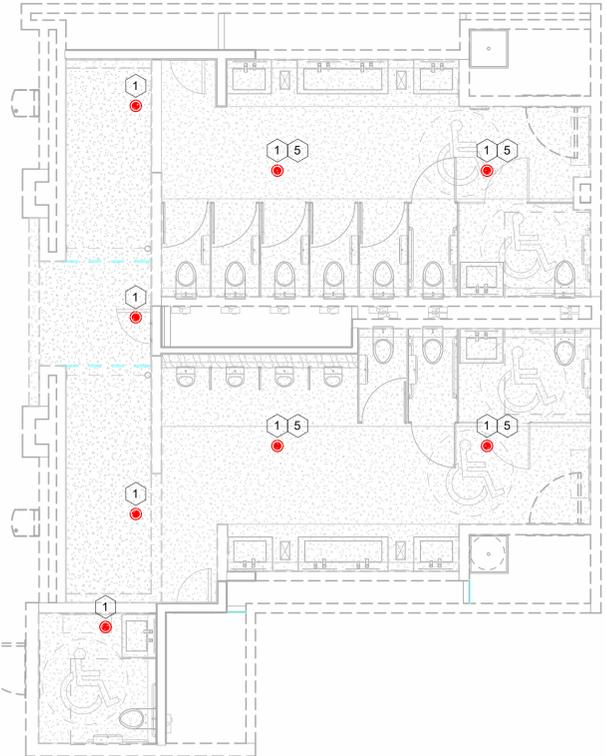

2 FP - CONCOURSE 'A' RENOVATION PLAN
3/16" = 1'-0"

EPI 25.0099

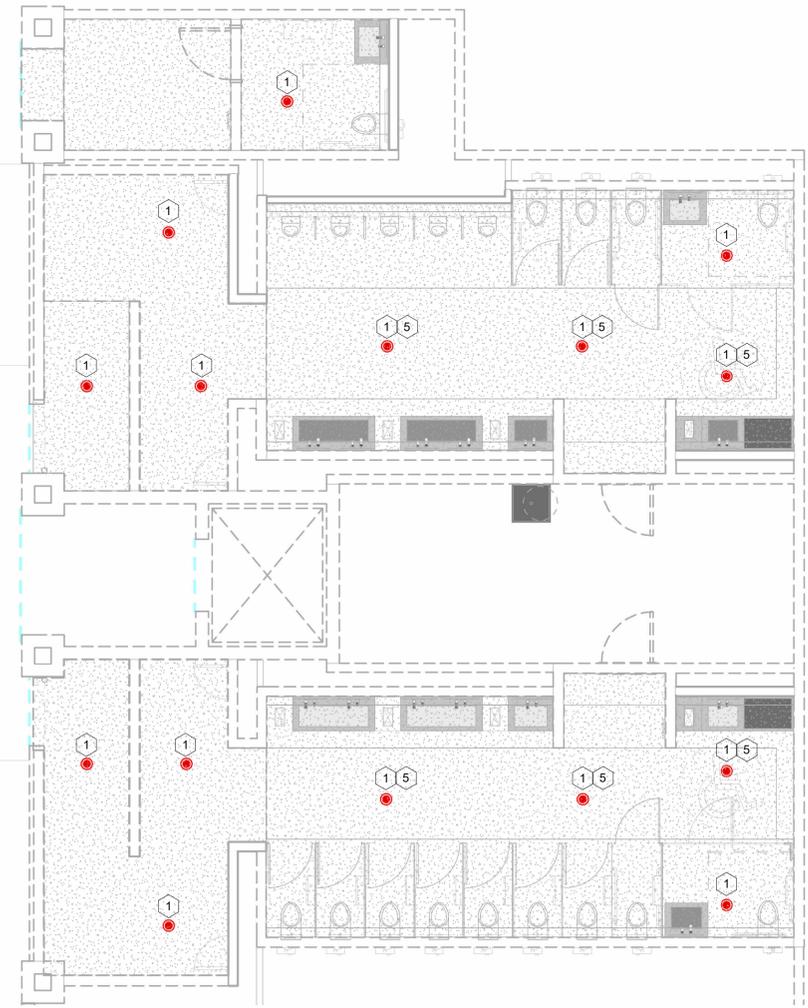

3 FP - CONCOURSE 'B' RENOVATION PLAN
3/16" = 1'-0"


EPI 25.0099

A

B

C


D

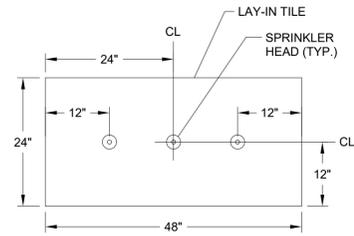

NOTESPRINKLER HEADS SHALL BE LOCATED IN CENTER THIRD OF 24"x48" CEILING TILES, UNLESS SHOWN OTHERWISE


TYPICAL PLACEMENT OF SPRINKLER

NO SCALE

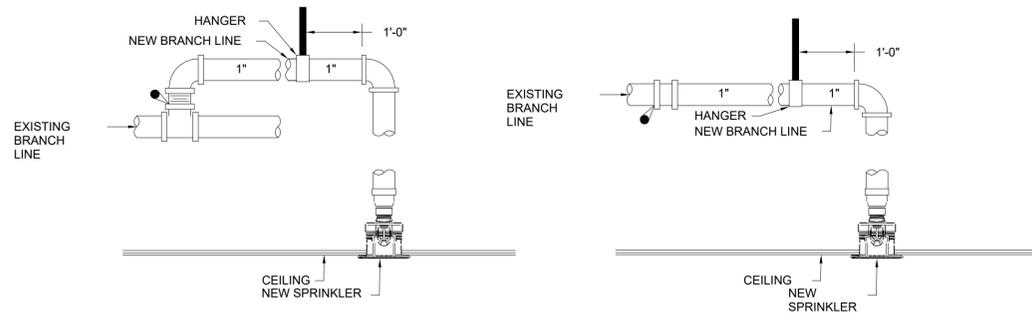


SPRINKLER INSTALLATION DETAIL

NOT TO SCALE

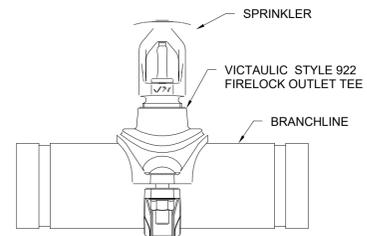

UPRIGHT SPRINKLER DETAIL

NO SCALE

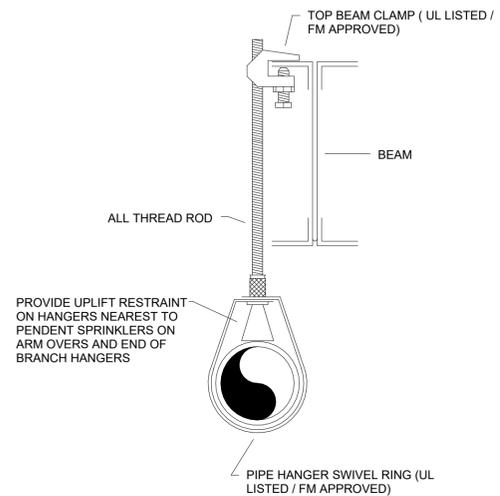

HANGER - STEEL

NO SCALE



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Engineering Professionals, Inc.

Mechanical Engineers
EB-0006437
912 W. Dr. Martin Luther King, Jr Blvd
Tampa, FL 33603 (813) 251-6848

Consultant	
Designed by:	HC
Drawn by:	HC
Checked by:	SRH
Project Number:	
SHANE R. HAMILTON P.E. FLORIDA LICENSE #75420 Seal	

Notes:

Scale Graphic:

REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
DETAILS

Date:	09/19/2025	Sheet Number:	FP-501
Scale:		Drawing Number:	

A

B

C

D

1

2

3

4

5



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Engineering Professionals, Inc.

Mechanical Engineers
EB-0006437
912 W. Dr. Martin Luther King, Jr Blvd
Tampa, FL 33603 (813) 251-6848

Consultant	
Designed by:	YZ
Drawn by:	YZ
Checked by:	SRH
Project Number:	
SHANE R. HAMILTON P.E. FLORIDA LICENSE #75420	

Notes:


Scale Graphic:

REVISIONS		
No.	Description	Date
1	Bid Set	09/19/2025


Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
PLUMBING RISER DIAGRAMS


Date:	09-19-2025	Sheet Number:	P-301
Scale:		Drawing Number:	

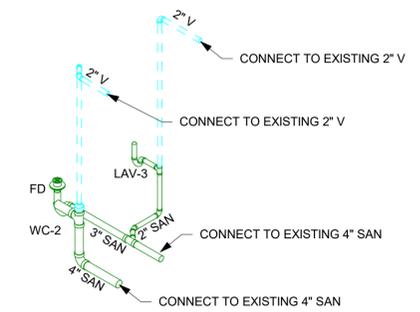


① SANITARY RISER DIAGRAM - CONCOURSE A

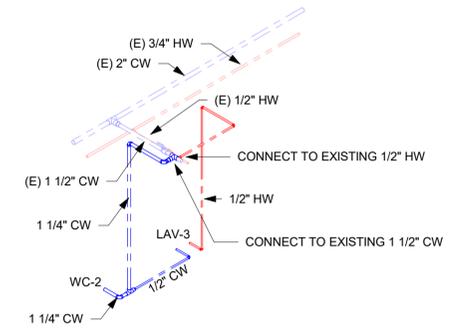

② WATER RISER DIAGRAM - CONCOURSE A

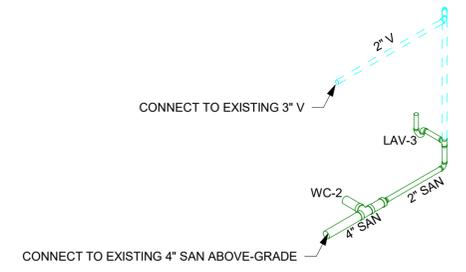

③ SANITARY RISER DIAGRAM - CONCOURSE B (2ND FLR)

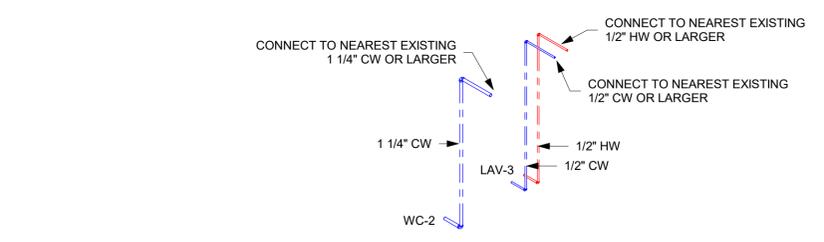

④ WATER RISER DIAGRAM - CONCOURSE B (2ND FLR)


1

2

3

4

5

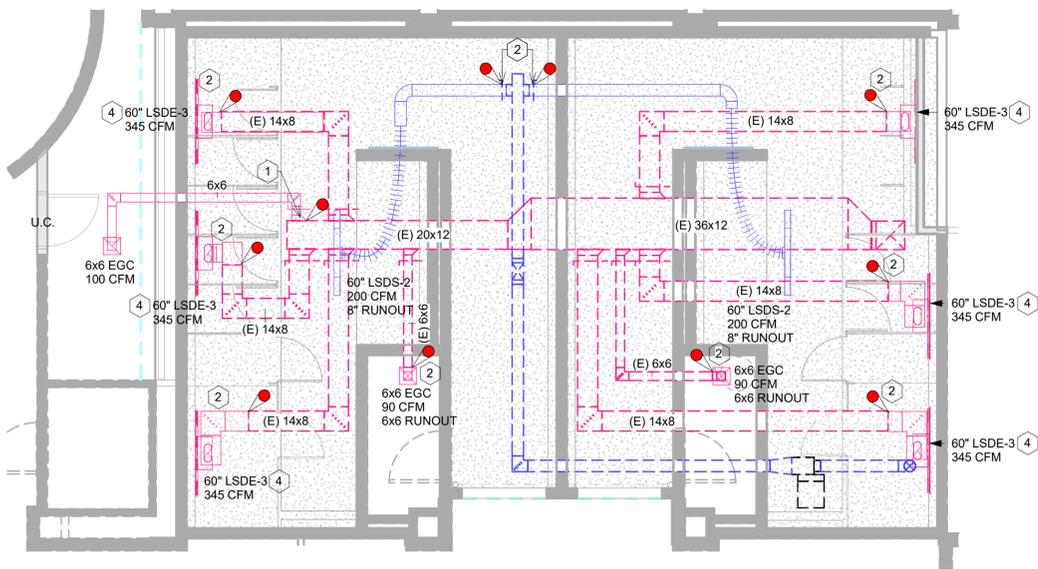


1 BAGCLAIM RENOVATION FLOOR PLAN
3/16" = 1'-0"

EPI 25.0099


NOTES:
 - DEEP CLEANING OF ALL EXISTING DUCTWORK TO REMAIN. DUCT CLEANING SHALL EXTEND FROM EXISTING VAV BOXES THROUGHOUT EXISTING SUPPLY DUCTWORK AND TERMINATING AT THE EXISTING SUPPLY AIR DEVICE OUTLET/INLET SURFACES. PERFORM SIMILAR CLEANING FOR EXHAUST DUCTS FROM THE EXTERIOR OUTLET AND THROUGHOUT INTERIOR DUCTWORK TERMINATING AT THE EXHAUST AIR DEVICE INLET SURFACE.
 - FIELD VERIFY EXISTING CFM OF SUPPLY AIR DEVICES AND EXHAUST AIR DEVICES. REBALANCE AS/IF REQUIRED.

RENOVATION NOTES
 1 TAP EXISTING EXHAUST DUCTWORK WITH NEW AND CONNECT TO NEW EGC.
 2 FIELD MODIFY EXISTING SUPPLY DUCTWORK AND EXHAUST DUCTWORK TO CONNECT NEW LINEAR SUPPLY/EXHAUST DIFFUSERS. PROVIDE DUCT TRANSITIONS AS REQUIRED.
 3 TAP EXISTING SUPPLY DUCTWORK WITH NEW AND CONNECT TO NEW LSDE.
 4 PROVIDE FULL SIZE DUCT FROM LSD PLENUM BOX AND TAP BOTTOM OF MAIN DUCTWORK OR CONNECT TO EXTENDED DUCTWORK.

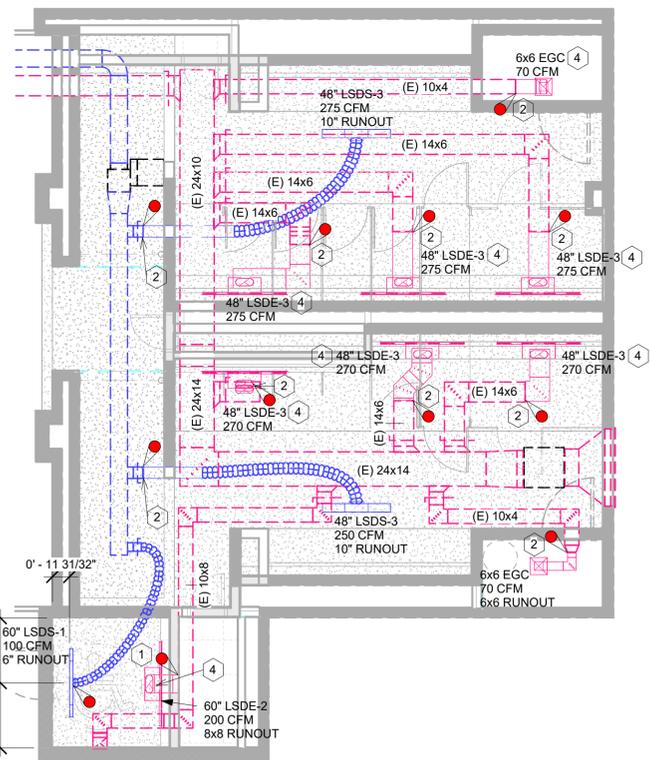

2 CONCOURSE 'A' RENOVATION FLOOR PLAN
3/16" = 1'-0"

EPI 25.0099

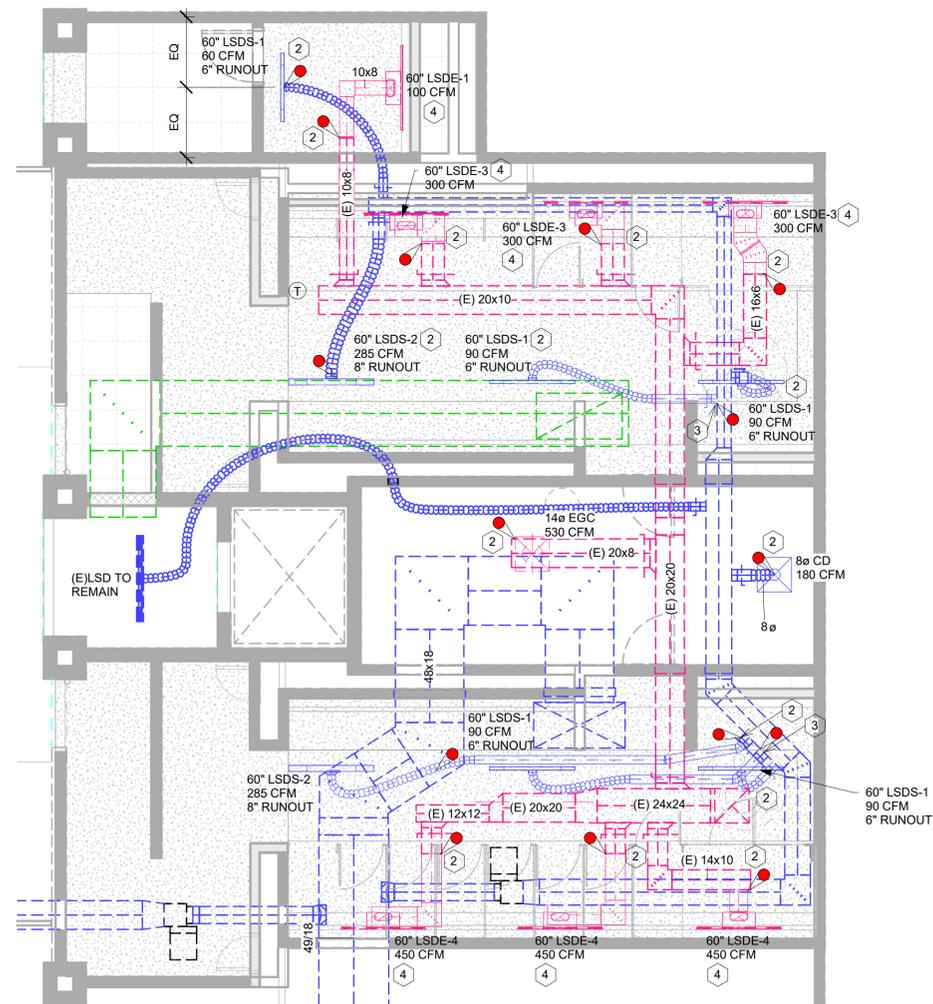

3 CONCOURSE 'B' RENOVATION FLOOR PLAN
3/16" = 1'-0"

EPI 25.0099



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928

Engineering
Professionals, Inc.

Mechanical Engineers
EB-0006437
912 W. Dr. Martin Luther King, Jr Blvd
Tampa, FL 33603 (813) 251-6848

Consultant

Designed by:	ES
Drawn by:	ES
Checked by:	SRH
Project Number:	

SHANE R. HAMILTON P.E.
FLORIDA LICENSE #75420

Notes:

Scale Graphic:
 0 4'-0" 8'-0" 16'-0"
 SCALE: 0' - 0 1/8" = 1' - 0"

REVISIONS		
No.	Description	Date
1	Bid Set	09/19/2025

Project Name:
**RESTROOM RENOVATIONS
 VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
BATHROOMS RENOVATION FLOOR PLAN

Date: 09/19/2025
 Scale: As indicated

Sheet Number: M-102
 Drawing Number:

A

B

C

D

ELECTRICAL SYMBOL LEGEND		
SYMBOL	DESCRIPTION	MOUNTING
	LED STRIP FIXTURE WITH REQUIRED MOUNTING HARDWARE; 4' OR 8' AS SHOWN ON PLANS, LETTER INDICATES TYPE.	SEE FIXTURE SCHEDULE
	RECESSED DOWNLIGHT, WALLWASH WITH TRIM AND REQUIRED CEILING ADAPTERS. LETTER INDICATES TYPE.	SEE FIXTURE SCHEDULE
	FIXTURES SHOWN WITH A SOLID HATCHED SHALL BE CONNECTED TO THE EMERGENCY BRANCH.	N/A
	2' X 4' LED TROFFER, LETTER INDICATES TYPE.	SEE FIXTURE SCHEDULE
	2' X 2' LED TROFFER, LETTER INDICATES TYPE.	SEE FIXTURE SCHEDULE
	EXISTING LIGHT FIXTURE, FIXTURE WITH DASHED LINE TO BE DEMOLISHED, FIXTURE IDENTIFIED WITH 'RL' TO BE RELOCATED, FIXTURE IDENTIFIED WITH 'EX' TO REMAIN.	AS EXISTING
	EXIT LIGHT, SHADING INDICATES NUMBER OF FACES, ARROWS INDICATE DIRECTIONAL INDICATORS REQUIRED. LETTER INDICATES TYPE.	SEE FIXTURE SCHEDULE
	BATTERY POWERED EMERGENCY EGRESS LIGHT WITH WALL BRACKET, (2) HEAD UNLESS OTHERWISE NOTED. LETTER INDICATES TYPE.	SEE FIXTURE SCHEDULE
	DUAT TECHNOLOGY LOW VOLTAGE 360° CEILING SENSOR, 120/277 VAC, @ 120, 0-1000W/@277, 0-1200W BALLAST. ACUITY CONTROL MODEL # CM-PDT-10=D. OR EQUIVALENT.	CEILING
	SWITCH, SINGLE POLE, 20 A, 120/277 VAC. REFER TO SPECIFICATIONS FOR DEVICE COLOR, WALL PLATE COLOR AND MATERIAL, AND DEVICE MODEL NUMBER.	48" AFF TO TOP UNLESS NOTED OTHERWISE
	SWITCH, THREE-WAY, 20 A, 120/277 VAC. REFER TO SPECIFICATIONS FOR DEVICE COLOR, WALL PLATE COLOR AND MATERIAL, AND DEVICE MODEL NUMBER.	48" AFF TO TOP UNLESS NOTED OTHERWISE
	SWITCH, FOUR-WAY, 20 A, 120/277 VAC. REFER TO SPECIFICATIONS FOR DEVICE COLOR, WALL PLATE COLOR AND MATERIAL, AND DEVICE MODEL NUMBER.	48" AFF TO TOP UNLESS NOTED OTHERWISE
	DIMMER SWITCH, SLIDE CONTROL, SINGLE POLE, 120/277 VAC, POWER RATING AS SHOWN ON PLANS. REFER TO SPECIFICATIONS FOR WALL PLATE COLOR AND MATERIAL. LUTRON: NOVA SERIES	48" AFF TO TOP UNLESS NOTED OTHERWISE
	DIMMER SWITCH, THREE-WAY, SLIDE CONTROL, SINGLE POLE, 120/277 VAC, POWER RATING AS SHOWN ON PLANS. REFER TO SPECIFICATIONS FOR WALL PLATE COLOR AND MATERIAL. LUTRON: NOVA SERIES	48" AFF TO TOP UNLESS NOTED OTHERWISE
	DUPLX RECEPTACLE, 20 A, 120 VAC. REFER TO SPECIFICATIONS FOR DEVICE COLOR, WALL PLATE REQUIREMENTS, AND DEVICE MODEL NUMBER.	UNLESS NOTED OTHERWISE, THE SYMBOLS SHOWN BELOW DEFINE MOUNTING HEIGHTS:
	TWO (2) DUPLX RECEPTACLES IN COMMON BOX, 20 A, 120 VAC. REFER TO SPECIFICATIONS FOR DEVICE COLOR, WALL PLATE REQUIREMENTS, AND DEVICE MODEL NUMBER.	18" AFF TO CENTERLINE
	SIMPLEX RECEPTACLE, 20 A, 120 VAC. REFER TO SPECIFICATIONS FOR DEVICE COLOR, WALL PLATE REQUIREMENTS, AND DEVICE MODEL NUMBER.	
	NON-FUSED DISCONNECT SWITCH, CURRENT RATING/FUSING/NUMBER OF POLES/ENCLOSURE	60" AFF TO TOP UNLESS NOTED OTHERWISE
	FUSED DISCONNECT SWITCH, CURRENT RATING/FUSING/NUMBER OF POLES/ENCLOSURE	60" AFF TO TOP UNLESS NOTED OTHERWISE
	ENCLOSED CIRCUIT BREAKER, CURRENT/FUSING/NUMBER OF POLES/ENCLOSURE	60" AFF TO TOP UNLESS NOTED OTHERWISE
	BRANCH CIRCUIT PANELBOARD, 120/208 V OR 120/240 V, SURFACE MOUNT	78" AFF TO TOP UNLESS NOTED OTHERWISE
	BRANCH CIRCUIT PANELBOARD, 120/208 V OR 120/240 V, FLUSH MOUNT	78" AFF TO TOP UNLESS NOTED OTHERWISE
	DISTRIBUTION PANELBOARD, 120/208 V OR 120/240 V, SURFACE MOUNT	78" AFF TO TOP UNLESS NOTED OTHERWISE
	BRANCH CIRCUIT PANELBOARD, 277/480 V, SURFACE MOUNT	78" AFF TO TOP UNLESS NOTED OTHERWISE
	BRANCH CIRCUIT PANELBOARD, 277/480 V, FLUSH MOUNT	78" AFF TO TOP UNLESS NOTED OTHERWISE
	DISTRIBUTION PANELBOARD, 277/480 V, SURFACE MOUNT	78" AFF TO TOP UNLESS NOTED OTHERWISE
	CONTACTOR CURRENT RATING OF CONTACTS/NUMBER OF CONTACTS/ENCLOSURE	60" AFF TO TOP UNLESS NOTED OTHERWISE
	AUTOMATIC TRANSFER SWITCH CURRENT RATING/ENCLOSURE	60" AFF TO TOP UNLESS NOTED OTHERWISE
	MANUAL TRANSFER SWITCH, CURRENT RATING/ENCLOSURE	60" AFF TO TOP UNLESS NOTED OTHERWISE
	COMMUNICATIONS OUTLET	18" AFF TO CENTERLINE UNLESS NOTED OTHERWISE
	COMMUNICATIONS OUTLET: SINGLE GANG, DEEP, FLUSH MOUNT BOX AND 3/4" C. WITH PULLSTRING. STUB CONDUIT UP INTO ACCESSIBLE CEILING SPACE AND TERMINATE WITH INSULATING BUSHING. COVER UNUSED BOXES WITH BLANK PLATE TO MATCH DEVICE WALLPLATES AND IDENTIFY FOR FUTURE. ALL TELEPHONE/DATA CABLING AND DEVICES SHALL BE PROVIDED BY OWNER OR OWNER'S REPRESENTATIVE.	18" AFF TO CENTERLINE UNLESS NOTED OTHERWISE

ELECTRICAL SYMBOL LEGEND		
SYMBOL	DESCRIPTION	MOUNTING
	TV CABLE CONNECTION AND DUPLET OUTLET IN SEPARATE SINGLE GANG FLUSH MOUNT BOXES. STUB-UP TV CABLE CONNECTION WITH 3/4" C. INTO ACCESSIBLE CEILING SPACE AND TERMINATE WITH INSULATING BUSHING. COVER UNUSED BOXES WITH BLANK COVER PLATE TO MATCH OUTLET COVER PLATE.	84" AFF TO CENTERLINE UNLESS NOTED OTHERWISE
	FIRE ALARM PULLSTATION, SEMI-FLUSH MOUNT ON RECESSED BOX.	48" AFF TO TOP UNLESS NOTED OTHERWISE
	FIRE ALARM HORN/STROBE COMBO, ADA COMPLIANT, SEMI-FLUSH MOUNT ON RECESSED BOX. COORDINATE MOUNTING HEIGHT WITH ARCHITECTURAL ELEVATIONS PRIOR TO INSTALL. TOP OF STROBE LENS SHALL NOT EXCEED 96" AFF.	MINIMUM OF 80" AFF TO BOTTOM OF STROBE LENS (SEE DESCRIPTION)
	FIRE ALARM STROBE, ADA COMPLIANT, SEMI-FLUSH MOUNT ON RECESSED BOX. COORDINATE MOUNTING HEIGHT WITH ARCHITECTURAL ELEVATIONS PRIOR TO INSTALL. TOP OF STROBE LENS SHALL NOT EXCEED 96" AFF.	MINIMUM OF 80" AFF TO BOTTOM OF STROBE LENS (SEE DESCRIPTION)
	SMOKE DETECTOR, SURFACE MOUNT ON RECESSED BOX.	CEILING UNLESS NOTED OTHERWISE
	HEAT DETECTOR, SURFACE MOUNT ON RECESSED BOX.	CEILING UNLESS NOTED OTHERWISE
	FIRE ALARM MAGNETIC DOOR HOLDER	AS NOTED ON PLANS
	*GFI" NOTATION MEANS ASSOCIATED DEVICE SHALL BE GROUND FAULT CIRCUIT INTERRUPTER TYPE. REFER TO SPECIFICATIONS FOR DEVICE COLOR, WALL PLATE REQUIREMENTS, AND MODEL NUMBER.	AS DEFINED BY SYMBOL
	*WP" NOTATION MEANS ASSOCIATED DEVICE SHALL BE MOUNTED IN WATERPROOF ENCLOSURE.	AS DEFINED BY SYMBOL
	*TR" NOTATION MEANS ASSOCIATED RECEPTACLE SHALL BE TAMPER RESISTANT TYPE. REFER TO SPECIFICATIONS FOR DEVICE COLOR, WALL PLATE REQUIREMENTS, AND MODEL NUMBER.	AS DEFINED BY SYMBOL
	HOME RUN TO PANEL. LABEL INDICATES PANEL NAME AND CIRCUIT NUMBER(S). CIRCUITS WITHOUT FURTHER DESIGNATION INDICATES A 2 WIRE CIRCUIT WITH A PARITY SIZED EQUIPMENT GROUND. CIRCUIT WITH MORE THAN 2 WIRES IS SHOWN AS FOLLOWS: ALL CONDUCTORS ARE #12 CU UNLESS NOTED OTHERWISE. * EQUIPMENT GROUND NOT SHOWN FOR CLARITY.	AS DEFINED BY SYMBOL
COMMON ABBREVIATIONS:		
AC	ABOVE COUNTER	EX EXISTING WR WEATHER RESISTANT
AFF	ABOVE FINISHED FLOOR	IAW IN ACCORDANCE WITH
AFG	ABOVE FINISHED GRADE	UG UNDERGROUND
BFG	BELOW FINISHED GRADE	UNO UNLESS NOTED OTHERWISE
AHJ	AUTHORITIES HAVING JURISDICTION	RL RELOCATED
EX	EXISTING DEVICE TO REMAIN	AS DEFINED BY SYMBOL
RL	NEW LOCATION FOR RELOCATED DEVICE	AS DEFINED BY SYMBOL
N	NEW DEVICE	AS DEFINED BY SYMBOL
CL	*CL" NOTATION MEANS ASSOCIATED DEVICE IS CEILING MOUNTED.	AS DEFINED
	RACEWAY RISER, UP OR DOWN AS NOTED.	SEE SPECIFICATIONS
	RACEWAY CONCEALED IN WALL OR ABOVE CEILINGS.	SEE SPECIFICATIONS
	RACEWAY CONCEALED UNDER FLOOR OR BELOW GRADE	SEE SPECIFICATIONS
	RACEWAY EXPOSED ON WALL OR CEILING	SEE SPECIFICATIONS

ELECTRICAL SHEET INDEX	
E1.0 - ELECTRICAL LEGEND AND SHEET INDEX	
E3.0 - ELECTRICAL DEMOLITION PLAN	
E4.0 - ELECTRICAL RENOVATION PLAN - LIGHTING	
E4.1 - ELECTRICAL RENOVATION PLAN - LIGHTING SECTIONS	
E5.0 - ELECTRICAL RENOVATION PLAN - POWER	
E6.0 - ELECTRICAL RISER DIAGRAM	
E7.0 - ELECTRICAL PANEL SCHEDULES	
E7.1 - ELECTRICAL PANEL SCHEDULES	
E9.0 - ELECTRICAL DETAILS	

APPLICABLE CODES	
NFPA 70 NATIONAL ELECTRIC CODE	2020
NFPA 72 NATIONAL FIRE ALARM CODE	2019
FLORIDA FIRE PREVENTION CODE (EIGHTH EDITION)	2023
FLORIDA BUILDING CODE (EIGHTH EDITION)	2023



INFRASTRUCTURE CONSULTING & ENGINEERING ARCHITECTURE
 5550 W. Idlewild Ave. Suite 115
 Tampa, FL 33634
 813-803-8928



201 FLAGSHIP DR., SUITE 106,
 LUTZ, FLORIDA 33549
 VOICE: (813) 909-1845
 FAX: (813) 909-0784
 Florida Registry Number: RY8135

Designed by: **TAB**
 Drawn by: **JMD**
 Checked by: **AJC**
 Project Number: **24-201.01**
 Notes:

AUSTIN J. CARLSON, PE
 Seal: FL REG NO. PE0090716

Scale Graphic:

REVISIONS		
No.	Description	Date
1	BID SET	09/19/2025

Project Name:
**RESTROOM RENOVATIONS
 VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
ELECTRICAL LEGEND AND SHEET INDEX

Date: **09-19-2025** Sheet Number: **E1.0**
 Scale: **As indicated** Drawing Number: **24-201.01**


BID SET

A


B

C


D

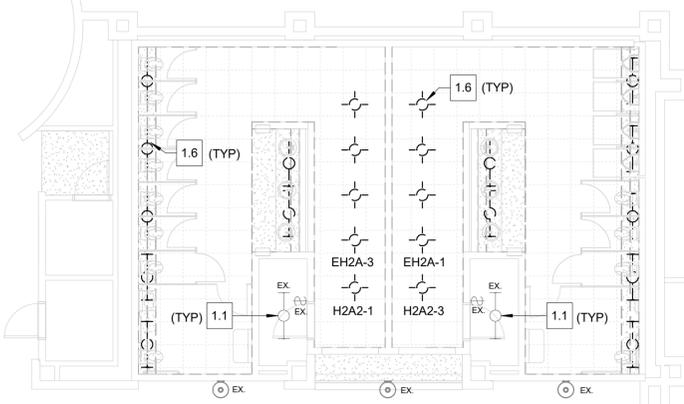

1 1st Floor Restroom Area B -
Lighting Demolition Plan - Bagclaim
1/8" = 1'-0"

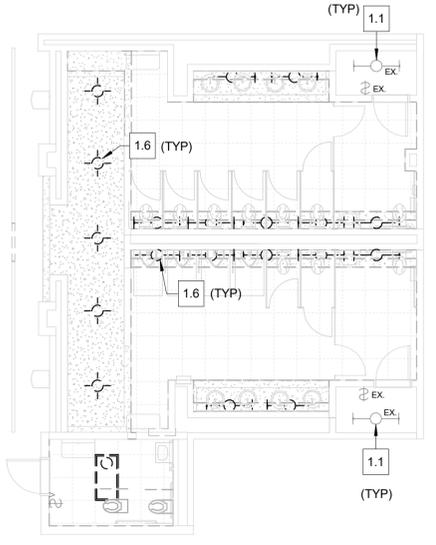


2 1st Floor Restroom Area C -
Lighting Demolition Plan -
Concourse A
1/8" = 1'-0"

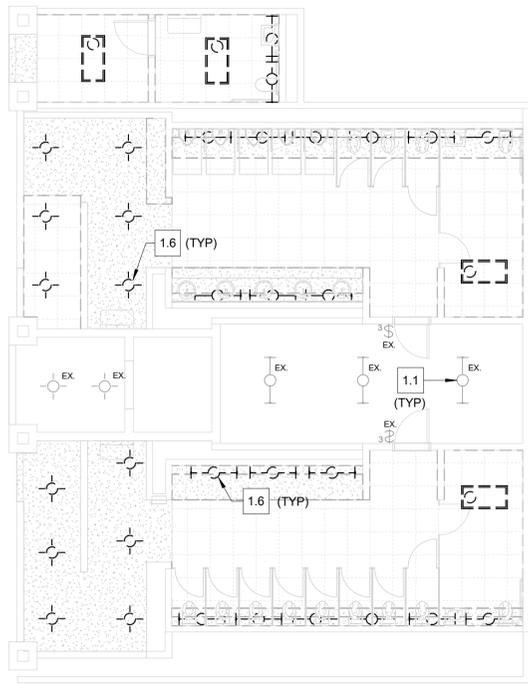


3 2nd Floor Restroom Area D -
Lighting Demolition Plan -
Concourse B (2nd Floor)
1/8" = 1'-0"

- DEMO DRAWING NOTES**
- 1.1 DEVICES DENOTED WITH "EX" ARE EXISTING TO REMAIN. MAINTAIN CONTINUITY OF THE EXISTING CIRCUITS AND DEVICES TO REMAIN.
 - 1.2 RECEPTACLE SHOWN DASHED SHALL BE REMOVED AND REPLACED WITH NEW GFCI-STYLE RECEPTACLE. RETAIN THE EXISTING CIRCUIT FOR RE-CONNECTION TO THE NEW RECEPTACLES.
 - 1.3 SPEAKER SHOWN DASHED SHALL BE REMOVED. SPEAKER SHALL BE REPLACED WITH A NEW SPEAKER. COORDINATE WITH THE OWNER WHETHER THE EXISTING SPEAKER CONDUCTORS CAN BE RE-USED FOR THE NEW SPEAKERS.
 - 1.4 FIRE ALARM DEVICE IS EXISTING TO REMAIN. PROTECT THE DEVICE DURING CONSTRUCTION.
 - 1.5 HOT WATER HEATER SHALL BE REMOVED AND REPLACED BY OTHERS. REMOVE THE ASSOCIATED DISCONNECT. THE EXISTING CIRCUIT SHALL BE RETAINED FOR RE-CONNECTION TO A NEW DISCONNECT TO SERVE THE NEW WATER HEATER.
 - 1.6 LIGHTING SHOWN DASHED SHALL BE REMOVED. RETAIN THE EXISTING CIRCUITS FOR RE-CONNECTION TO NEW FIXTURES.
 - 1.7 FIRE ALARM DEVICE TO BE RELOCATED. SEE POWER & SYSTEMS PLAN FOR NEW LOCATION. RELOCATED DEVICE TO BE RE-CONNECTED BACK TO THE EXISTING FIRE ALARM SYSTEM.
 - 1.8 RECEPTACLE SHOWN DASEHD SHALL BE REMOVED AND RELOCATED. SEE POWER & SYSTEMS PLAN FOR NEW LOCATION. RELOCATED DEVICE TO BE RE-CONNECTED BACK TO THE EXISTING RECEPTACLE CIRCUIT.
 - 1.9 EXISTING FIRE ALARM REMOTE ANNUCIATOR (FARA) TO BE REMOVED AND RELOCATED WITHIN THE SCOPE OF THE PROJECT. RECONNECT TO THE EXISTING FIRE ALARM SYSTEM AS REQUIRED.


- GENERAL DEMOLITION NOTES**
- A. REMOVE ALL SWITCHES, BOXES, DEVICES, ETC. IN THE PROJECT AREA MADE UNNECESSARY BY DEMOLITION. ELECTRICAL CONTRACTOR SHALL SURVEY THE PROJECT AREA TO DETERMINE THE EXTENT OF DEMOLITION WORK PRIOR TO SUBMITTING A BID.
 - B. REMOVE ALL ELECTRICAL WIRING MADE UNNECESSARY BY DEMOLITION COMPLETELY BACK TO THE SOURCE AND UPDATE PANEL SCHEDULES. RECONNECT ALL CIRCUITS AS REQUIRED FOR EXISTING DEVICES THAT ARE NOT BEING DEMOLISHED.
 - C. REMOVE ALL CONDUIT MADE UNNECESSARY BY THE DEMOLITION BACK TO SOURCE. WHERE REMOVAL IS NOT POSSIBLE DUE TO STRUCTURAL OR OTHER LIMITATIONS. CONDUIT SHALL BE CUT AT THE SURFACE AND CAPPED. ABANDONED CONDUIT SHALL BE TAGGED FOR FUTURE IDENTIFICATION.
 - D. COORDINATE WITH OWNER TO DETERMINE IF ANY MATERIALS OR DEVICES SHALL BE RETURNED TO THE OWNER FOR BUILDING STOCK. ALL MATERIALS NOT SPECIFICALLY REQUESTED BY THE OWNER SHALL BE DISPOSED OF BY THE CONTRACTOR.
 - E. THE CONTRACTOR SHALL VISIT THE JOB SITE AND DETERMINE THE EXTENT OF DEMOLITION WORK REQUIRED PRIOR TO SUBMITTING A BID. THE DEMOLITION WORK SHALL INCLUDE THE REMOVAL OF ALL RACEWAYS, DEVICES, BOXES, ETC., IN THE PROJECT AREA THAT ARE UNNECESSARY. THIS SHALL INCLUDE ALL EXISTING DEVICES IN THE PROJECT AREA THAT WERE MADE UNNECESSARY BY PREVIOUS WORK.
 - F. THE CONTRACTOR SHALL SUPPORT EXISTING CONDUIT AND JUNCTION BOXES IN THE AREA OF RENOVATION AS REQUIRED AND PROVIDE COVER PLATES FOR ANY EXISTING OPEN JUNCTION BOXES.

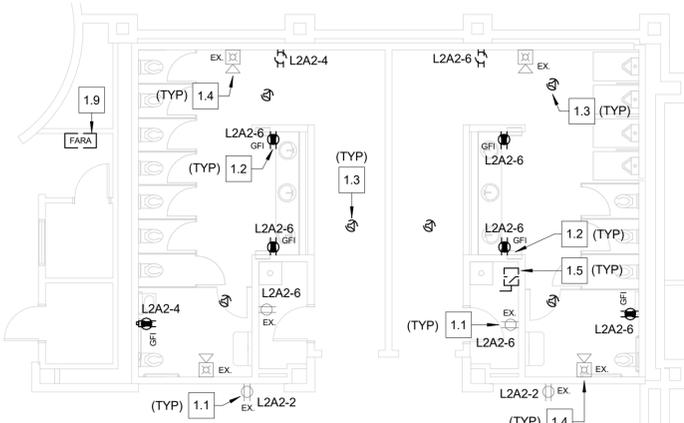

4 1st Floor Restroom Area B - Power
& Systems Demolition Plan -
Bagclaim
1/8" = 1'-0"

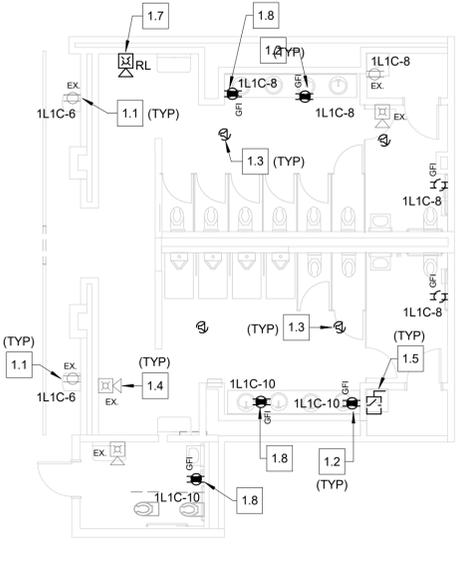

5 1st Floor Restroom Area C - Power
& Systems Demolition Plan -
Concourse A
1/8" = 1'-0"

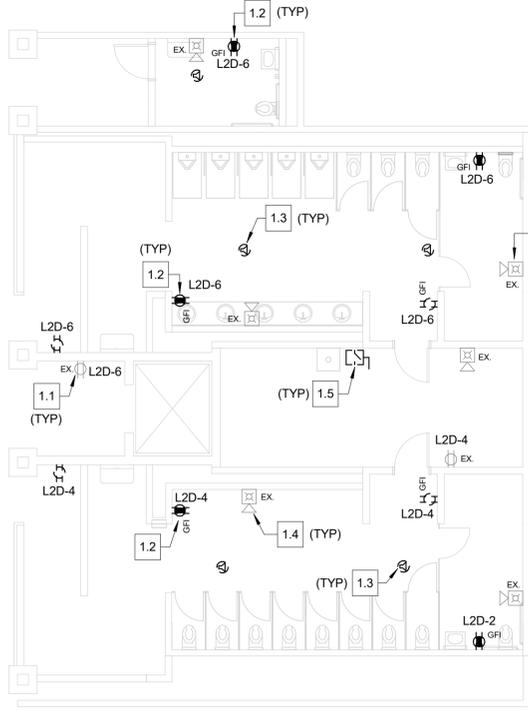

6 2nd Floor Restroom Area D -
Power & System Demolition Plan -
Concourse B (2nd Floor)
1/8" = 1'-0"



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928



201 FLAGSHIP DR., SUITE 106,
LUTZ, FLORIDA 33549
VOICE: (813) 909-1845
FAX: (813) 909-0784

Consultant Florida Registry Number: RY8135

Designed by:	TAB
Drawn by:	JMD
Checked by:	AC
Project Number:	24-201.01
Notes:	AUSTIN J. CARLSON, PE Seal FL REG NO. PE0090716

Scale Graphic:

REVISIONS

No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
VPS - DESTIN-FORT
WALTON BEACH
AIRPORT**

Drawing Name:
**ELECTRICAL DEMOLITION
PLAN**

Date:	09-19-2025	Sheet Number:	E3.0
Scale:	As indicated	Drawing Number:	24-201.01



INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928



201 FLAGSHIP DR., SUITE 106,
LUTZ, FLORIDA 33549
VOICE: (813) 909-1845
FAX: (813) 909-0764

Consultant Florida Registry Number: RY8135

Designed by:

TAB

Drawn by:

JMD

Checked by:

AJC

Project Number:

24-201.01

Notes:

AUSTIN J. CARLSON, PE
Seal FL REG NO. PE0090716

Scale Graphic:

REVISIONS

No.	Description	Date
1	BID SET	09/19/2025

Project Name:

RESTROOM RENOVATIONS
VPS - DESTIN-FORT WALTON BEACH AIRPORT

Drawing Name:

ELECTRICAL RENOVATION PLAN - POWER

Date:

09-19-2025

Sheet Number:


E5.0

Scale:


1/8" = 1'-0"

Drawing Number:


24-201.01

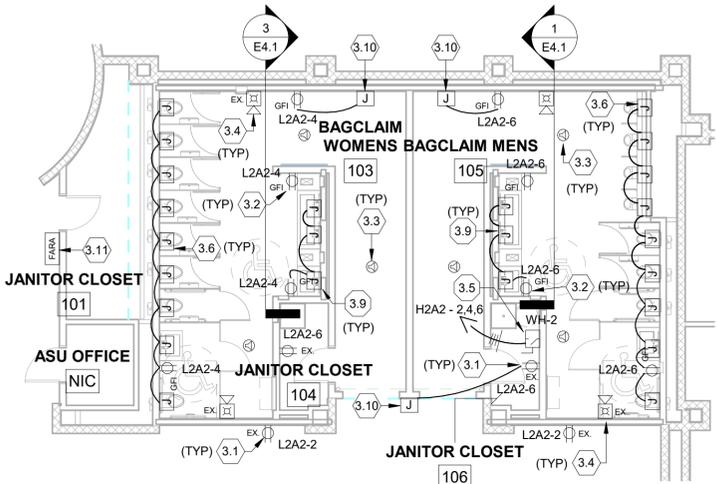

1 1st Floor Restroom Area B - Bagclaim
1/8" = 1'-0"

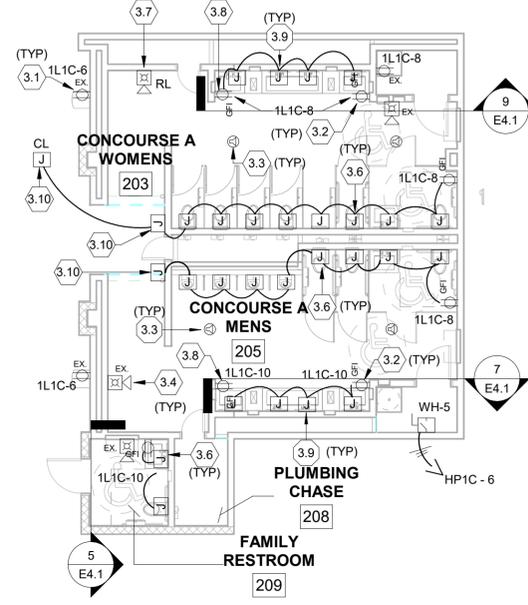

2 1st Floor Restroom Area C - Concourse A
1/8" = 1'-0"

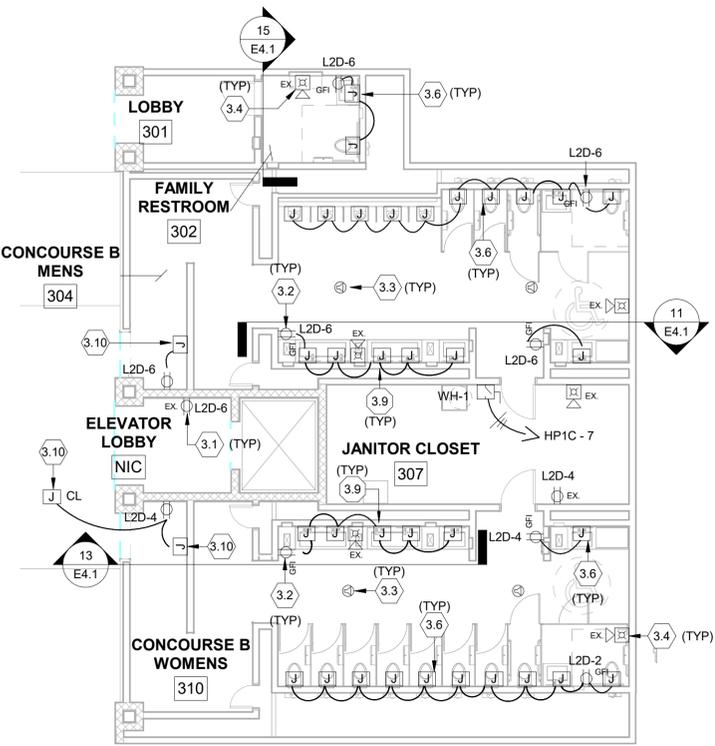

3 2nd Floor Restroom Area D - Concourse B (2nd Floor)
1/8" = 1'-0"

- POWER DRAWING NOTES**
- 3.1 DEVICES DENOTED WITH "EX" ARE EXISTING TO REMAIN. MAINTAIN THE CONTINUITY OF THE EXISTING CIRCUITS AND DEVICES TO REMAIN.
 - 3.2 FURNISH AND INSTALL NEW GFCI-STYLE RECEPTACLE AND CONNECT TO THE EXISTING CIRCUIT RETAINED FROM THE REMOVAL OF THE EXISTING RECEPTACLE.
 - 3.3 FURNISH AND INSTALL NEW CEILING-MOUNTED SPEAKER. ELECTRICAL CONTRACTOR SHALL COORDINATE THE EXACT SPEAKER MODEL TO BE FURNISHED AND INSTALLED. COORDINATE THE INSTALLATION OF THE NEW SPEAKER WITH THE OWNER AND THE OWNER'S IT DEPARTMENT TO CONNECT THE NEW SPEAKERS TO THE EXISTING SYSTEM AS REQUIRED.
 - 3.4 FIRE ALARM DEVICE IS EXISTING TO REMAIN. MAINTAIN THE CONTINUITY OF THE EXISTING FIRE ALARM DEVICES AND CONDUCTORS TO REMAIN.
 - 3.5 NEW HOT WATER HEATER TO BE FURNISHED AND INSTALLED BY THE MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL NEW 30A/3P/NF/N-1 DISCONNECT FOR THE NEW WATER HEATER. CONNECT TO THE EXISTING CIRCUIT RETAINED FROM THE DEMOLITION OF THE OLD WATER HEATER.
 - 3.6 PROVIDE 120V CIRCUIT TO THE LOCATION SHOWN FOR AUTOMATIC PLUMBING VALVES. CIRCUIT AS SHOWN.
 - 3.7 NEW LOCATION FOR RELOCATED FIRE ALARM DEVICE. RE-CONNECT TO THE EXISTING FIRE ALARM SYSTEM AS REQUIRED.
 - 3.8 FURNISH AND INSTALL NEW GFCI-STYLE RECEPTACLE IN A NEW LOCATION. RE-CONNECT TO THE EXISTING CIRCUIT SHOWN RETAINED FROM THE REMOVAL OF THE EXISTING RECEPTACLE.
 - 3.9 PROVIDE 120V CIRCUIT TO THE LOCATION SHOWN FOR SENSOR FAUCET. CIRCUIT AS SHOWN.
 - 3.10 FURNISH AND INSTALL JUNCTION BOX FOR LIGHTED SIGNAGE FURNISHED AND INSTALLED BY OTHERS. EXTEND 120V CIRCUIT FROM THE EXISTING RECEPTACLE CIRCUITS TO THE LIGHTED SIGNAGE LOCATION.
 - 3.11 NEW LOCATION FOR RELOCATED FIRE ALARM REMOTE ANNUNCIATOR (FARA). RECONNECT TO THE EXISTING FIRE ALARM SYSTEM AS REQUIRED.

A

B

C

D



INFRASTRUCTURE CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115 Tampa, FL 33634 813-803-8928



201 FLAGSHIP DR., SUITE 106, LUTZ, FLORIDA 33549 VOICEMAIL: (813) 909-1845 FAX: (813) 909-0764 Florida Registry Number: RY8135

Designed by: TAB
Drawn by: JMD
Checked by: AIC
Project Number: 24-201.01
AUSTIN J. CARLSON, PE
Seal FL REG NO. PE0090716

Notes:

Scale Graphic:

REVISIONS

Table with 3 columns: No., Description, Date

Project Name:

RESTROOM RENOVATIONS VPS - DESTIN-FORT WALTON BEACH AIRPORT

Drawing Name:

ELECTRICAL PANEL SCHEDULES

Date: 09-19-2025 Sheet Number: E7.0
Scale: Drawing Number: 24-201.01

BID SET

A

B

C

D

Electrical panel schedule for Panel H2A2. Includes branch name, panel name, location, and a detailed load table with columns for LTG, COOL, HEAT, RCPT, MISC, Circuit Description, Trip, Po., C., A, B, C, G., Po., Trip, and LOAD. Includes summary tables for connected and demand loads.

Electrical panel schedule for Panel L2A2. Includes branch name, panel name, location, and a detailed load table with columns for LTG, COOL, HEAT, RCPT, MISC, Circuit Description, Trip, Po., C., A, B, C, G., Po., Trip, and LOAD. Includes summary tables for connected and demand loads.

Electrical panel schedule for Panel EH2A. Includes branch name, panel name, location, and a detailed load table with columns for LTG, COOL, HEAT, RCPT, MISC, Circuit Description, Trip, Po., C., A, B, C, G., Po., Trip, and LOAD. Includes summary tables for connected and demand loads.

Electrical panel schedule for Panel IL1C. Includes branch name, panel name, location, and a detailed load table with columns for LTG, COOL, HEAT, RCPT, MISC, Circuit Description, Trip, Po., C., A, B, C, G., Po., Trip, and LOAD. Includes summary tables for connected and demand loads.

A

B

C

D


KBA Engineering, Inc. PH# 813-909-1845														MFG STD: SQUARE-D NF CABINET: SURFACE MOUNT, N-1 RATING: 35,000 AIC FULLY RATED SIZE: 225 A MLO FED BY: ATS-LB																											
PANEL NAME: EH2C LOCATION: AREA C 2ND FLOOR ELEC RM VOLTAGE/PHASE: 480/277 Wye 3PH 4W														MFG STD: SQUARE-D E2 CABINET: SURFACE MOUNT, N-1 RATING: 10,000 AIC FULLY RATED SIZE: 100 A MCB FED BY: L2D-XFRMR																											
BRANCH: EMERGENCY PANEL: EXISTING														BRANCH: NORMAL PANEL: EXISTING																											
LOAD (VA)														LOAD (VA)																											
LTG	COOL	HEAT	RCPT	MISC	Circuit Description	Trip	Po.	C.	A	B	C	C.	Po.	Trip	Circuit Description	MISC	RCPT	HEAT	COOL	LTG																					
3620				69	LTG 2ND AREA C	20	1	1	3688	2645			2	1	20	LTG 2ND AREA D				2645																					
2968				41	LTG 2ND AREA C	20	1	3		3009	2745		4	1	20	LTG 2ND AREA D				2745																					
1292					LTG 1ST AREA D	20	1	5			1292	720	6	1	20	LTG 1ST AREA C				720																					
2050					LTG EXT AREA D	20	1	7	2050	3021			8	1	20	LTG 1ST AREA C				2990																					
630					LTG EXT AREA D	20	1	9		630	2790		10	1	20	LTG 1ST AREA C				2725																					
								11				2520	12	1	20	LTG 2ND AREA C				2520																					
								13	0				14	3	20	EH2D																									
								15		0			16	--	--																										
								17				0	18	--	--																										
100		4120	5450		EL2C-XFRMR	20	3	19	9670	8620			20	3	20	EL1C-XFRMR	1800	4620		200																					
0		3580	6300	--		--	--	21		9880	5680			22	--	--				200																					
0		4340	4050	--		--	--	23			8390	5730	24	--	--					200																					
CONNECTED LOAD SUMMARY (VA)														DEMAND LOAD SUMMARY																											
TOTALS														D.F.																											
LIGHTING 25,986 VA														125.00%														LOAD 31,993 VA													
COOL 0 VA																												0 VA													
HEAT 0 VA																												0 VA													
RCPT 24,220 VA														70.64%														17,110 VA													
MISC 21,257 VA														100.00%														21,257 VA													
LARGE MOTOR 0 VA																												0 VA													
TOTAL CONNECTED LOAD PER PHASE																												TOTAL DEMAND LOAD 70,360 VA													
PHASE A 27,695 VA														103.4 A														TOTAL DEMAND CURRENT 84.6 A													
PHASE B 24,724 VA														92.6 A																											
PHASE C 18,652 VA														67.3 A																											
Notes:																												MIN. SERVICE AMPS REQUIRED 84.6 A													

KBA Engineering, Inc. PH# 813-909-1845														MFG STD: SQUARE-D NF CABINET: SURFACE MOUNT, N-1 RATING: 25,000 AIC FULLY RATED SIZE: 100 A MLO FED BY: H2C																											
PANEL NAME: H2D LOCATION: AREA D 2ND FLOOR ELEC RM VOLTAGE/PHASE: 480/277 Wye 3PH 4W														MFG STD: SQUARE-D NF CABINET: SURFACE MOUNT, N-1 RATING: 35,000 AIC FULLY RATED SIZE: 225 A MLO FED BY: MSBB																											
BRANCH: NORMAL PANEL: EXISTING														BRANCH: NORMAL PANEL: EXISTING																											
LOAD (VA)														LOAD (VA)																											
LTG	COOL	HEAT	RCPT	MISC	Circuit Description	Trip	Po.	C.	A	B	C	C.	Po.	Trip	Circuit Description	MISC	RCPT	HEAT	COOL	LTG																					
					"UNKNOWN"	20	3	--	0	1260			3	20	L2D-XFRMR	0	1260			0																					
					--	--	--	--		3540			--	--	--		0	2340			1200																				
					--	--	--	--			0	2940	--	--	--		60	2880			0																				
3445					LTG. EXT. AREA D	20	1	1	3445	0			--	3	20	OW1 - XFRMR					0																				
2285					LTG. EXT. AREA D	20	1	3		2285	0		--	--	--																										
2300				123	LTG. 2ND HOLD RM	20	1	5				2443	0	--	--																										
105				123	LTG. 2ND HOLD RM	20	1	7	228				--	--	--																										
3255					LTG. TARMAC EAST	20	1	4		3255	0		16	1	20	SPARE OAKWELLS OK.	0				0																				
2790					LTG. TARMAC EAST	20	1	6			2790																														
434					LTG 1ST AIR OPS	20	1	2	434																																
2790					LTG. TARMAC WEST	20	1	10			2790																														
1860					LTG. WALL MTD.	20	1	12			1860																														
3255					LTG. TARMAC WEST	20	1	8	3255																																
				0	B5 B6 HOLD AREA	20	1	14		0																															
				0	"UNKNOWN"	20	1				0																														
													--	3	20	T-MOBILE A/C PANEL																									
												0	--	--	--																										
												0	--	--	--																										
												0	--	--	--																										
CONNECTED LOAD SUMMARY (VA)														DEMAND LOAD SUMMARY																											
TOTALS														D.F.																											
LIGHTING 23,739 VA														125.00%														LOAD 29,674 VA													
COOL 0 VA																												0 VA													
HEAT 0 VA																												0 VA													
RCPT 6,480 VA														100.00%														6,480 VA													
MISC 307 VA														100.00%														307 VA													
LARGE MOTOR 0 VA																												0 VA													
TOTAL CONNECTED LOAD PER PHASE																												TOTAL DEMAND LOAD 36,460 VA													
PHASE A 8,622 VA														31.1 A														TOTAL DEMAND CURRENT 43.9 A													
PHASE B 11,870 VA														43.6 A																											
PHASE C 10,033 VA														37.0 A																											
Notes:																												MIN. SERVICE AMPS REQUIRED 43.9 A													
* EXISTING 50A CB IS UNLABELLED AND HAS AN UNKNOWN CIRCUIT.																																									

KBA Engineering, Inc. PH# 813-909-1845														MFG STD: SQUARE-D E2 CABINET: SURFACE MOUNT, N-1 RATING: 10,000 AIC FULLY RATED SIZE: 100 A MCB FED BY: L2D-XFRMR																											
PANEL NAME: L2D LOCATION: AREA D 2ND FLOOR ELEC RM VOLTAGE/PHASE: 120/208V 3PH 4W														MFG STD: SQUARE-D NF CABINET: SURFACE MOUNT, N-1 RATING: 35,000 AIC FULLY RATED SIZE: 225 A MLO FED BY: MSBB																											
BRANCH: NORMAL PANEL: EXISTING														BRANCH: NORMAL PANEL: EXISTING																											
LOAD (VA)														LOAD (VA)																											
LTG	COOL	HEAT	RCPT	MISC	Circuit Description	Trip	Po.	C.	A	B	C	C.	Po.	Trip	Circuit Description	MISC	RCPT	HEAT	COOL	LTG																					
					720	RECP AREA D HOL	20	1	1	720	540		2	1	20	RECP AREA D RR	0	540			0																				
					720	RECP AREA D HOL	20	1	3		720	1620		4	1	20	RECP AREA D RR	0	1620			0																			
					720	RECP AREA D HOL	20	1	5			720	2220	6	1	20	RECP AREA D RR	60	2160			0																			
				0	RECP KIOSK	20	1	7	0	0			8	1	20	POTABLE WATER B1 JET WAY	0				0																				
				1200	LTG DISPLAY	20	1	9		1200	0		10	1	20	POTABLE WATER B3 JET WAY	0				0																				
				0	OVERHEAD DOOR	20	1	11			0		12	1	20	POTABLE WATER B2 JET WAY	0				0																				
				0	DE-ICER MACHINE	20	1	13	0	0			14	1	20	POTABLE WATER A2	0				0																				
				0	HELL AND BACK *	100	2	15		0	0		16	2	30	PP1 LK3P-2	0				0																				
				--	--	--	--	17	--	--	--		0	18	--	--					0																				
				100	3	19	0	0				20	2	30	PP1 LK30-1	0					0																				
				--	--	--	--	21	--	--	--		22	--	--						0																				
				--	--	--	--	23	--	--	--		0	24	--	--					0																				
CONNECTED LOAD SUMMARY (VA)														DEMAND LOAD SUMMARY																											
TOTALS														D.F.																											
LIGHTING 1,200 VA														125.00%														LOAD 1,500 VA													
COOL 0 VA																												0 VA													
HEAT 0 VA																												0 VA													
RCPT 6,480 VA														100.00%														6,480 VA													
MISC 60 VA														100.00%														60 VA													
LARGE MOTOR 0 VA																												0 VA													
TOTAL CONNECTED LOAD PER PHASE																												TOTAL DEMAND LOAD 8,040 VA													
PHASE A 1,200 VA														10.5 A														TOTAL DEMAND CURRENT 22.3 A													
PHASE B 3,540 VA														31.7 A																											
PHASE C 2,940 VA														26.7 A																											
Notes:																												MIN. SERVICE AMPS REQUIRED 22.3 A													
* DESCRIPTION OF EXISTING CIRCUIT MATCHES EXISTING PHYSICAL PANEL SCHEDULE WITHIN PANEL, WITH AN UNKNOWN LOAD.																																									

KBA Engineering, Inc. PH# 813-909-1845														MFG STD: SQUARE-D NF CABINET: SURFACE MOUNT, N-1 RATING: 35,000 AIC FULLY RATED SIZE: 225 A MLO FED BY: MSBB													
PANEL NAME: H2C LOCATION: AREA C 2ND FLOOR ELEC RM VOLTAGE/PHASE: 480/277 Wye 3PH 4W														MFG STD: SQUARE-D NF CABINET: SURFACE MOUNT, N-1 RATING: 35,000 AIC FULLY RATED SIZE: 225 A MLO FED BY: MSBB													
BRANCH: NORMAL PANEL: EXISTING														BRANCH: NORMAL PANEL: EXISTING													
CKT	Circuit Description	Poles	Frame Size	Trip Rating	A	B	C	Remarks																			
20	H2C-2	3	400 A	20 A	7,795	6,790	7,090																				
21	L1C-XFRMR	3	400 A	20 A	6,480	4,290	4,620																				
22	L2C-XFRMR	3	400 A	20 A	3,780	3,900	3,900																				
23	CL1C	3	400 A	20 A	0	0	0																				
24	H2D	3	400 A	20 A	8,622	11,870	10,033																				
25	CL2C	3	400 A	20 A	0	0	0																				
26	CL1B2-XFRMR	3	400 A	20 A	0	0	0																				
	SPARE	3	400 A	20 A	0	0	0																				
LOAD CLASSIFICATION				CONNECTED LOAD	DEMAND FACTOR	ESTIMATED DEMAND	PANEL TOTALS																				
LIGHTING				49,817 VA	125.00%	62,271 VA	TOTAL CONNECTED LOAD: 79,170 VA																				
COOL							TOTAL DEMAND LOAD: 62,634 VA																				
HEAT							TOTAL DEMAND CURRENT: 99 A																				
RCPT				27,980 VA	67.87%	18,990 VA																					
MISC				1,374 VA	100.00%	1,374 VA																					
LARGE MOTOR							MIN. SERVICE AMPS REQUIRED 99 A																				
Notes:																											


KBA Engineering, Inc. PH# 813-909-1845														MFG STD: SQUARE-D NF CABINET: SURFACE MOUNT, N-1 RATING: 35,000 AIC FULLY RATED SIZE: 800 A MLO FED BY: MSBB													
PANEL NAME: HP1C LOCATION: AREA C 2ND FLOOR ELEC RM VOLTAGE/PHASE: 480/277 Wye 3PH 4W														MFG STD: SQUARE-D NF CABINET: SURFACE MOUNT, N-1 RATING: 35,000 AIC FULLY RATED SIZE: 800 A MLO FED BY: MSBB													
BRANCH: NORMAL PANEL: EXISTING														BRANCH: NORMAL PANEL: EXISTING													
CKT	Circuit Description	Poles	Frame Size	Trip Rating	A	B	C	Remarks																			
1	SPARE	3	400 A	20 A	0	0	0																				
2	JET AIRE C18	3	400 A	20 A	22,725	22,725	22,724																				
3	GATE B2 GRPJ	3	400 A	20 A	0	0	0																				
4	JET AIRE C23	3	400 A	20 A	22,725	22,725	22,724																				
5	L1C1-XFRMR	3	400 A	20 A	2,712	1,176	1,176																				
6	WH-5	2	400 A	20 A	2,500	2,500																					
7	WH-1	2	400 A	20 A	3,000	3,000																					
8	WH-2 AREA C 1ST	3	400 A	20 A	3,334	3,333	3,333																				
9	WH-2 AREA C 2ND	3	400 A	20 A	3,334	3,333	3,333																				
10																											
11																											
12																											
13																											
14																											
15																											
16																											
17																											
18																											
19																											
20																											
LOAD CLASSIFICATION				CONNECTED LOAD	DEMAND FACTOR	ESTIMATED DEMAND	PANEL TOTALS																				
LIGHTING							TOTAL CONNECTED LOAD: 172,412 VA																				
COOL							TOTAL DEMAND LOAD: 172,412 VA																				
HEAT							TOTAL DEMAND CURRENT: 207 A																				
RCPT				360 VA	100.00%	360 VA																					
MISC				172,052 VA	100.00%	172,052 VA																					
LARGE MOTOR																											

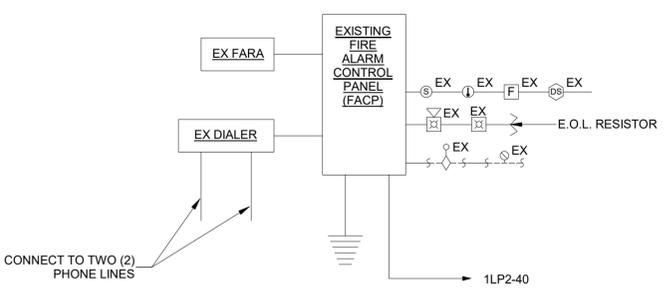


FIRE ALARM SYSTEM - WIRING SCHEDULE	
CONDUCTORS	DESCRIPTION
2C #16 SHIELDED TWISTED PAIR	ADDRESSABLE INITIATION AND RELAY DEVICES
2C #12 AWG THIN	STROBE, LIGHT
2C #16 TWISTED	SPEAKER

8 TYPICAL FIRE ALARM RISER DIAGRAM
NOT TO SCALE

- FIRE ALARM GENERAL NOTES**
- FIRE ALARM SYSTEM EQUIPMENT SHOWN FOR GENERAL SYSTEM SPECIFICATION AND SCOPE OF WORK. FIRE ALARM PERMIT DRAWINGS SHALL BE PREPARED AND SUBMITTED BY THE FIRE ALARM SYSTEM CONTRACTOR.
 - PROVIDE SURGE SUPPRESSION ON ALL FIRE ALARM SIGNAL CIRCUITS.
 - CONTRACTOR SHALL VERIFY DEVICE QUANTITIES ON FLOOR PLANS.
 - ELECTRICAL CONTRACTOR SHALL PLACE FIRESTOPPING MATERIALS AROUND ALL CONDUIT PENETRATIONS THRU ANY FIRE RATED WALLS AND FLOORS, PER NEC 300-21.

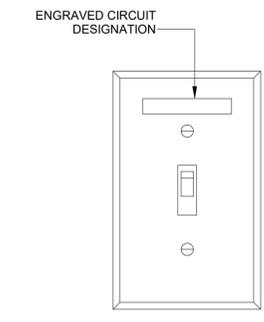

6 TYPICAL SWITCH DETAIL
NOT TO SCALE

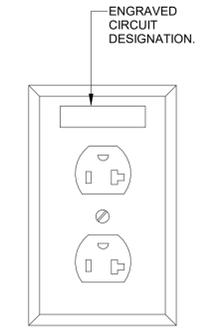

7 TYPICAL RECEPTACLE DETAIL
NOT TO SCALE



JE INFRASTRUCTURE
CONSULTING & ENGINEERING

ARCHITECTURE

5550 W. Idlewild Ave. Suite 115
Tampa, FL 33634
813-803-8928



201 FLAGSHIP DR., SUITE 106,
LUTZ, FLORIDA 33549
VOICE: (813) 909-1845
FAX: (813) 909-0764

Consultant Florida Registry Number: RY8135

Designed by: **TAB**
 Drawn by: **JMD**
 Checked by: **AJC**
 Project Number: **24-201.01**
 Austin J. Carlson, PE
 Seal: FL REG NO. PE0090716

Notes:

Scale Graphic:

REVISIONS		
No.	Description	Date

Project Name:
**RESTROOM RENOVATIONS
 VPS - DESTIN-FORT WALTON BEACH AIRPORT**

Drawing Name:
ELECTRICAL DETAILS

Date: **09-19-2025** Sheet Number: **E9.0**
 Scale: **12" = 1'-0"** Drawing Number: **24-201.01**